
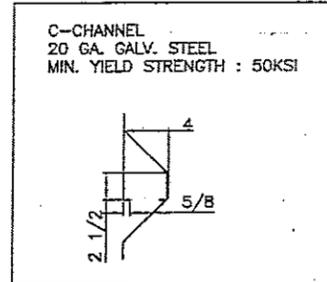
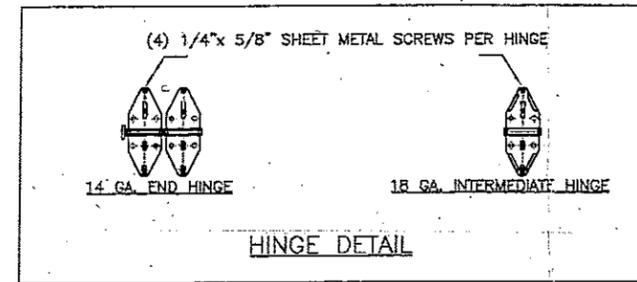


NOTE 1: THE DOOR MUST BE INSTALLED WITH EITHER AN ELECTRONIC OPERATOR OR A LOCKING DEVICE. ALL DOORS W/O OPERATOR MUST HAVE LOCK(S) THAT ENGAGE BOTH TRACKS.


NOTE 2: TEST PERFORMED TO ASTM E330 AND ANSI/DASMA 108-2002
DESIGN PRESSURE +22.0/-24.5
TEST PRESSURE +38.2/-36.9

NOTE 3: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING. GUIDELINES FOR THE JAMB CONSTRUCTION ARE CONTAINED IN TECHNICAL DATA SHEETS TDS-156 AND TDS-161 AT WWW.DASMA.COM


NOTE 4:
DOORS UP TO 7'-0" HIGH CONSIST OF (4) SECTIONS (SHOWN)
DOORS OVER 8'-0" HIGH CONSIST OF (5) SECTIONS (NOT SHOWN)
MAX DOOR HEIGHT=12'W/NO SECTION EXCEEDING 21"

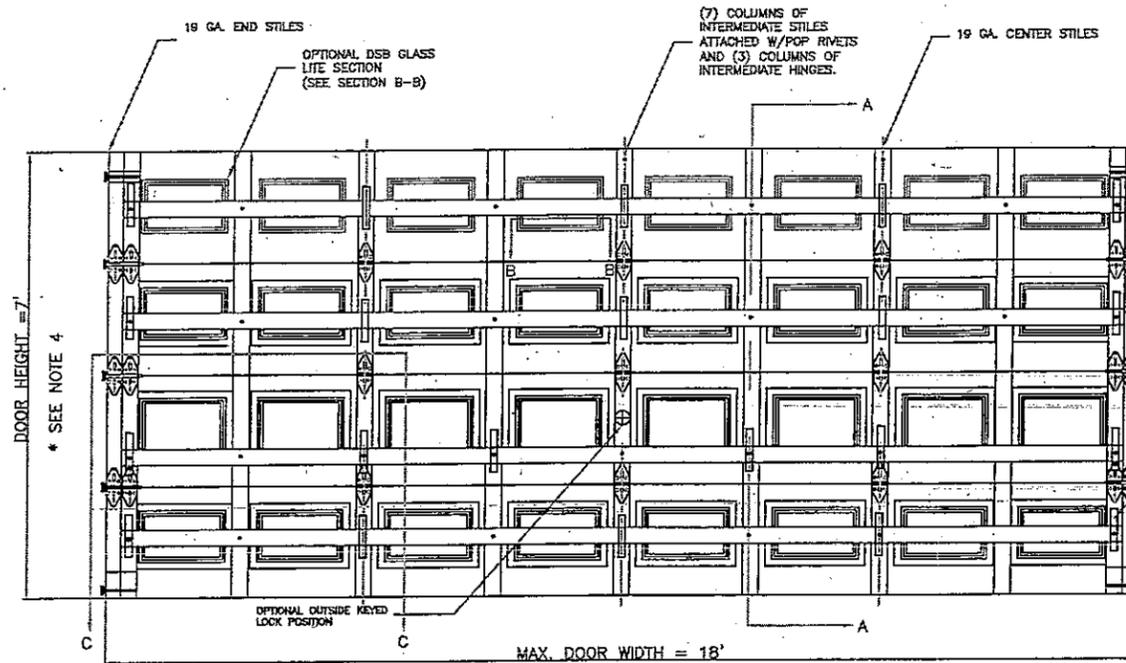


INSIDE ELEVATION

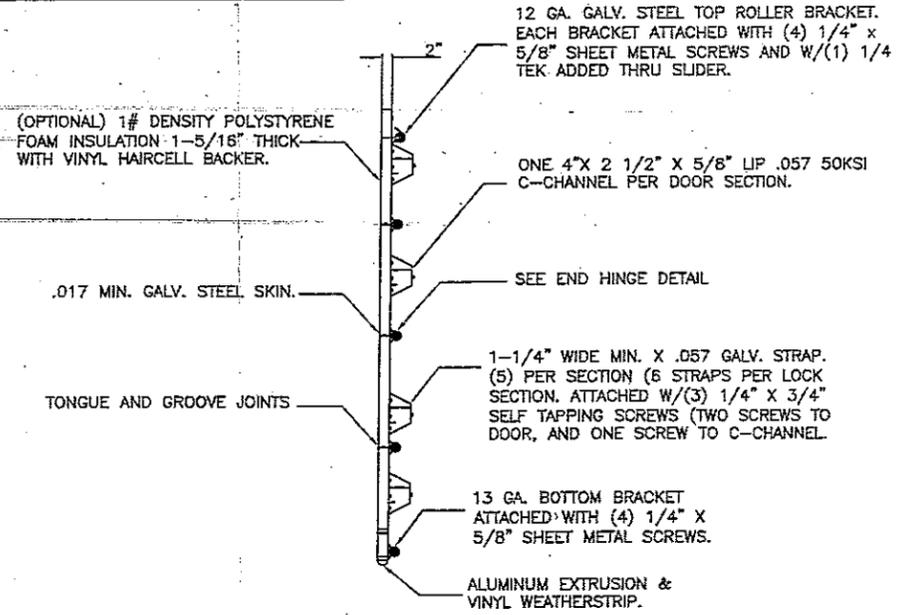


SECTION A-A

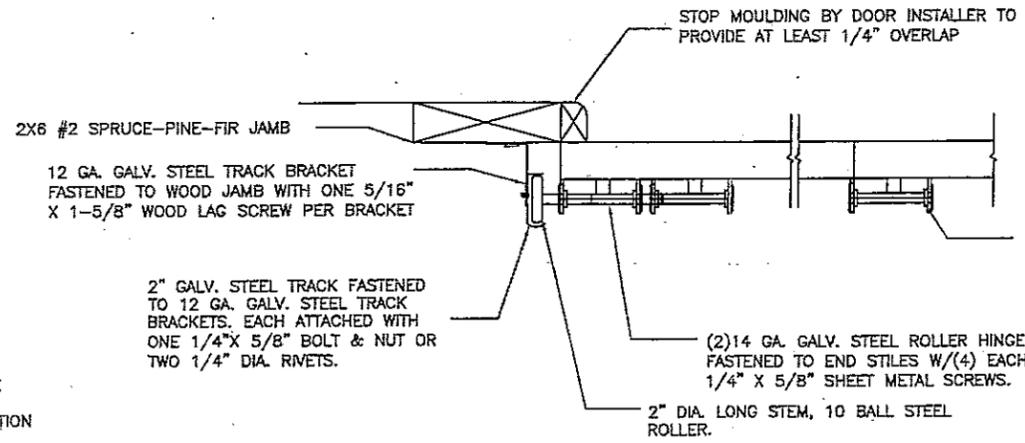

JAMB CONFIGURATION SECTION C-C (PREPARATION OF JAMBS BY OTHERS)

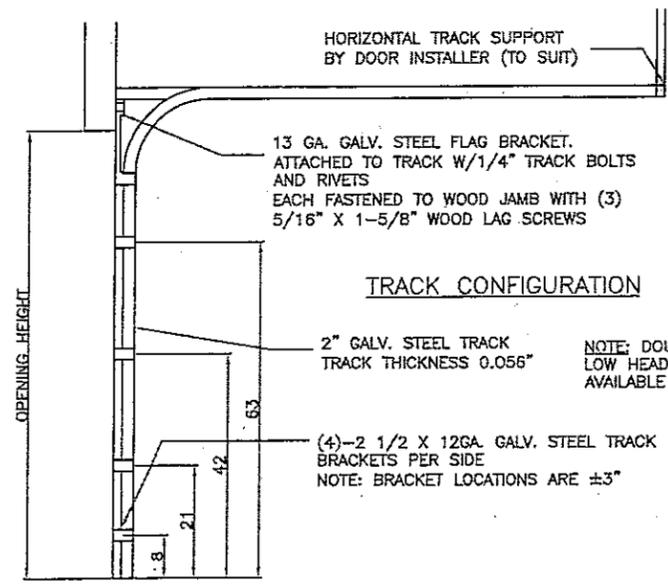

TRACK CONFIGURATION

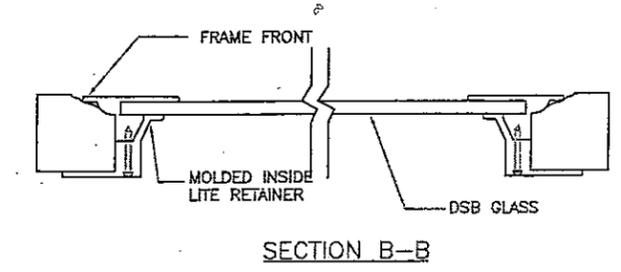

SECTION B-B

Professional Engineers seal provided only for verification of windload construction details.

Professional Engineer Seal for John E. Scates, P.E., State of Texas, License No. 20556, dated 11/29/05.

Professional Engineer Seal for John E. Scates, P.E., State of North Carolina, License No. 28896, dated 11/29/05.

Professional Engineer Seal for John E. Scates, P.E., State of South Carolina, License No. 23448, dated 11/29/05.

DoorLink Manufacturing Co., Inc.
1501 Taney Ave.
North Kansas City, Missouri 64116



WIND LOAD RATED RESIDENTIAL DOOR MODELS: 510,511,410,411,430,431,450,451,470,471			
DRAWN BY: GDR	SIZE 18'-0" X 7'-0"	DRAWING NO. RO18A-120	REV.
APPROVED BY:	SCALE: N/A	120 MPH WR	SHEET 1 OF