
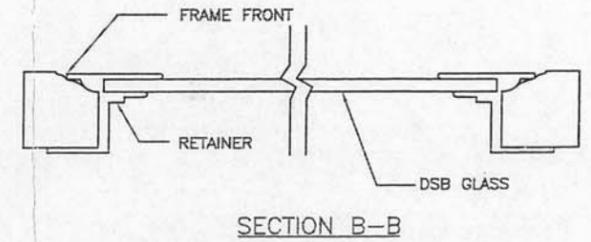
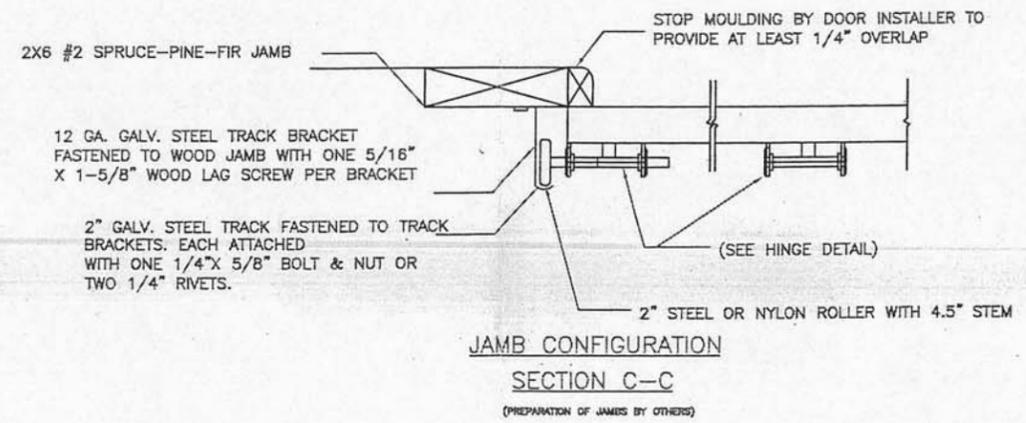
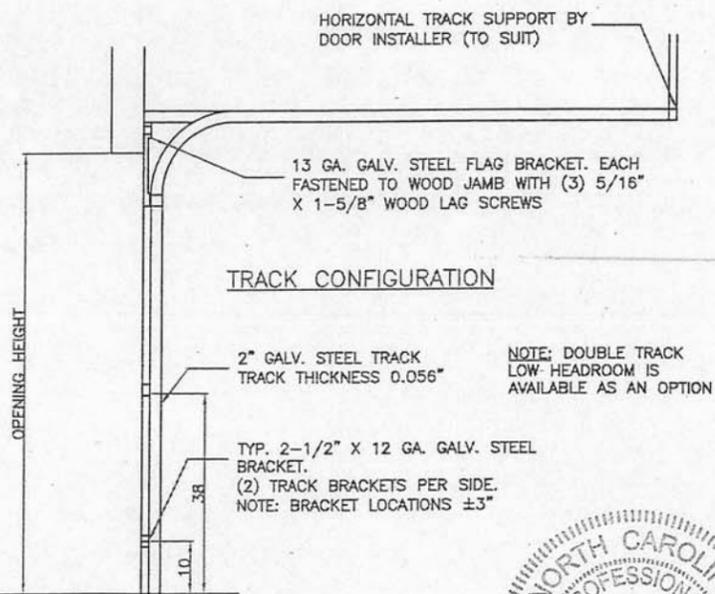
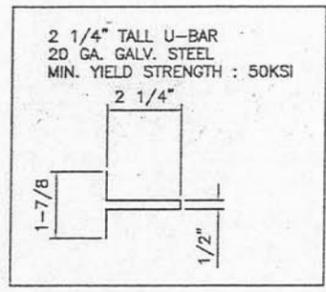
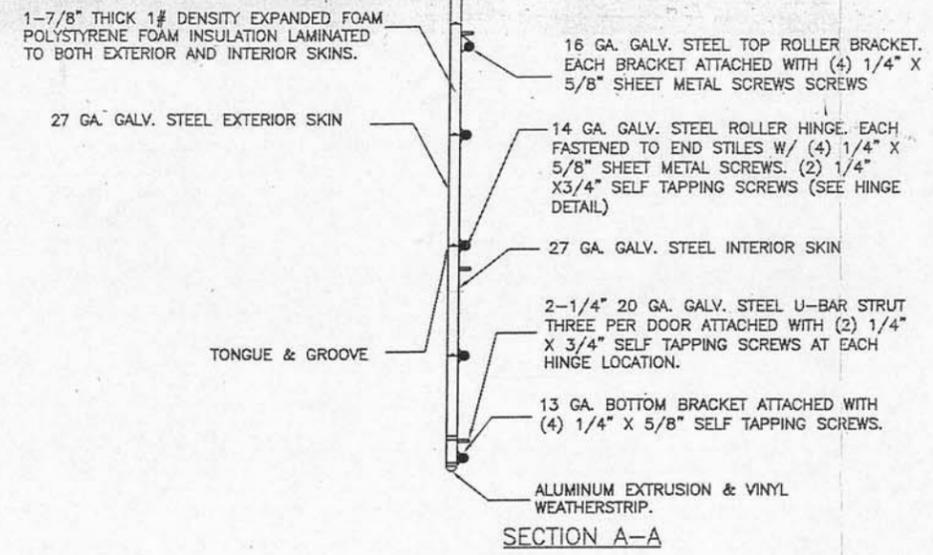
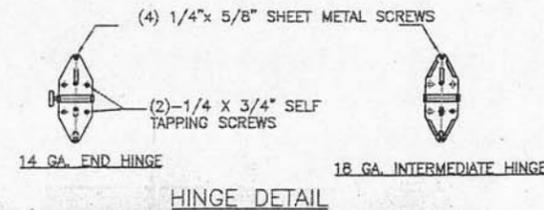


NOTE 1: THE DOOR MUST BE INSTALLED WITH EITHER AN ELECTRONIC OPERATOR OR A LOCKING DEVICE. ALL DOORS W/O OPERATOR MUST HAVE LOCK(S) THAT ENGAGE BOTH TRACKS.


NOTE 2: TEST PERFORMED TO ASTM E330 AND ANSI/DASMA 108-2002 DESIGN PRESSURE +22.9 / -26.3 TEST PRESSURE +34.3 / -39.4 MODEL 3610, 3630, 3650

NOTE 3: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING. GUIDELINES FOR THE JAMB CONSTRUCTION ARE CONTAINED IN TECHNICAL DATA SHEETS TDS-156 AND TDS-161 AT WWW.DASMA.COM

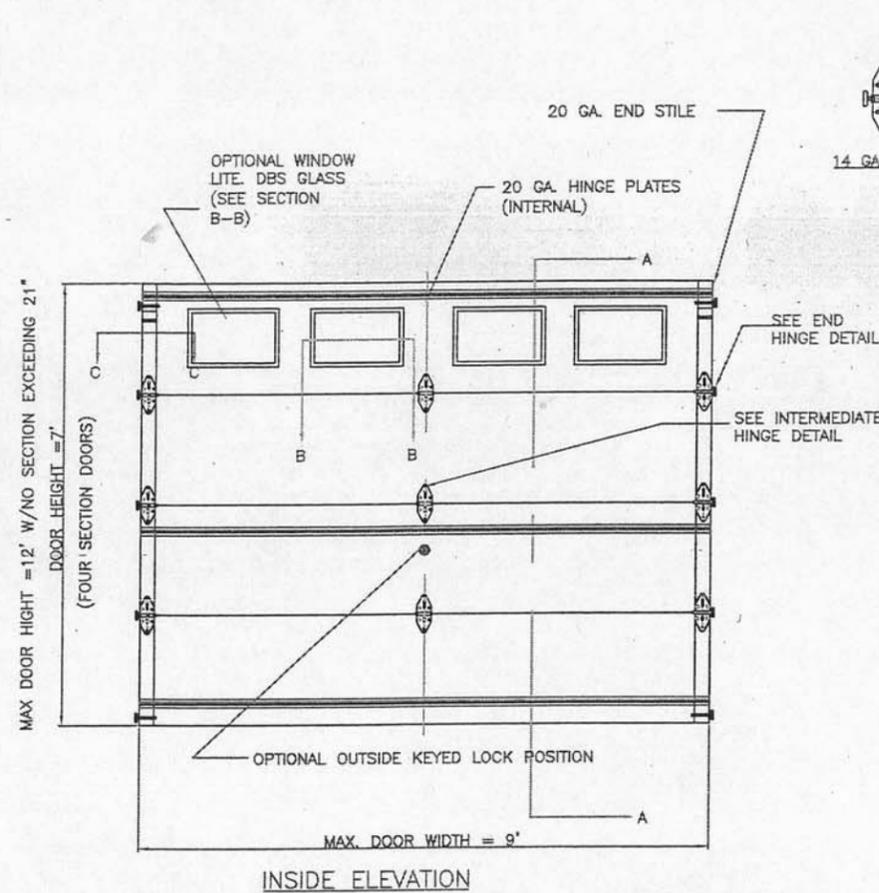

Professional Engineer's seal provided only for verification of windload construction details.

John E. Scates, P.E.
1411 Lemay #205
Carrollton, TX 75007
11/29/05

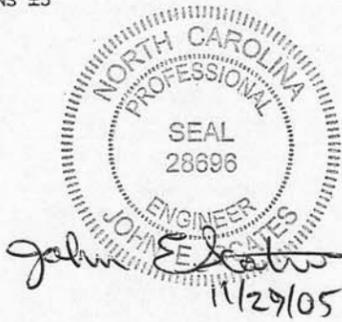

DoorLink Manufacturing Co., Inc.
1501 Taney Ave.
North Kansas City, Missouri 64116



WIND LOAD RATED RESIDENTIAL DOOR
MODELS: 3610, 3630, 3650

| | | | |
|---------------|---------------------|-------------------------|--------------|
| DRAWN BY: GDR | SIZE 9'0" X 7'0" | DRAWING NO. RS9A-120 | REV. |
| APPROVED BY: | SCALE: N/A | 120 MPH WR | SHEET 1 OF 1 |