


**NOTES:**

1. DOOR MUST OVERLAP JAMBS A MINIMUM OF 1" ON EACH SIDE OF OPENING.
2. SLIDE LOCK OR OPERATOR REQUIRED. LOW HEADROOM REQUIRES A LOCK ON BOTH SIDES.
3. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
4. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:  
EXTERIOR - 27 GA  
INTERIOR - 30 GA
5. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER SOUTHERN PINE. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
6. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A LHR TOP BRACKET IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. SEE LHR, DETAIL A, SHEET 2.
7. FOR LOW HEAD ROOM APPLICATIONS, THE UPPERMOST JAMB BRACKET IS OMITTED EXCEPT ON DOORS < 7' TALL.

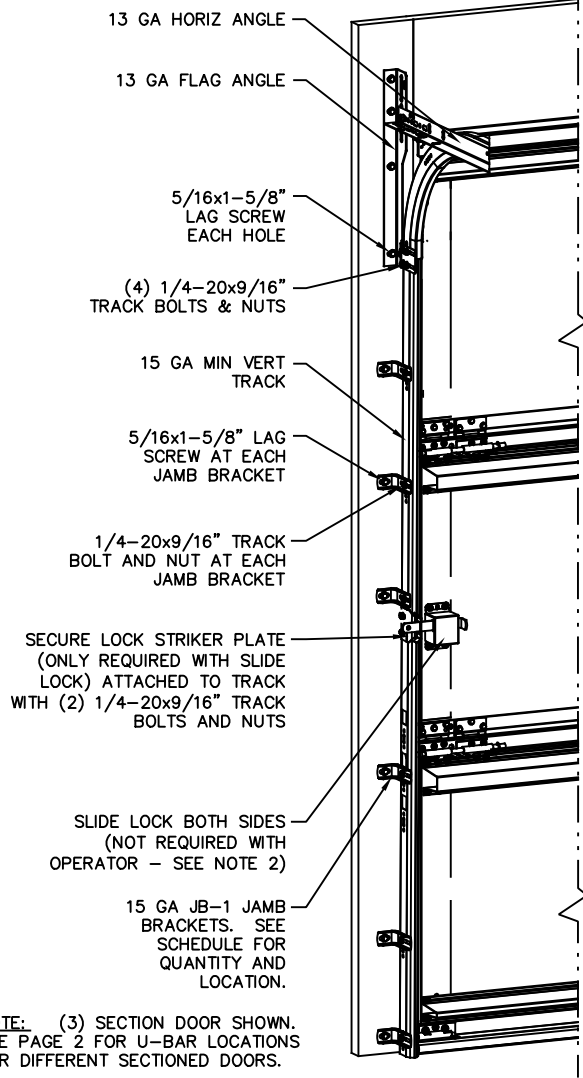


NOTE: (3) SECTION DOOR SHOWN. SEE PAGE 2 FOR U-BAR LOCATIONS FOR DIFFERENT SECTIONED DOORS.

JAMB BRACKET SCHEDULE			
DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
7'-0"	3	6	2", 10", 26", 42", 53", 63"
8'-0"	4	8	2", 10", 26", 39", 48", 57", 66", 75"
> 8'-0"			SEE NOTE BELOW

NOTE: ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE		
DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
16'-2"	7'-0"	+316.9/-353.2
	8'-0"	+316.9/-353.2

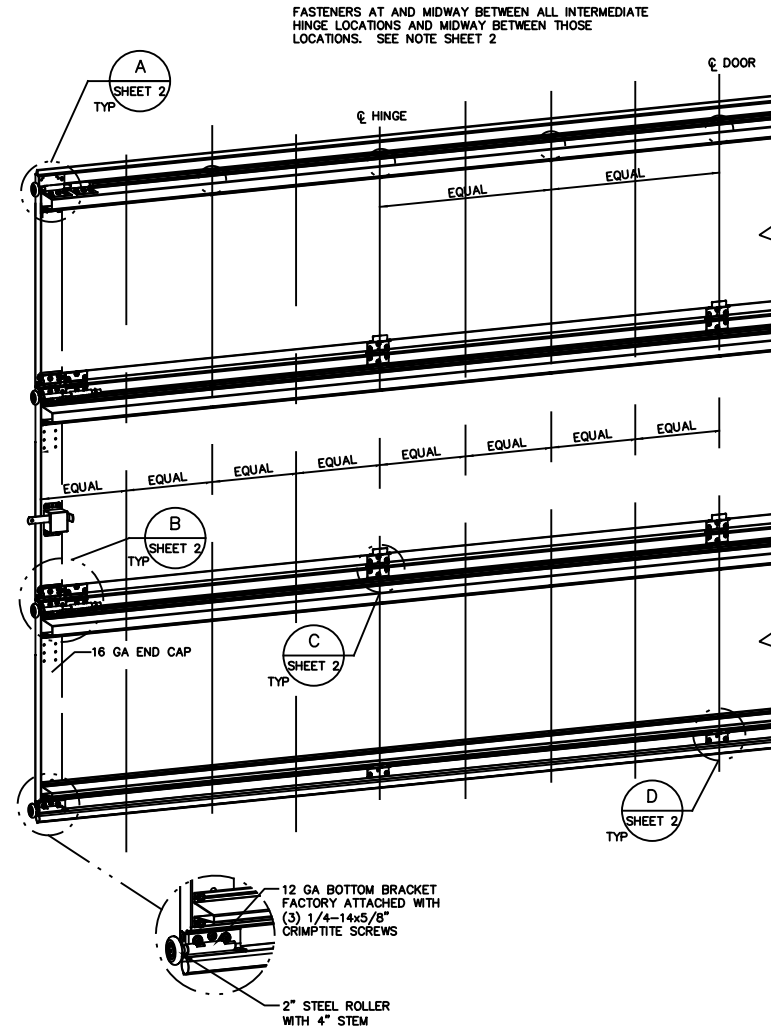

REVISIONS

P01 NEW DRAWING CREATED FOR UPDATED WINDLOAD CODES 8-19-16 GAC

P02 ER 31281 REV NOMENCLATURE TO 1144 GRADE STEEL ROLLER 2-3-17 GAC

C UPDATED PER PCR32744. UPDATED REV LEVELS TO ALPHABETICAL 12/8/21 SW


This door has been tested per ANSI/DASMA 108

**Wayne Dalton**


A DIVISION OF OVERHEAD DOOR CORP  
3395 ADDISON DRIVE  
PENSACOLA, FLORIDA 32514  
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+39.20/-43.70	MAX WIDTH:	16'-2"	DATE	1-20-16	NAME	GAC
IMPACT/CYCLIC RATED (YES/NO): NO		MAX HEIGHT:	14'-0"	DRAWN	1-20-16		
		MAX SECTION HEIGHT:	28"	CHECKED			
MODELS 9700/9510				SHEET 1 OF 2			
WINDLOAD SPECIFICATION OPTION CODE 0540				DRAWING PART NO.		REV.	
				359177		C	

**STANDARD LIFT TRACK**

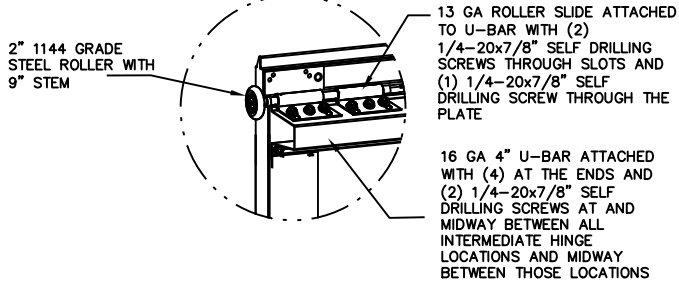

**LOW HEADROOM TRACK**

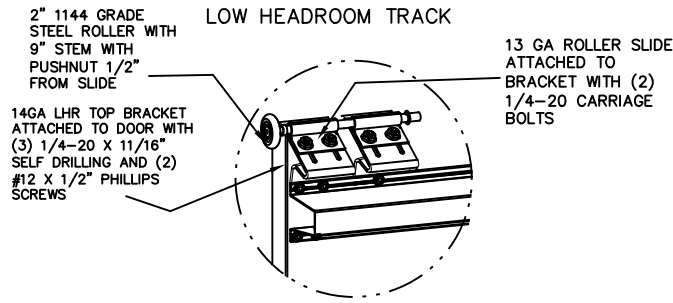

U-BAR LOCATIONS (7) SECTION DOORS WITH (7) 4" 16 GA & (1) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

**REVISIONS**

(2) 15 GA HINGE LEAFS ATTACHED WITH (3) 1/4-14x5/8" CRIMP TITE SCREWS EACH

**DETAIL A**

14 GA HINGE BASE FACTORY ATTACHED TO DOOR WITH (5) 1/4-14x5/8" CRIMP TITE SCREWS

POSITION U-BAR OVER REINFORCING BRACKET AND ATTACH WITH (4) 1/4-20x7/8" SELF DRILLING SCREWS PLUS 2 SCREWS BENEATH STRUT.

2" 1144 GRADE STEEL ROLLER WITH 9" STEM WITH PUSHNUT 1/2" FROM SLIDE

11 GA ROLLER CARRIERS (WELDED) ATTACHED TO HINGE BASE USING (2) 1/4-20x9/16" TRACK BOLTS AND NUTS EACH.



**BEFORE U-BAR INSTALLATION**

**AFTER U-BAR INSTALLATION**

11 GA REINFORCING BRACKET ATTACHED TO HINGE BASE WITH (4) 1/4-20x9/16" TRACK BOLTS & NUTS

**DETAIL B**

15 GA HINGE ATTACHED WITH (6) 1/4-14x5/8" CRIMP TITE SCREWS



POSITION U-BAR OVER HINGE LEAF AND ATTACH WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS AS SHOWN



**BEFORE U-BAR INSTALLATION**

**AFTER U-BAR INSTALLATION**

**DETAIL C**

15 GA HINGE BRACKET ATTACHED WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS

POSITION U-BAR OVER HINGE BRACKET AND ATTACH WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS AS SHOWN



**BEFORE U-BAR INSTALLATION**

**AFTER U-BAR INSTALLATION**

**DETAIL D**


(6) SECTION DOORS WITH (6) 4" 16 GA & (1) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(5) SECTION DOORS WITH (5) 4" 16 GA & (1) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(4) SECTION DOORS WITH (4) 4" 16 GA & (1) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(3) SECTION DOORS WITH (3) 4" 16 GA & (1) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

UNLESS NOTED OTHERWISE, ALL U-BARS SHALL BE ATTACHED WITH A MINIMUM OF (4) FASTENERS AT EACH END, (2) FASTENERS AT ALL INTERMEDIATE HINGE LOCATIONS, MIDWAY BETWEEN INTERMEDIATE HINGE LOCATIONS, AND MIDWAY BETWEEN THOSE MIDWAY LOCATIONS. (SEE DIAGRAM SHEET 1). ALL FASTENERS USED TO ATTACH U-BARS SHALL BE 1/4-20x7/8" SELF DRILLING.

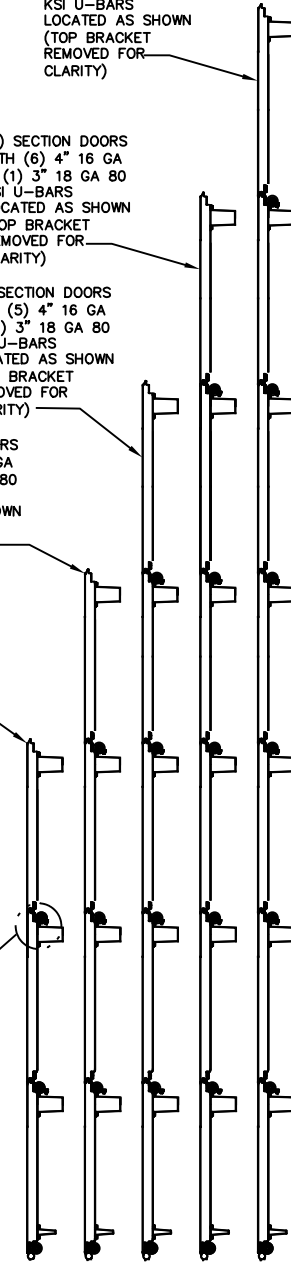

A DIVISION OF OVERHEAD DOOR CORP  
3395 ADDISON DRIVE  
PENSACOLA, FLORIDA 32514  
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+39.20/-43.70	MAX WIDTH: 16'-2"	DATE	NAME
IMPACT/CYCLIC RATED (YES/NO): NO		MAX HEIGHT: 14'-0"	DRAWN	GAC
		MAX SECTION HEIGHT: 28"	CHECKED	
MODELS 9700/9510			SHEET 2 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 0540			DRAWING PART NO.	REV.
			359177	C