




1/4" HOLE IS REQUIRED TO BE DRILLED THROUGH BOTH THE TRACK AND THE TRACK CLIP AT EACH TRACK CLIP LOCATION IN ORDER TO INSTALL SECOND


1/4-20x9/16" TRACK BOLT AND 1/4-20 HEX NUT.

1/4-20x9/16" TRACK BOLT AND 1/4-20 HEX NUT THROUGH THE SLOT IN THE TRACK AND TRACK CLIP



DETAIL A


13 GA ROLLER SLIDE ATTACHED TO BRACKET WITH 5/16-18 BOLT & NUT IN CENTER SLOT AND 1/4-20x9/16" TRACK BOLT & 1/4-20 HEX NUT THROUGH ANY TWO ALIGNING HOLES



DETAIL B

13 GA COMMERCIAL 'A' FRAME TOP BRACKETS EACH ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMP TITE SCREWS


ADD (2) 1/4-14x7/8" SELF DRILLING CRIMP TITE SCREWS (INSIDE OF EACH INSIDE END HINGE)



DETAIL C


2" STEEL ROLLER WITH 5-1/8" STEM AND 7/16" PUSHNUT AT EACH ROLLER LOCATION. 1/4" MAX BETWEEN PUSHNUT AND BRACKET OR HINGE

14 GA WIDE BODY END HINGES EACH ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMP TITE SCREWS




DETAIL D

14 GA WIDE BODY INTERMEDIATE HINGE ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMP TITE SCREWS



AFV SECTION

12 GA BOTTOM BRACKET ATTACHED WITH (3) 1/4-14x7/8" SELF DRILLING CRIMP TITE SCREWS




DETAIL E

MIN 3/16" THICK STEEL FOR MOUNTING MOUNTING WALL ANGLE

TRACK CLIP  
1/4-20x9/16" TRACK BOLT AND 1/4-20 HEX NUT  
TRACK

MOUNTING TO STEEL DETAIL




3/8" SIMPSON TITEN HD, 2-3/4" MIN EMBED INTO MIN 2000 PSI CONCRETE AT EACH HOLE OR PAIR OF HOLE LOCATION

MOUNTING WALL ANGLE  
TRACK CLIP  
(2) 1/4-20x9/16" TRACK BOLT AND 1/4-20 HEX NUT  
TRACK


CONCRETE MOUNTING DETAIL

OPTIONAL: WALL ANGLE MAY BE ATTACHED TO SUPPORTING STEEL WITH MIN. (1) 1/4-20x7/8" SELF DRILLING SCREW WITH 1" O.D. WASHER AT EACH HOLE OR PAIR OF HOLE LOCATIONS IN LIEU OF WELDING

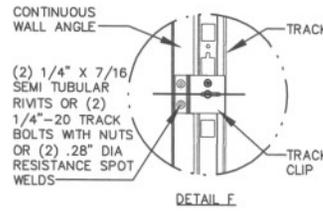

DETAIL F

CONTINUOUS WALL ANGLE  
(2) 1/4" x 7/16" SEMI TUBULAR RIVETS OR (2) 1/4"-20 TRACK BOLTS WITH NUTS OR (2) .28" DIA RESISTANCE SPOT WELDS

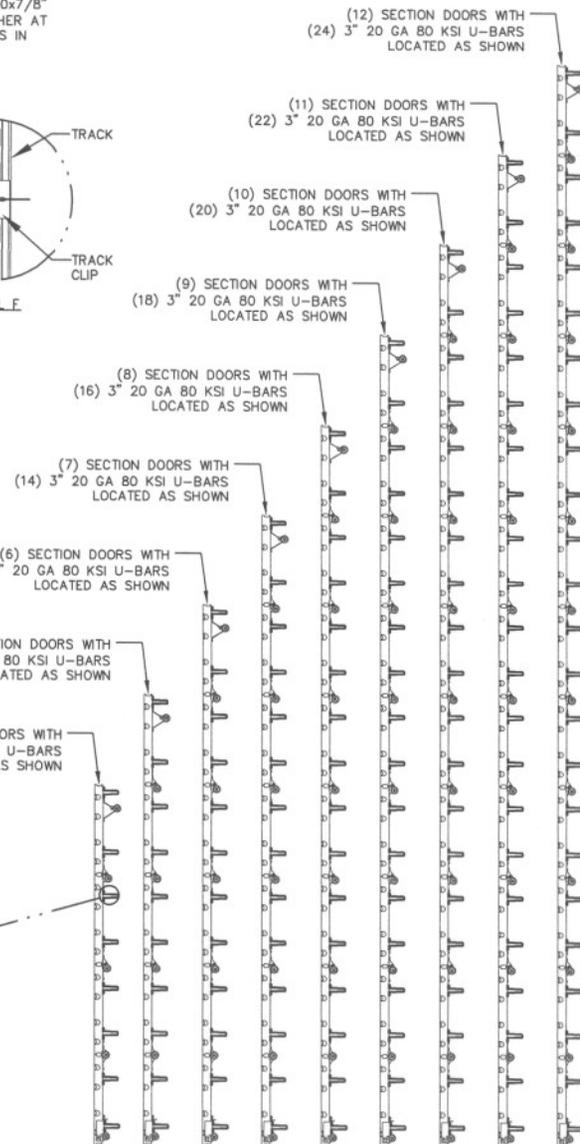

ATTACH U-BARS WITH (2) 1/4-14x7/8" SELF DRILLING CRIMP TITE SCREWS AT ALL STILE LOCATIONS, TYP.



REVISIONS	
P1	MODIFIED MOUNTING TO STEEL DETAIL. ADDED DETAIL F ON SHEET 2 FOR TRACK CLIPS. GRT 4/20/08

*Signature*  
S/30/08  
TX PE 93119

MARK R. BARROW, PE  
FLORIDA LICENSE NO. 57389

**Wayne Dalton**

3395 ADDISON DRIVE  
PENSACOLA, FLORIDA 32514  
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+44.00/-49.80	MAX WIDTH:	9'-2"	DATE		NAME	
TEST (PSF):	+66.00/-74.70	MAX HEIGHT:	24'-1"	DRAWN	5/22/07	GRT	
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT:	24'	CHECKED	10/05/07	MRB	
MODELS C20/C24/C2400				SHEET 2 OF 2			
WINDLOAD SPECIFICATION OPTION CODE 2003				DRAWING PART NO.		REV.	
				332572		P1	