
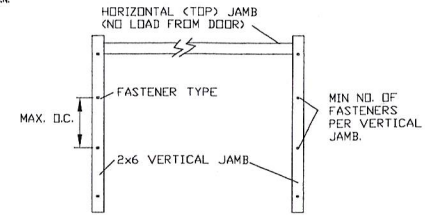
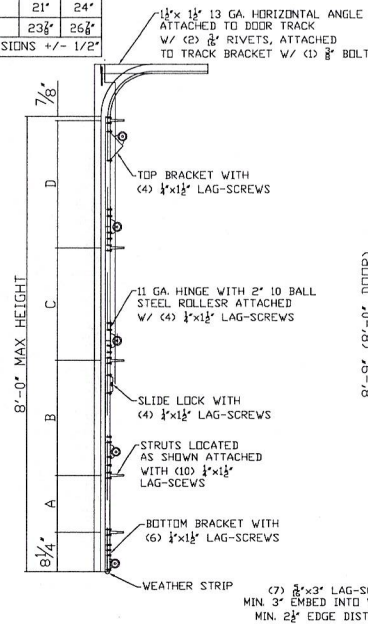


	DOOR HEIGHT	
STRUT SPACING	7'-0"	8'-0"
A	9"	12"
B	21"	24"
C	21"	24"
D	23 1/2"	26 1/2"
DIMENSIONS +/- 1/2"		

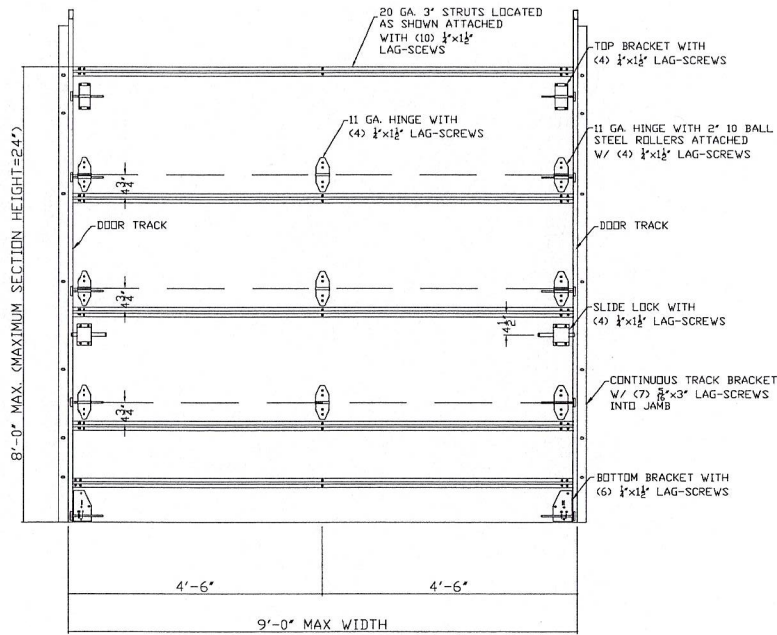

ALLOWABLE DESIGN PRESSURES	
+	35.0 PSF
-	35.0 PSF

NOTES:

1. THE WD-9 DOOR MEETS THE 2018 INTERNATIONAL BUILDING CODE AND 2018 INTERNATIONAL RESIDENTIAL CODE.
2. NON-IMPACT RATED.
3. ALLOWABLE DESIGN PRESSURE = +/- 35.0 PSF.
4. THE DOOR SECTIONS ARE CONSTRUCTED OF 1" THICK PINE FRAMING AROUND PERIMETER AND AT HINGE LOCATIONS. A 1" FOAM CORE IS BETWEEN FRAMING. 1/2" HARD BOARD SKIN ON EITHER SIDE AND 3/8" THICK TONGUE AND GROOVE CEDAR PLANKING ON EXTERIOR SIDE.






BJJ
6-15-2020

DATE DRAWN:	DATE CHECKED:	DATE APPROVED:	DESCRIPTION
12/07/09	12/07/09	12/07/09	
AF	TW	TW	
BY:	BY:	BY:	
DATE:	DATE:	DATE:	
REV:	REV:	REV:	
B	B	B	
DRAWN BY:			N/A
CHECKED BY:			
APPROVED BY:			
SCALE:			


Rev. Engineering & Drafting Inc.
6535 WALKWOOD DRIVE, HOUSTON, TX 77235
(281) 940-6600 Fax: (281) 940-9884

MODEL:	WD-9, 8' x 9' SECTIONAL DOOR
MANUFACTURER:	STENHART DOOR, LTD
MANUFACTURER ADDRESS:	1700 WEST LITTLE YORK, HOUSTON, TX 77064
MANUFACTURER PHONE NUMBER:	(281) 659-5339
JOB NO.:	370-0390T-09
MODEL:	WD-9
REV. NO.:	B

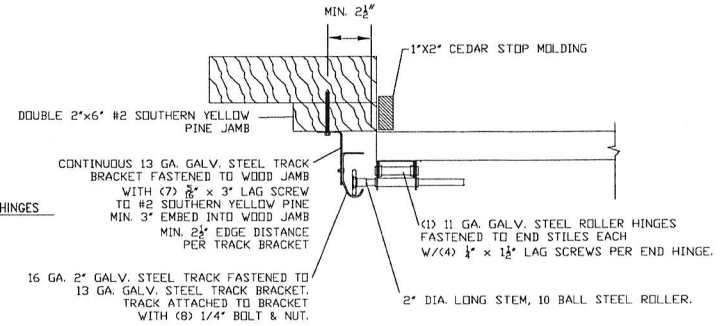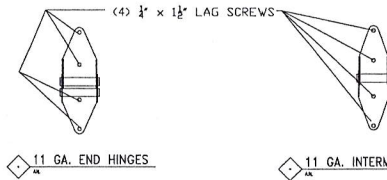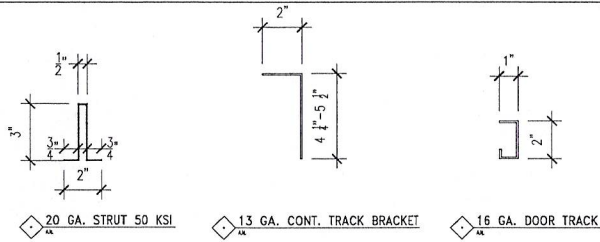


	DOOR HEIGHT	
STRUT SPACING	7'-0"	8'-0"
A	9"	12"
B	21"	24"
C	21"	24"
D	23 1/2"	26 1/2"
DIMENSIONS +/- 1/2"		

2 JAMB DETAIL
AN.

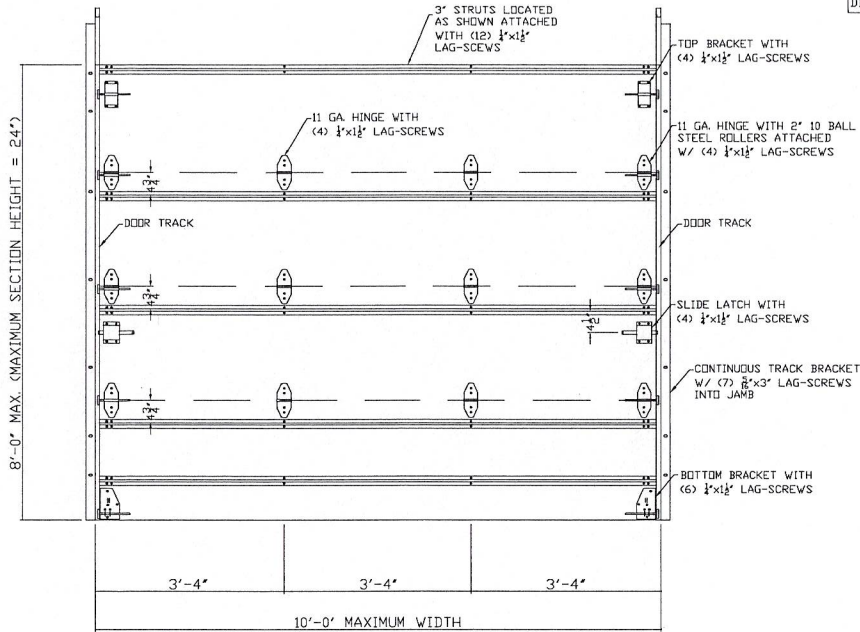


10'-0" x 8'-0" MAXIMUM OPENING

1 10'x8' SECTIONAL DOOR
AN.

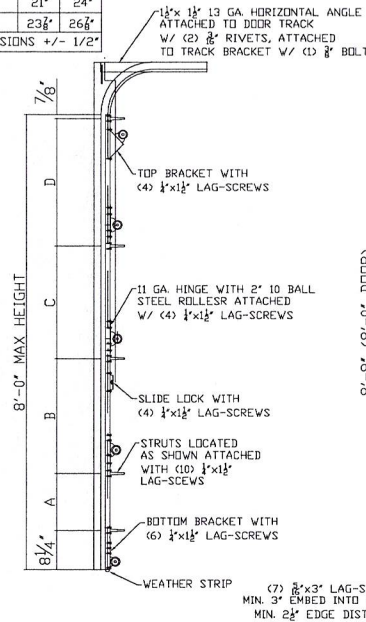

8'-0" (8'-0" DOOR)
7'-9" (7'-0" DOOR)

CONTINUOUS TRACK BRACKET ATTACHMENT TO WOOD

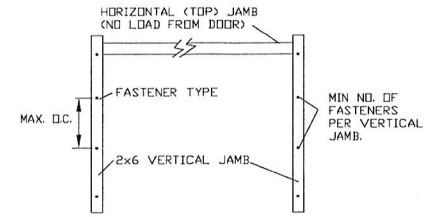

VERTICAL 2x6 JAMB ATTACHMENT INTO WOOD WALL FRAMING:
3/8" x 3" LAG SCREW W/ 1-1/8" WASHER @ 24" O.C. MAX INTO SOUTHERN PINE (G-0.55) OR 24" O.C. MAX INTO SPRUCE-PINE-FIR (G-0.42) FRAMING. LAG SCREWS MUST PENETRATE MIN. 1-1/2" INTO WOOD FRAMING. LAG SCREWS MAY BE COUNTER SUNK 1/2" TO PROVIDE A FLUSH MOUNTING SURFACE.
HORIZONTAL JAMBS DO NOT TRANSFER LOAD.
(REFERENCE DASHA TECHNICAL DATA SHEET #161)

ALLOWABLE DESIGN PRESSURES

+ 35.0 PSF
- 35.0 PSF




NOTES:

1. THE WD-10 DOOR MEETS THE 2018 INTERNATIONAL BUILDING CODE AND 2018 INTERNATIONAL RESIDENTIAL CODE.
2. NON-IMPACT RATED.
3. ALLOWABLE DESIGN PRESSURE = +/- 35.0 PSF.
4. THE DOOR SECTIONS ARE CONSTRUCTED OF 1" THICK PINE FRAMING AROUND PERIMETER AND AT HINGE LOCATIONS. A 1" FOAM CORE IS BETWEEN FRAMING. 1/2" HARD BOARD SKIN ON EITHER SIDE AND 3/8" THICK TONGUE AND GROOVE CEDAR PLANKING ON EXTERIOR SIDE.




DATE DRAWN	DATE CHECKED	DATE APPROVED	DESCRIPTION
12/01/09			
AF	TW	TW	
DATE DRAWN	DATE CHECKED	DATE APPROVED	DESCRIPTION
12/01/09			
AF	TW	TW	
DATE DRAWN	DATE CHECKED	DATE APPROVED	DESCRIPTION
12/01/09			
AF	TW	TW	
DATE DRAWN	DATE CHECKED	DATE APPROVED	DESCRIPTION
12/01/09			
AF	TW	TW	

MODEL:	WD-10, 8' X 10' SECTIONAL DOOR
MANUFACTURER:	STEWART DOOR, LTD
MANUFACTURER ADDRESS:	17050 WEST LITTLE YORK, HOUSTON, TX 77064
MANUFACTURER PHONE NUMBER:	(281) 859-4339
JOB NO.:	370-0390T-09
MODEL:	WD-10
REV NO.:	B

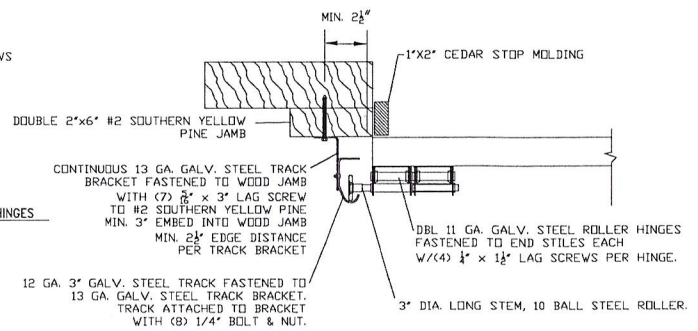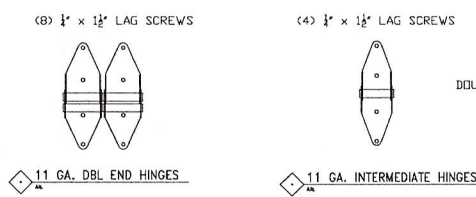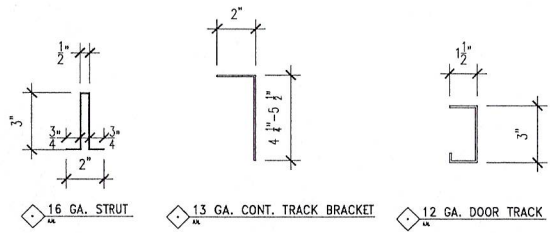


VERTICAL 2x6 JAMB ATTACHMENT INTO WOOD WALL FRAMING:
 3/8" x 3" LAG SCREW W/ 1-1/8" WASHER @ 24" O.C. MAX INTO SOUTHERN PINE (G=0.55) OR 17" O.C. MAX INTO SPRUCE-PINE-FIR (G=0.42) FRAMING. LAG SCREWS MUST PENETRATE MIN. 1-1/2" INTO WOOD FRAMING. LAG SCREWS MAY BE COUNTER SUNK 1/2" TO PROVIDE A FLUSH MOUNTING SURFACE.
 HORIZONTAL JAMBS DO NOT TRANSFER LOAD. (REFERENCE DASMA TECHNICAL DATA SHEET #161)

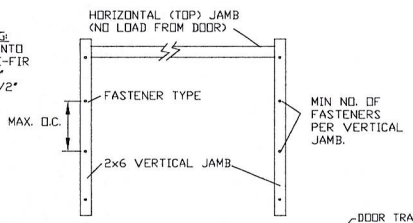


STRUT SPACING	DOOR HEIGHT
7'-0"	8'-0"
A	8 1/2" 11 1/2"
B	11" 14"
C	11" 14"
D	15" 18"

DIMENSIONS +/- 1/2"

2 JAMB DETAIL

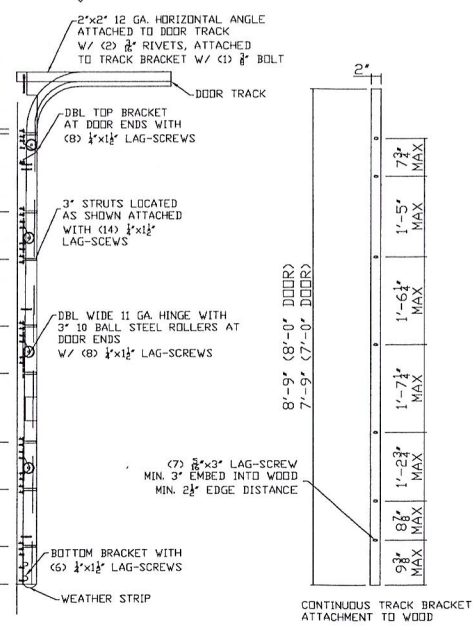


2 SECTIONAL DOOR END VIEW

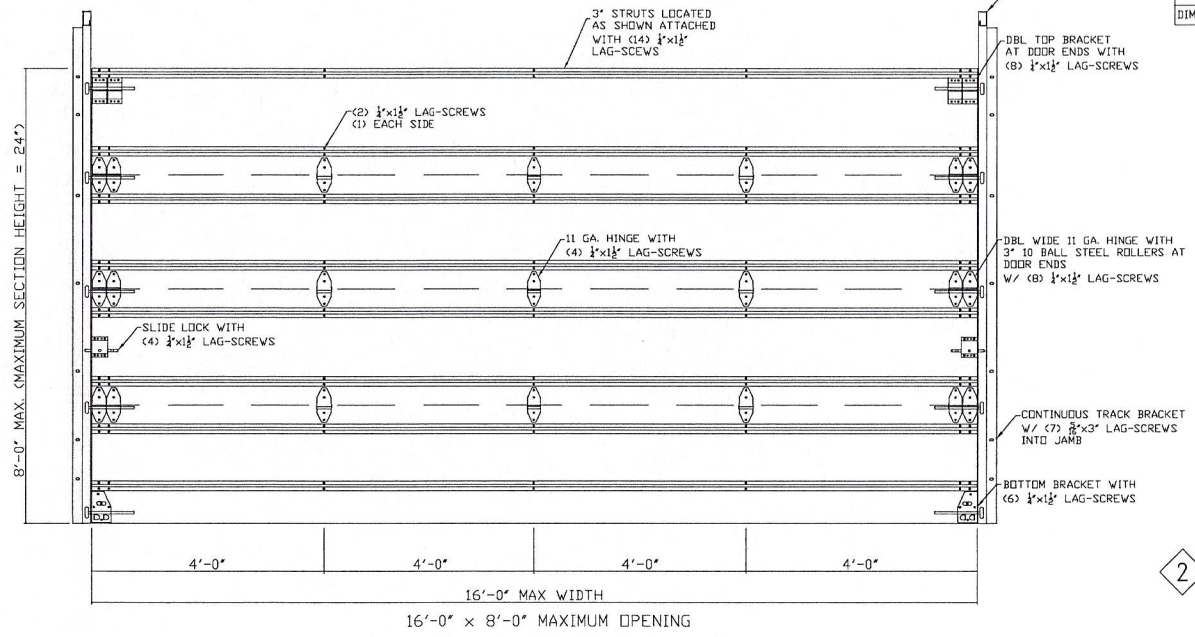

1 16'X8' SECTIONAL DOOR

- NOTES:
1. THE WD-16 DOOR MEETS THE 2018 INTERNATIONAL BUILDING CODE AND 2018 INTERNATIONAL RESIDENTIAL CODE.
 2. NON-IMPACT RATED.
 3. ALLOWABLE DESIGN PRESSURE = +/- 35.0 PSF.
 4. THE DOOR SECTIONS ARE CONSTRUCTED OF 1" THICK PINE FRAMING AROUND PERIMETER AND AT HINGE LOCATIONS. A 1" FOAM CORE IS BETWEEN FRAMING. 1/2" HARD BOARD SKIN ON EITHER SIDE AND 3/8" THICK TONGUE AND GROOVE CEDAR PLANKING ON EXTERIOR SIDE.

ALLOWABLE DESIGN PRESSURES
+ 35.0 PSF
- 35.0 PSF

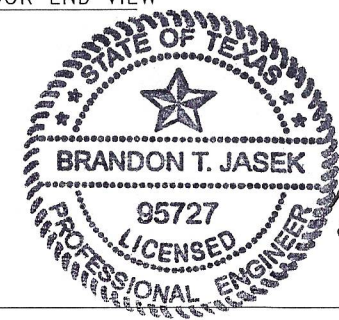


Handwritten signature and date: 6-15-2020

DATE DRAWN:	DATE CHECKED:	DATE APPROVED:	DESCRIPTION
12/07/09	12/07/09		
AF	TN		
BY:	BY:	BY:	
DATE:	DATE:	DATE:	
SCALE:	SCALE:	SCALE:	

MANUFACTURER:	MANUFACTURER ADDRESS:
WD-16, 16' X 8' SECTIONAL DOOR	17030 WEST LITTLE YORK, HOUSTON, TX 77064
MANUFACTURER PHONE NUMBER:	
(281) 859-9339	



MODEL:	WD-16
JOB NO.:	370-0390T-09
MODEL:	WD-16
REV. NO.:	B

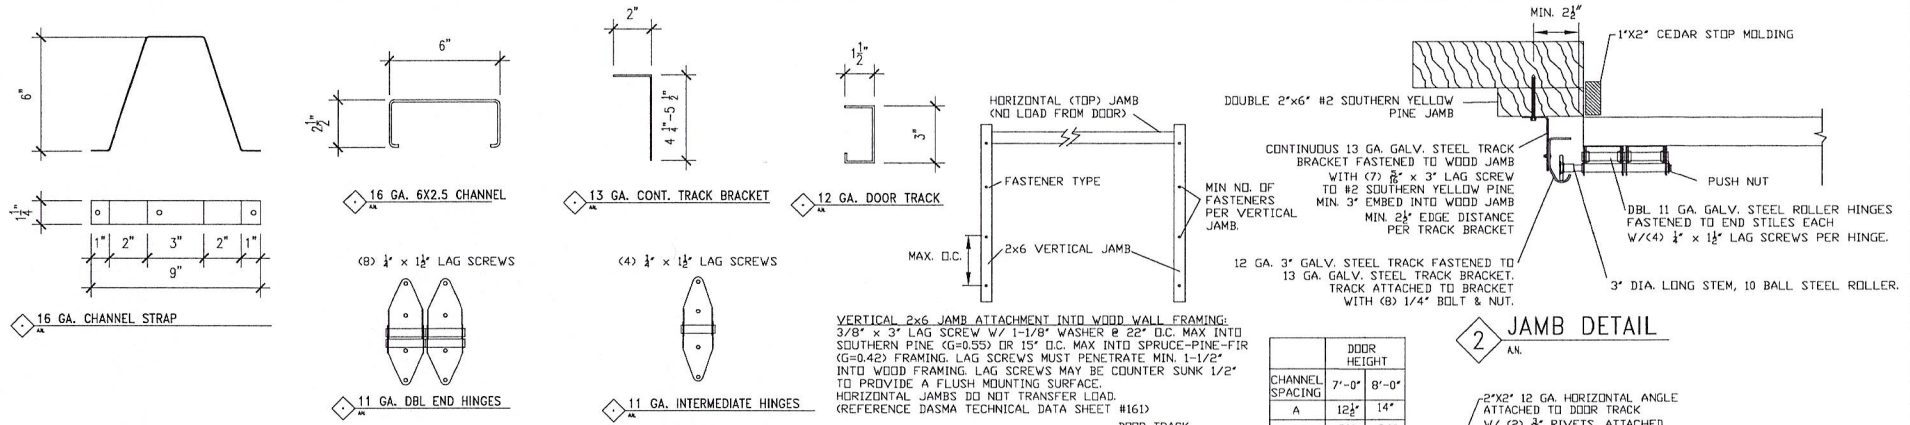

VERTICAL 2x6 JAMB ATTACHMENT INTO WOOD WALL FRAMING:
3/8" x 3" LAG SCREW W/ 1-1/8" WASHER @ 22" O.C. MAX INTO SOUTHERN PINE (G=0.55) OR 15" O.C. MAX INTO SPRUCE-PINE-FIR (G=0.42) FRAMING. LAG SCREWS MUST PENETRATE MIN. 1-1/2" INTO WOOD FRAMING. LAG SCREWS MAY BE COUNTER SUNK 1/2" TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD. (REFERENCE DASMA TECHNICAL DATA SHEET #161)

CHANNEL SPACING	DOOR HEIGHT
A	12'-0" 14'
B	21' 24'
C	21' 24'
D	21' 24'


DIMENSIONS +/- 1/2"

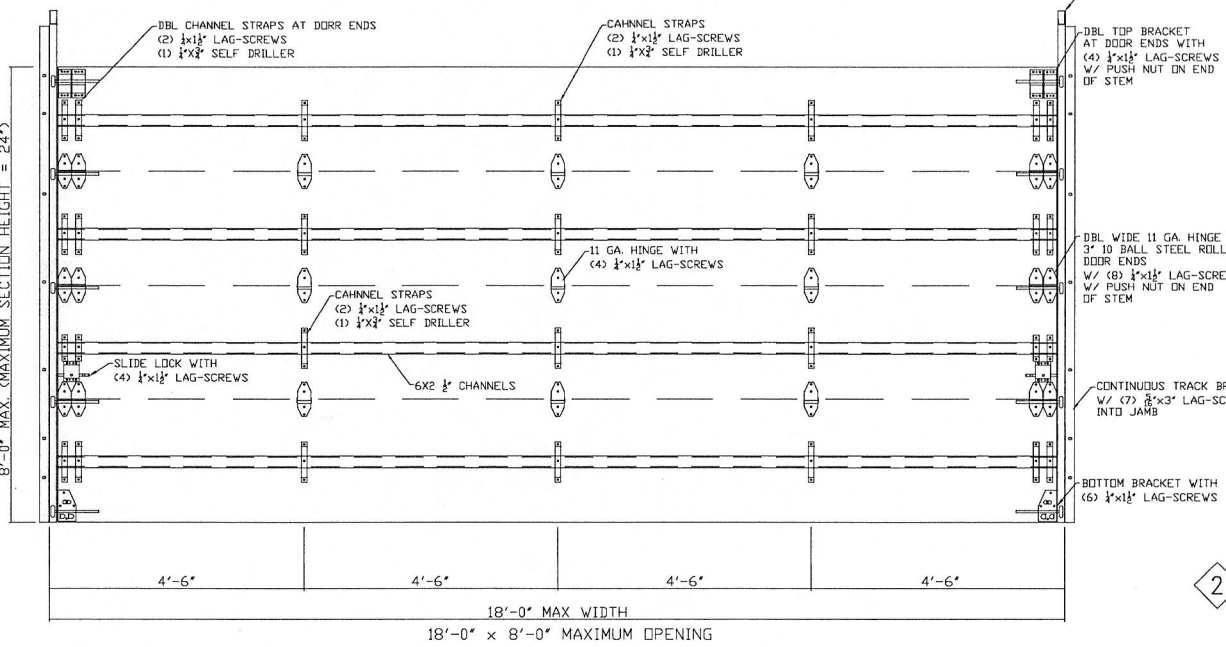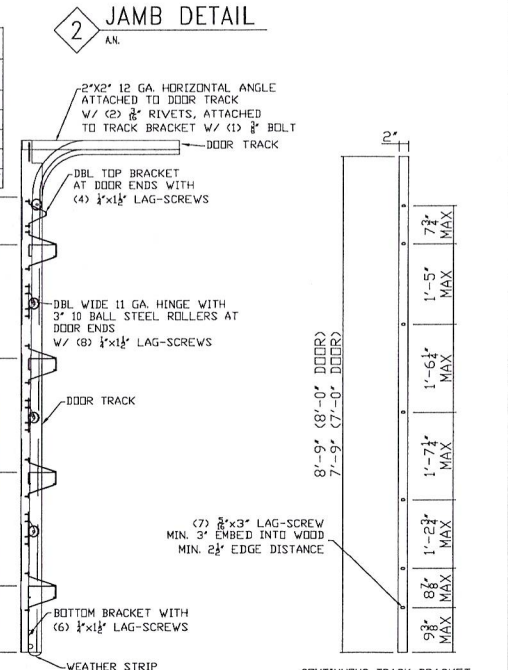

1 18'x8' SECTIONAL DOOR AN.

- NOTES:
1. THE WD-18 DOOR MEETS THE 2018 INTERNATIONAL BUILDING CODE AND 2018 INTERNATIONAL RESIDENTIAL CODE.
 2. NON-IMPACT RATED.
 3. ALLOWABLE DESIGN PRESSURE = +/- 35.0 PSF.
 4. THE DOOR SECTIONS ARE CONSTRUCTED OF 1" THICK PINE FRAMING AROUND PERIMETER AND AT HINGE LOCATIONS. A 1" FOAM CORE IS BETWEEN FRAMING. 1/2" HARD BOARD SKIN ON EITHER SIDE AND 3/8" THICK TONGUE AND GROOVE CEDAR PLANKING ON EXTERIOR SIDE.

ALLOWABLE DESIGN PRESSURES
+ 35.0 PSF
- 35.0 PSF

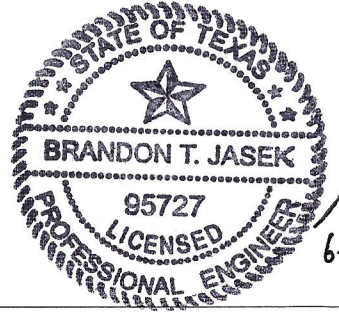

BJM
6-15-2020

REV	BY	DATE	DESCRIPTION
B	BJM/BJZ	12/01/09	
		12/01/09	

DATE DRAWN:	12/01/09
DATE CHECKED:	12/01/09
DATE APPROVED:	

DRAWN BY:	AF
CHECKED BY:	TW
APPROVED BY:	TW
SCALE:	N.A.

Force Engineering & Testing, Inc.
16550 West Little York, Houston, TX 77064
(281) 564-0000 Fax: (281) 564-9966

MODEL:	WD-18, 18' x 8' SECTIONAL DOOR
MANUFACTURER:	STEWART DOOR, LTD
MANUFACTURER ADDRESS:	17030 WEST LITTLE YORK, HOUSTON, TX 77064
MANUFACTURER PHONE NUMBER:	(281) 855-9339

JOB NO.:	370-03907-09
MODEL:	WD-18
REV NO.:	B