




TYPICAL TOP FIXTURES ①  
N.T.S.

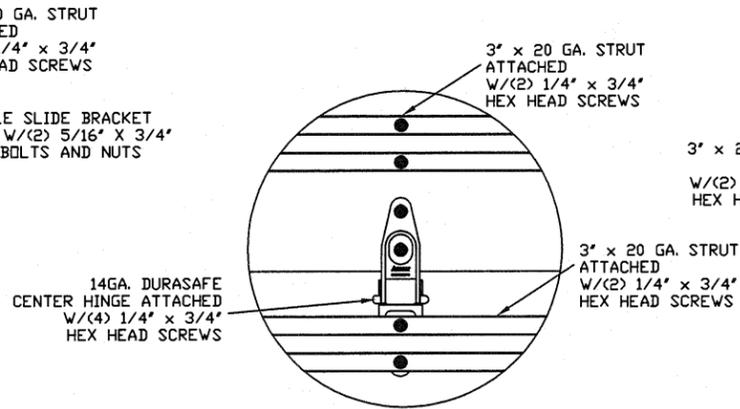


TYPICAL DURASAFE CENTER HINGE ②  
N.T.S.

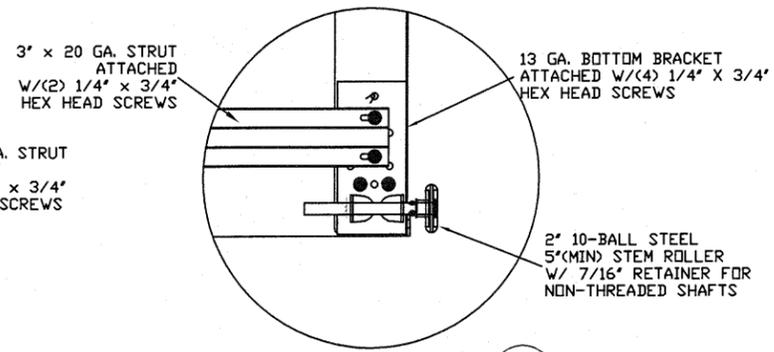

TYPICAL BOTTOM BRACKET ⑤  
N.T.S.

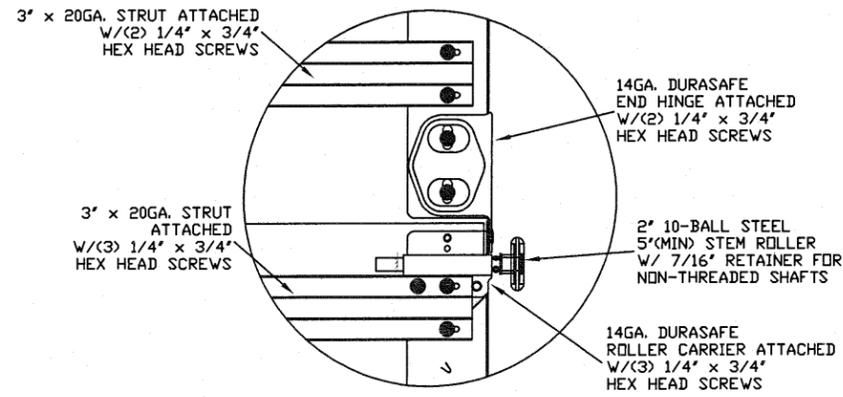

TYPICAL DURASAFE END HINGE ④  
N.T.S.



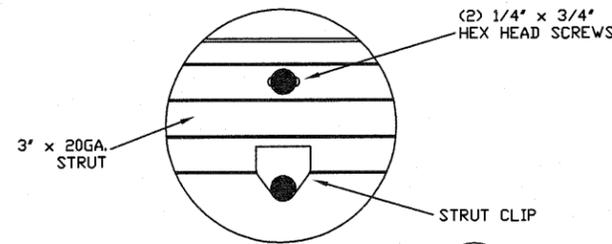


TYPICAL TOP STRUT ATTACHMENT ③  
N.T.S.

SPECIFICATIONS AND NOTES

1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +204.8 LBS/FT & -232.8 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. (.0216) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.

LARGE MISSILE IMPACT RESISTANT

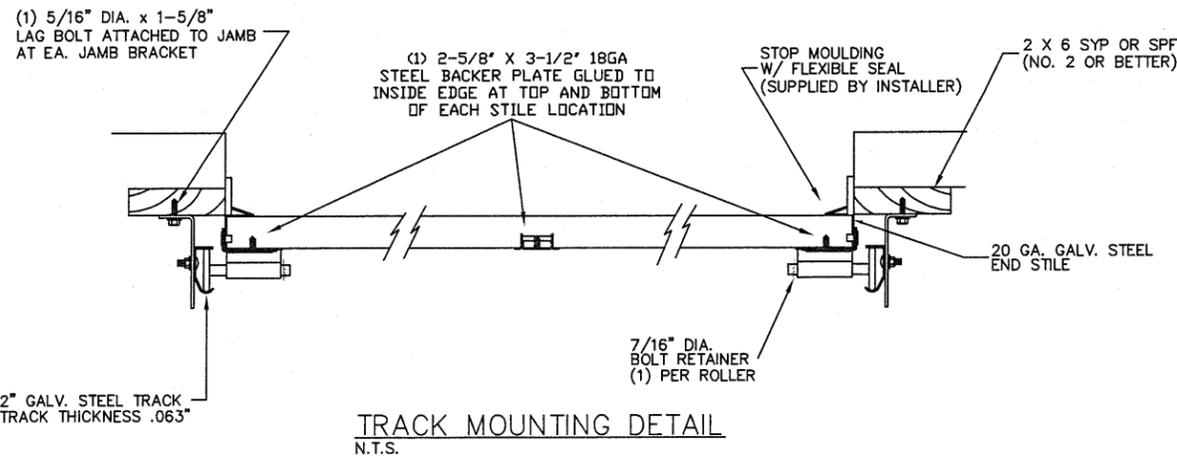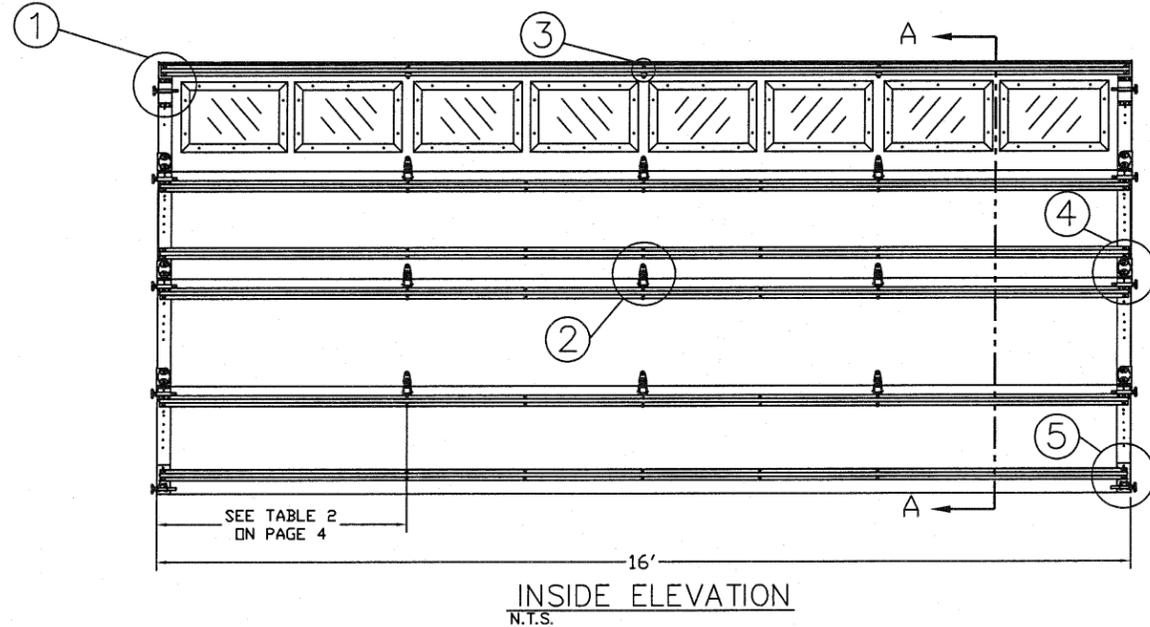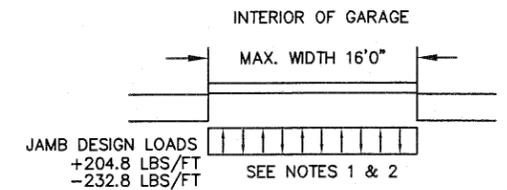

THE METHOD OF TESTING WAS IN SUBSTANTIAL CONFORMANCE WITH THE PROCEDURE DESCRIBED IN ASTM E330, E1886, E1996, & F588, ANSI/DASMA 108 & 115. THE PRESSURES SHOWN ON THE DRAWINGS WERE CALCULATED USING ASCE 7-98/02/05 WITH THE FOLLOWING PARAMETERS (5 FEET OF DOOR WIDTH IN THE END ZONE, ROOF AT ANY SLOPE, AND I=1.0):

WIND SPEED (MPH)	130	118	112	107	103
EXPOSURE LEVEL	B	C	C	D	D
MEAN ROOF HEIGHT	30'	15'	25'	15'	25'

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE  
16' WIDTH  
14' HEIGHT  
(DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)

DESIGN LOADS  
+25.6 PSF  
-29.1 PSF

TEST LOADS  
(1.5 x DESIGN LOADS)  
+38.4 PSF  
-43.6 PSF

LARGE MISSILE IMPACT RESISTANCE

Thomas L. Shelmerdine, PE (TX PE #85829)  
Structural Solutions, PA (TX Firm #F-004063)

STATE OF TEXAS  
THOMAS L. SHELMERDINE  
85829  
LICENSED PROFESSIONAL ENGINEER

TX

5921-G W. Friendly Ave., Greensboro, NC 27410


**Amarr**  
ENTRE/MATIC  
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

MODEL #1200 HERITAGE 3000  
MODEL #1200 OAK SUMMIT 3000  
SHORT, LONG, FLUSH & OAK SUMMIT PANELS


SIZE	DRAWN BY	RLR	DATE	07/22/14	DRAWING NUMBER
B	CHECKED BY		DATE		IRC-1216-130-15-1

SHEET 1 OF 4



# OPTIONAL SHORT AND LONG PANEL GLAZING LAYOUTS

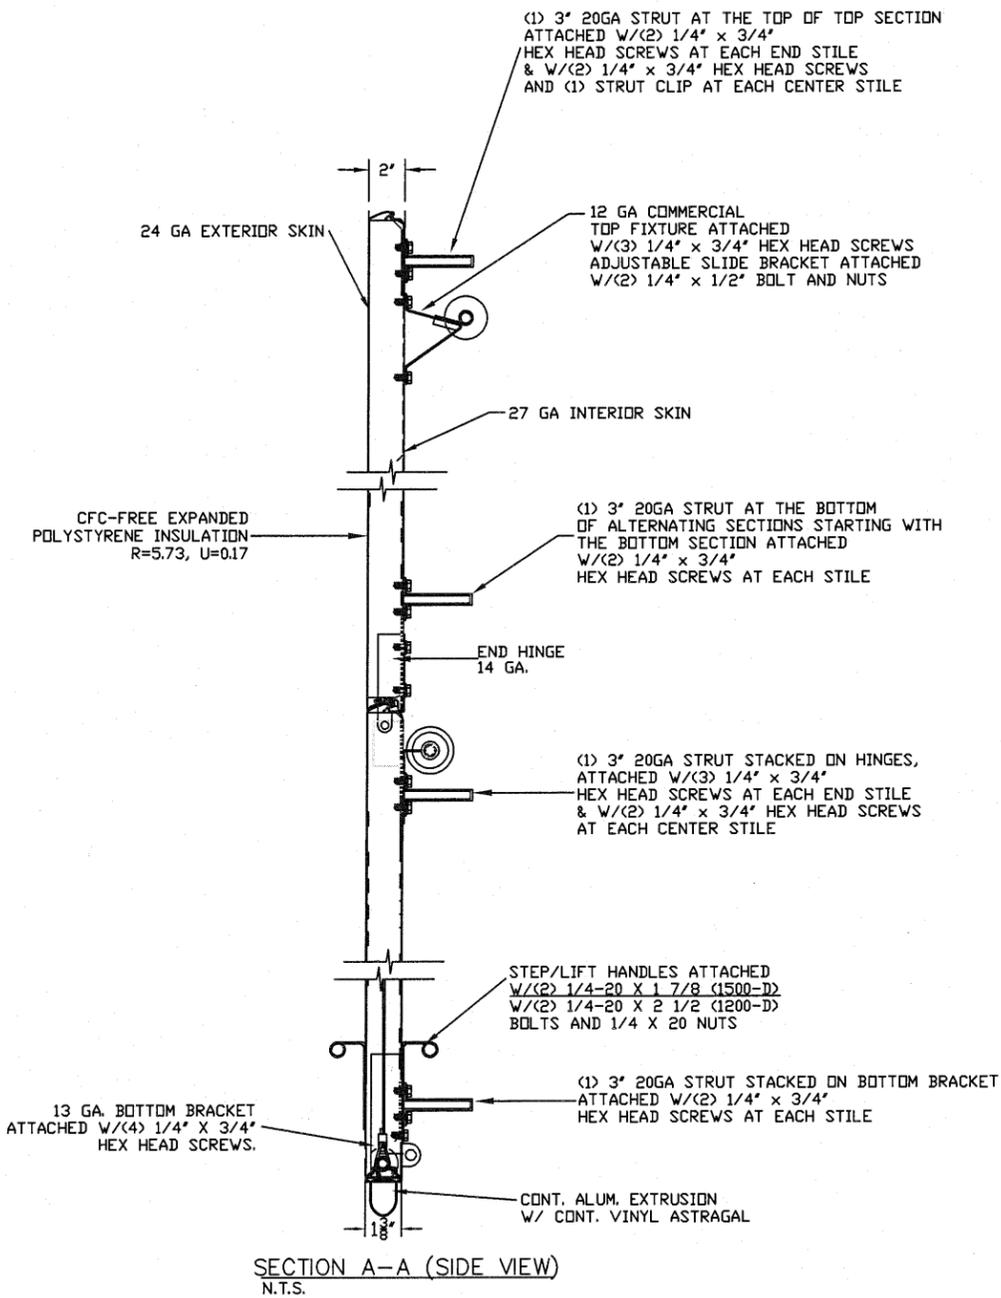


SECTION A-A (SIDE VIEW)  
N.T.S.

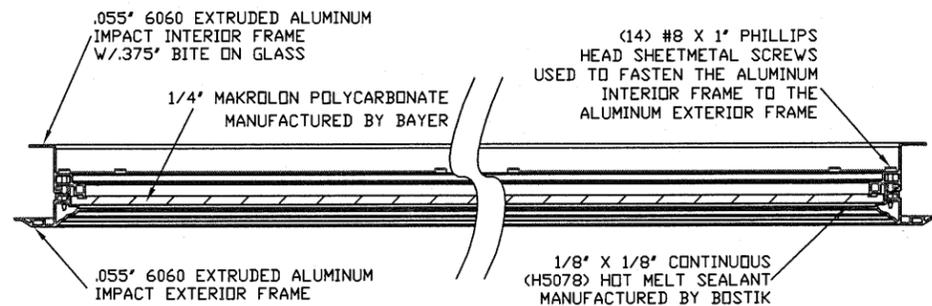


SECTION B-B IMPACT WINDOW DETAIL  
N.T.S.

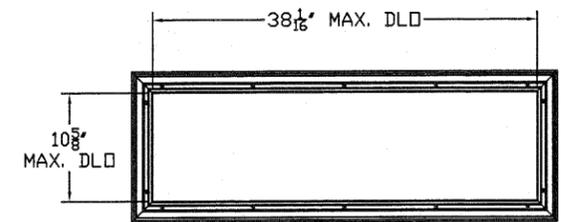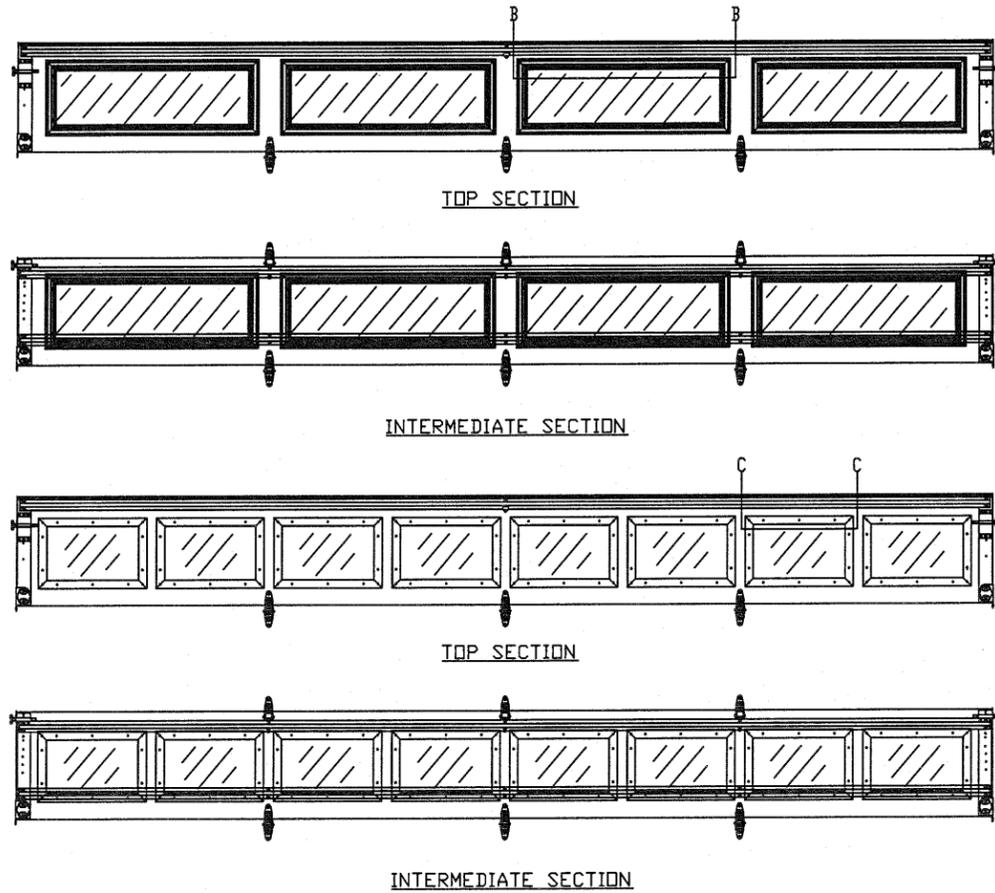

LONG PANEL IMPACT GLAZING FASTENER DETAIL  
N.T.S.

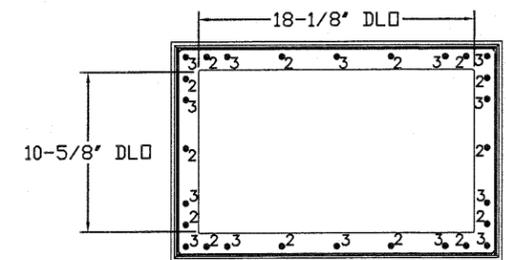

IMPACT GLAZING FASTENER DETAIL  
N.T.S.  
GLAZING MEETS ASTM E1300-04

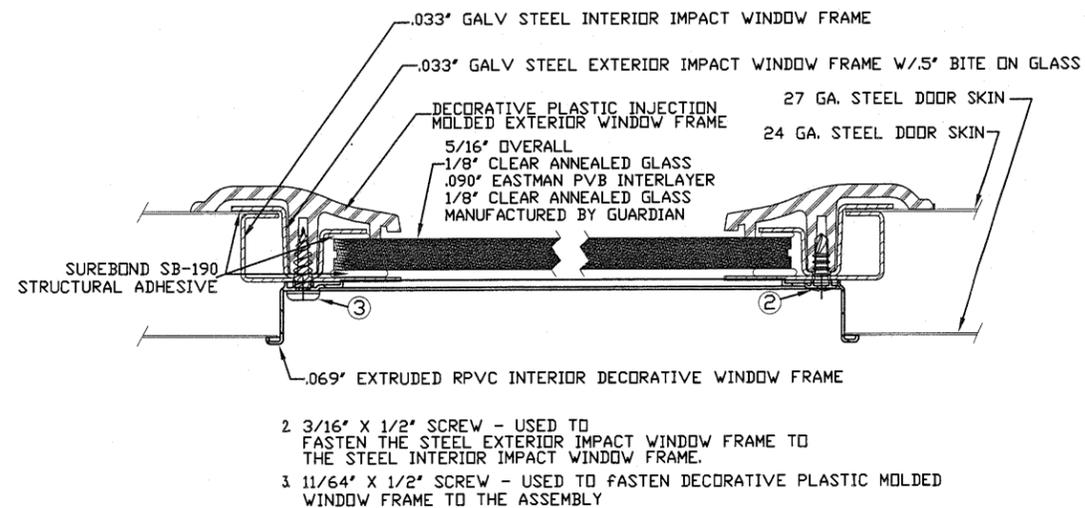


SECTION C-C IMPACT WINDOW DETAIL  
N.T.S.

REV	DESCRIPTION OF REVISIONS	DATE	BY
	MAX SIZE 16' WIDTH 14' HEIGHT (DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS) DESIGN LOADS +25.6 PSF -29.1 PSF TEST LOADS (1.5 x DESIGN LOADS) +38.4 PSF -43.6 PSF LARGE MISSILE IMPACT RESISTANCE		
	Thomas L. Shelmerdine, PE (TX PE #85829) Structural Solutions, PA (TX Firm #004063)		
	 TX		
	 <b>ENTREMATIC</b> 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105		
	<b>MODEL #1200 HERITAGE 3000</b> <b>MODEL #1200 OAK SUMMIT 3000</b> <b>SHORT, LONG, FLUSH &amp; OAK SUMMIT PANELS</b>		
	SIZE B	DRAWN BY RLR	DATE 07/22/14
	CHECKED BY	DATE	DRAWING NUMBER IRC-1216-130-15-1
			SHEET 2 OF 4

5921-G W. Friendly Ave., Greensboro, NC 27410

WOOD JAMB ATTACHMENT TO STRUCTURE

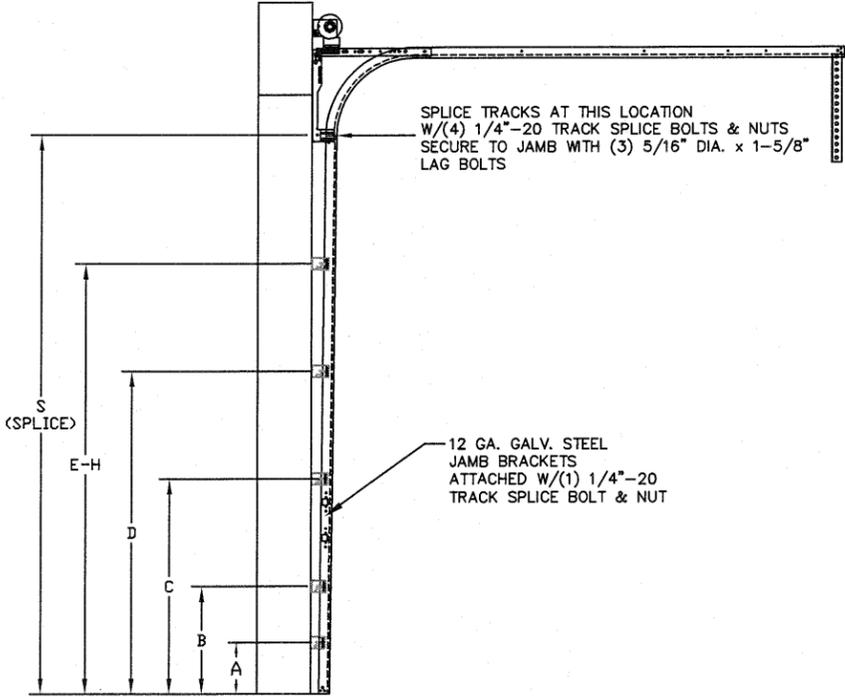

TRACK CONFIGURATION FOR 6'6" UP TO 14' TALL DOORS (SEE TABLE 1)  
N.T.S.

TABLE 1



DOOR HEIGHT	TRACK ATTACHMENT								SPLICE
	A	B	C	D	E	F	G	H	
6' 6"	3.5"	21"	42"	63"					70"
7'	3.5"	21"	42"	63"					76"
7' 6"	3.5"	21"	42"	63"					82"
8'	3.5"	21"	42"	63"					88"
8' 6"	3.5"	21"	42"	63"	84"				94"
9'	3.5"	21"	42"	63"	84"				100"
9' 6"	3.5"	21"	42"	63"	84"				106"
10'	3.5"	21"	42"	63"	84"	105"			112"
10' 6"	3.5"	21"	42"	63"	84"	105"			118"
11'	3.5"	21"	42"	63"	84"	105"			124"
11' 6"	3.5"	21"	42"	63"	84"	105"			130"
12'	3.5"	21"	42"	63"	84"	105"	126"		136"
12' 6"	3.5"	21"	42"	63"	84"	105"	126"		142"
13'	3.5"	21"	42"	63"	84"	105"	126"		148"
13' 6"	3.5"	21"	42"	63"	84"	105"	126"	147"	154"
14'	3.5"	21"	42"	63"	84"	105"	126"	147"	160"

ALL TRACK ATTACHMENT SPACING +/- 1.5' ALLOWED WITH SYP OR SPF NO. 2 OR BETTER ONLY

2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE  
5/16" X 3' LAG SCREWS STARTING 6' FROM ENDS THEN 24" O.C. (1 1/2' EMBEDMENT)  
2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE  
HILTI KWIK BOLT 3/8" X 4' STARTING 6' FROM ENDS THEN 24" O.C. (2 1/2' EMBEDMENT)  
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6' FROM ENDS THEN 20" O.C. (1 1/4' EMBEDMENT)  
ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4' STARTING 6' FROM ENDS THEN 24" O.C. (2 1/2' EMBEDMENT)  
2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK  
SIMPSON 1/4" X 3' TITEN SCREWS STARTING 6' FROM ENDS, USE PAIRS OF FASTENERS (3' APART) AT 16" O.C. (1 1/2' EMBEDMENT)  
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6' FROM ENDS, USE PAIRS OF FASTENERS (3' APART) AT 16" O.C. (1 1/4' EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)  
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6' FROM ENDS THEN 24" O.C. (1 1/4' EMBEDMENT) (OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)

\*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.  
\*PREPARATION OF WOOD JAMBS BY OTHERS

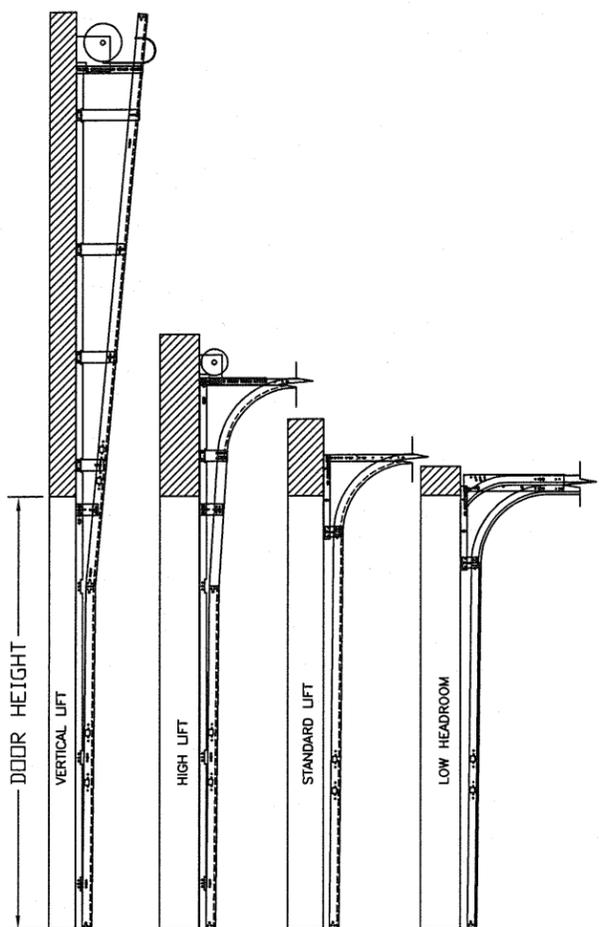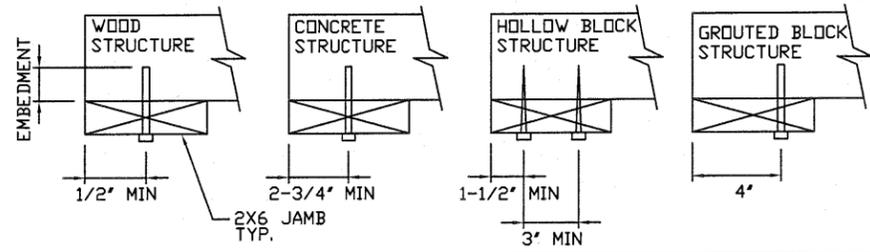

AVAILABLE TRACK CONFIGURATIONS  
N.T.S.

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE  
16' WIDTH  
14' HEIGHT  
(DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)

DESIGN LOADS  
+25.6 PSF  
-29.1 PSF

TEST LOADS  
(1.5 x DESIGN LOADS)  
+38.4 PSF  
-43.6 PSF

LARGE MISSILE IMPACT RESISTANCE

Thomas L. Shelmerdine, PE (TX PE #85829)  
Structural Solutions, PA (TX Firm #F-004063)

STATE OF TEXAS  
THOMAS L. SHELMERDINE  
85829  
LICENSED PROFESSIONAL ENGINEER

TX

**Amarr**  
ENTREMATIC  
165 CARRIAGE COURT WINSTON-SALEM, NC. 27105

MODEL #1200 HERITAGE 3000  
MODEL #1200 OAK SUMMIT 3000  
SHORT, LONG, FLUSH & OAK SUMMIT PANELS

SIZE	DRAWN BY	RLR	DATE	07/22/14	DRAWING NUMBER
B	CHECKED BY		DATE		IRC-1216-130-15-1

SHEET 3 OF 4

5921-G W. Friendly Ave., Greensboro, NC 27410

TABLE 2

Section Width (ft)	Panel Type	Center Stile Locations (Measured from Left Edge)			
		1st (in)	2st (in)	3rd (in)	4th (in)
10' 0	Short	48.41	71.59		
10' 0	Long	30.00	60.00	90.00	
10' 0	Oak Summit	30.63	60.00	89.38	
12' 0	Short	48.81	72.00	95.19	
12' 0	Long	49.63	72.00	94.38	
12' 0	Oak Summit	48.31	72.00	95.69	
12' 2	Short	49.64	73.00	96.36	
12' 2	Long	50.08	73.00	95.92	
12' 2	Oak Summit	49.06	73.00	96.94	
12' 4	Short	50.64	74.00	97.36	
12' 4	Long	51.08	74.00	96.92	
12' 4	Oak Summit	49.81	74.00	98.19	
12' 6	Short	50.67	75.00	99.33	
12' 6	Long	51.17	75.00	98.83	
12' 6	Oak Summit	50.56	75.00	99.44	
12' 8	Short	51.67	76.00	100.33	
12' 8	Long	52.10	76.00	99.90	
12' 8	Oak Summit	51.31	76.00	100.69	
12' 10	Short	52.25	77.00	101.75	
12' 10	Long	53.10	77.00	100.90	
12' 10	Oak Summit	52.06	77.00	101.94	
13' 0	Short	53.00	78.00	103.00	
13' 0	Long	54.10	78.00	101.90	
13' 0	Oak Summit	52.81	78.00	103.19	
13' 2	Short	54.00	79.00	104.00	
13' 2	Long	55.10	79.00	102.90	
13' 2	Oak Summit	53.56	79.00	104.44	
13' 4	Short	54.40	80.00	105.60	
13' 4	Long	54.90	80.00	105.10	
13' 4	Oak Summit	54.31	80.00	105.69	
13' 6	Short	55.40	81.00	106.60	
13' 6	Long	55.90	81.00	106.10	
13' 6	Oak Summit	55.06	81.00	106.94	
13' 8	Short	56.40	82.00	107.60	
13' 8	Long	56.63	82.00	107.38	
13' 8	Oak Summit	55.81	82.00	108.19	
13' 10	Short	57.16	83.00	108.71	
13' 10	Long	57.17	83.00	108.83	
13' 10	Oak Summit	56.56	83.00	109.44	

TABLE 3

Section Width (ft)	Panel Type	Center Stile Locations (Measured from Left Edge)			
		1st (in)	2st (in)	3rd (in)	4th (in)
14' 0	Short	57.76	84.00	110.11	
14' 0	Long	58.63	84.00	109.38	
14' 0	Oak Summit	57.31	84.00	110.69	
14' 2	Short	58.85	85.00	111.41	
14' 2	Long	59.17	85.00	110.83	
14' 2	Oak Summit	58.06	85.00	111.94	
14' 4	Short	59.16	86.00	112.71	
14' 4	Long	60.17	86.00	111.83	
14' 4	Oak Summit	58.81	86.00	113.19	
14' 6	Short	59.86	87.00	114.01	
14' 6	Long	61.17	87.00	112.83	
14' 6	Oak Summit	59.56	87.00	114.44	
14' 8	Short	60.56	88.00	115.31	
14' 8	Long	44.81	88.00	131.19	
14' 8	Oak Summit	60.31	88.00	115.69	
14' 10	Short	61.26	89.00	116.61	
14' 10	Long	45.60	89.00	132.40	
14' 10	Oak Summit	61.06	89.00	116.94	
15' 0	Short	61.94	90.00	117.94	
15' 0	Long	46.60	90.00	133.40	
15' 0	Oak Summit	61.63	90.00	118.38	
15' 2	Short	62.66	91.00	119.21	
15' 2	Long	47.60	91.00	134.40	
15' 2	Oak Summit	62.13	91.00	119.88	
15' 4	Short	63.60	92.00	120.80	130.40
15' 4	Long	47.25	92.00	136.75	
15' 4	Oak Summit	63.63	92.00	121.38	
15' 6	Short	64.62	93.00	121.38	
15' 6	Long	47.60	93.00	138.40	
15' 6	Oak Summit	64.42	93.00	121.58	
15' 8	Short	65.62	94.00	122.38	
15' 8	Long	48.60	94.00	139.40	
15' 8	Oak Summit	65.02	94.00	122.98	
15' 10	Short	66.62	95.00	123.38	
15' 10	Long	49.17	95.00	140.83	
15' 10	Oak Summit	66.62	95.00	123.38	
16' 0	Short	49.62	96.00	142.38	
16' 0	Long	50.60	96.00	141.40	
16' 0	Oak Summit	48.42	96.00	143.58	

DOOR HEIGHT	SECTION HEIGHTS							
	Btm	#2	#3	#4	#5	#6	#7	#8
14' 0"	21"	21"	21"	21"	21"	21"	21"	21"
13' 6"	21"	21"	21"	21"	21"	18"	18"	21"
13' 0"	21"	21"	21"	18"	18"	18"	18"	21"
12' 6"	21"	18"	18"	18"	18"	18"	18"	21"
12' 0"	21"	21"	21"	21"	21"	18"	21"	
11' 6"	21"	21"	21"	18"	18"	18"	21"	
11' 0"	21"	18"	18"	18"	18"	18"	21"	
10' 6"	21"	21"	21"	21"	21"	21"		
10' 0"	21"	21"	21"	18"	18"	21"		
9' 6"	21"	18"	18"	18"	18"	21"		
9' 0"	18"	18"	18"	18"	18"	18"		
8' 6"	21"	21"	21"	18"	21"			
8' 0"	21"	18"	18"	18"	21"			
7' 6"	18"	18"	18"	18"	18"			
7' 0"	21"	21"	21"	21"				
6' 6"	21"	18"	18"	21"				

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE  
16' WIDTH  
14' HEIGHT  
(DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)

DESIGN LOADS  
+25.6 PSF  
-29.1 PSF

TEST LOADS  
(1.5 x DESIGN LOADS)  
+38.4 PSF  
-43.6 PSF

LARGE MISSILE IMPACT RESISTANCE

THOMAS L. SHELME RDINE  
85829  
LICENSED PROFESSIONAL ENGINEER  
TX

Thomas L. Shelmerdine, PE (TX PE #85829)  
Structural Solutions, PA (TX Firm #F-004063)

5921-G W. Friendly Ave., Greensboro, NC 27410

**ENTRE/MATIC**  
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

**MODEL #1200 HERITAGE 3000**  
**MODEL #1200 OAK SUMMIT 3000**  
**SHORT, LONG, FLUSH & OAK SUMMIT PANELS**

SIZE	DRAWN BY	RLR	DATE	07/22/14	DRAWING NUMBER
B	CHECKED BY		DATE		IRC-1216-130-15-1

SHEET 4 OF 4