
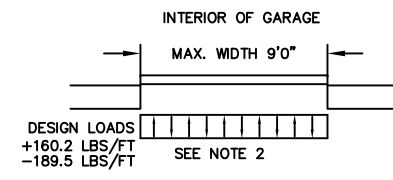


LARGE MISSILE IMPACT RESISTANT

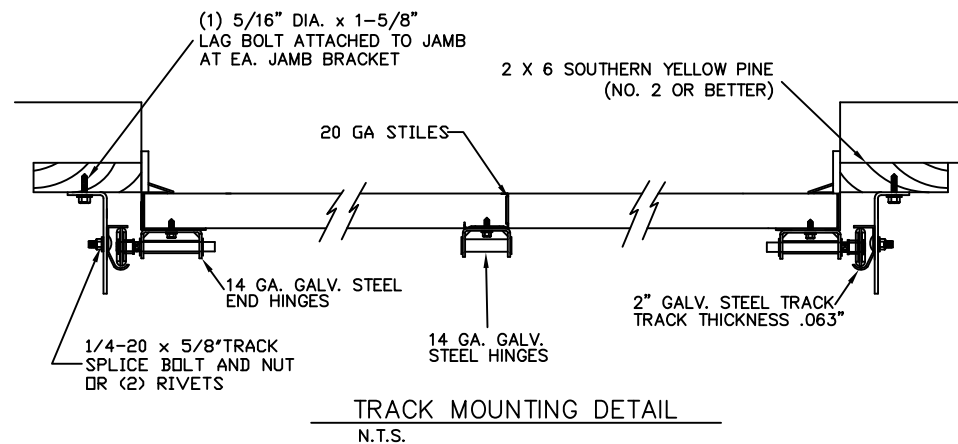

SPECIFICATIONS AND NOTES

- ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK. FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
- EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +160.2 LBS/FT & -189.5 LBS/FT
- DOORS AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
- DOOR SECTIONS SHALL BE 25 GA. MIN. (.019") ROLLED FORMED LIGHT COMMERCIAL QUALITY.
- DOORS UP TO 14'0" HIGH HAVE (2) 3" STRUTS ON EACH SECTION (SEE TABLE 4 ON PAGE 3 FOR STRUT SCHEDULE)
- SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.
- REFER TO TABLES ON PAGE 3 FOR ADDITIONAL DOOR WIDTHS AND THEIR DESIGN PRESSURES
- DOOR IS MANUFACTURED AND TESTED IN ACCORDANCE WITH THE 2018 IRC/IBC

THE METHOD OF TESTING WAS IN SUBSTANTIAL CONFORMANCE WITH THE PROCEDURE DESCRIBED IN DASMA 108 & 115, AND ASTM E330, E1886, E1996, & F588. THE PRESSURES SHOWN ON THE DRAWINGS WERE CALCULATED USING ASCE 7-16 WITH THE FOLLOWING PARAMETERS (5 FEET OF DOOR WIDTH IN THE END ZONE, ROOF AT ANY SLOPE):


WIND SPEED (MPH)	194	176	167	160	153
EXPOSURE LEVEL	B	C	C	D	D
MEAN ROOF HEIGHT	30'	15'	25'	15'	25'

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	ADDED HERITAGE MODEL/DRAWING UPDATES	3/1/22	RLR

MAX SIZE
9' x 14'

DESIGN LOADS
+35.6 PSF
-42.1 PSF

TEST LOADS
+53.4 PSF
-63.2 PSF



This document has been digitally signed & sealed by Thomas L. Shelmerdine, PE on the date shown. Printed copies of this document are not considered signed & sealed, and the signature must be verified on any electronic copies.

LARGE MISSILE IMPACT RESISTANCE

Thomas L. Shelmerdine, PE (TX PE #85829)
Structural Solutions, PA (TX Firm #F-004063)
5921-G W. Friendly Ave., Greensboro, NC 27410 TX




MODEL #625 AMARR LINCOLN 1000, 2000
MODEL #675 AMARR HILLCREST 1000, 2000
MODEL #950 AMARR HERITAGE 1000, 2000


SIZE	DRAWN BY	DRC	DATE	DRAWING NUMBER
B	CHECKED BY	RLR	DATE 5/13/20	IRC-6209-150-15-1

AMARR COMPANY
165 CARRIAGE COURT WINSTON-SALEM, NC. 27105

SHEET 1 OF 3

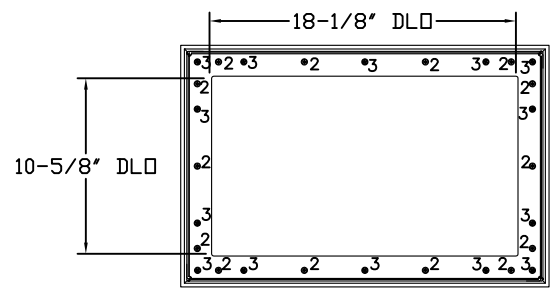


IMPACT GLAZING FASTENER DETAIL
N.T.S.

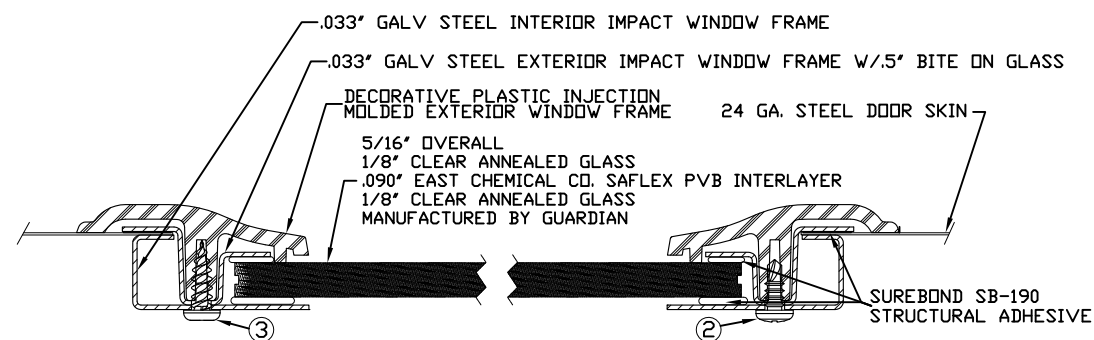


2. 3/16" X 1/2" SCREW - USED TO FASTEN THE STEEL EXTERIOR IMPACT WINDOW FRAME TO THE STEEL INTERIOR IMPACT WINDOW FRAME.
3. 11/64" X 1/2" SCREW - USED TO FASTEN DECORATIVE PLASTIC MOLDED WINDOW FRAME TO THE ASSEMBLY

SECTION B-B IMPACT WINDOW DETAIL
N.T.S.

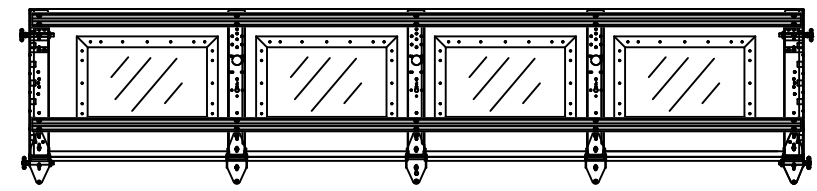

OPTIONAL TOP SECTION IMPACT GLAZED LAYOUT
N.T.S.

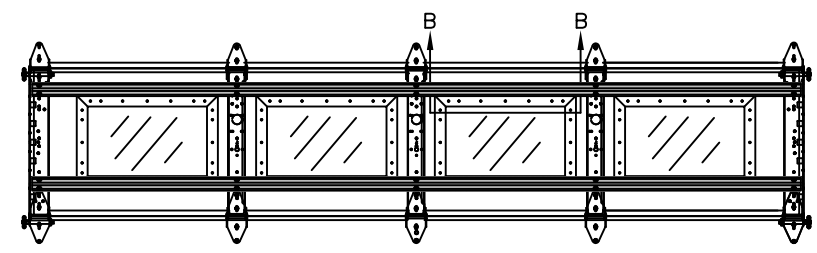

OPTIONAL INTERMEDIATE SECTION IMPACT GLAZED LAYOUT
N.T.S.

WOOD JAMB ATTACHMENT TO STRUCTURE (OPTIONAL)

2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE

5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS THEN 24" O.C. (1 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE

HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)

HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 24" O.C. (1 1/4" EMBEDMENT)

ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK

SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART) AT 16" O.C. (1 1/2" EMBEDMENT)

HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART) AT 16" O.C. (1 1/4" EMBEDMENT)



2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)

HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 24" O.C. (1 1/4" EMBEDMENT)

(OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)

*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

*PREPARATION OF WOOD JAMBS BY OTHERS

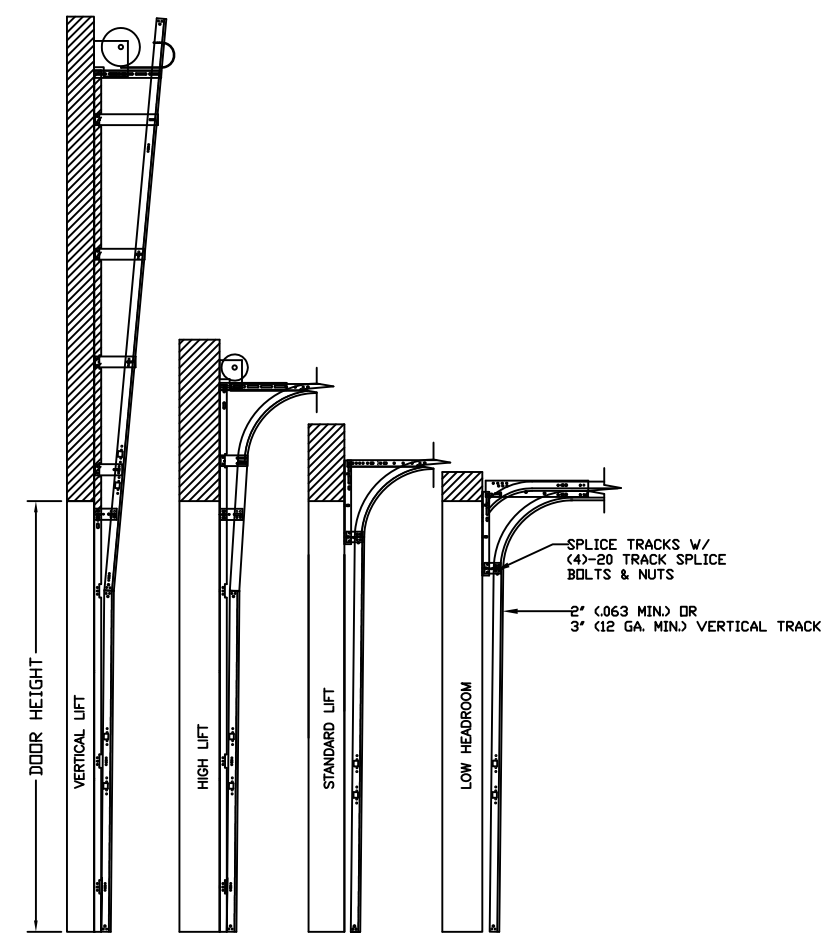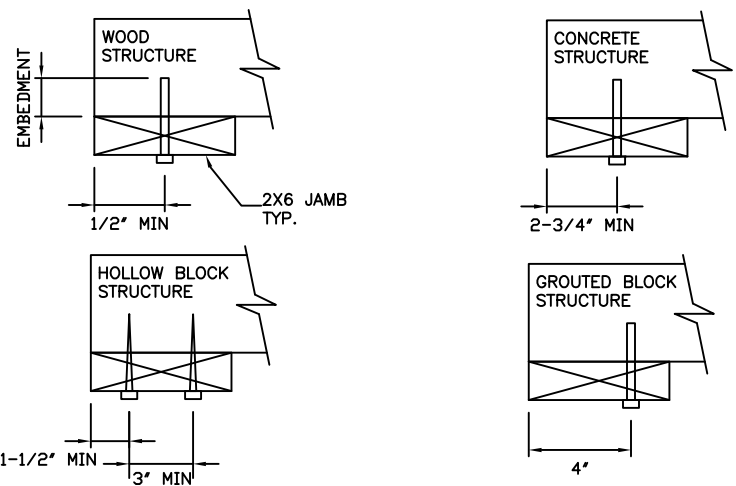

AVAILABLE TRACK CONFIGURATIONS
N.T.S.

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	ADDED HERITAGE MODEL/DRAWING UPDATES	3/1/22	RLR

MAX SIZE
9' x 14'
DESIGN LOADS
+35.6 PSF
-42.1 PSF
TEST LOADS
+53.4 PSF
-63.2 PSF
LARGE MISSILE
IMPACT
RESISTANCE



This document has been digitally signed & sealed by Thomas L. Shelmerdine, PE on the date shown. Printed copies of this document are not considered signed & sealed, and the signature must be verified on any electronic copies.

Thomas L. Shelmerdine, PE (TX PE #85829)
Structural Solutions, PA (TX Firm #F-004063)
5921-G W. Friendly Ave., Greensboro, NC 27410 TX



MODEL #625 AMARR LINCOLN 1000, 2000
MODEL #675 AMARR HILLCREST 1000, 2000
MODEL #950 AMARR HERITAGE 1000, 2000

SIZE	DRAWN BY	DRC	DATE	DRAWING NUMBER
B	CHECKED BY	RLR	DATE 4/13/20	IRC-6209-150-15-1
AMARR COMPANY 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105				SHEET 2 OF 3

TABLE 1

DOOR HEIGHT	SECTION HEIGHTS							
	Btm	#2	#3	#4	#5	#6	#7	#8
14' 0"	21"	21"	21"	21"	21"	21"	21"	21"
13' 6"	21"	21"	21"	21"	21"	18"	18"	21"
13' 0"	21"	21"	21"	18"	18"	18"	18"	21"
12' 6"	21"	18"	18"	18"	18"	18"	18"	21"
12' 0"	21"	21"	21"	21"	21"	18"	21"	
11' 6"	21"	21"	21"	18"	18"	18"	21"	
11' 0"	21"	18"	18"	18"	18"	18"	21"	
10' 6"	21"	21"	21"	21"	21"	21"		
10' 0"	21"	21"	21"	18"	18"	21"		
9' 6"	21"	18"	18"	18"	18"	21"		
9' 0"	18"	18"	18"	18"	18"	18"		
8' 6"	21"	21"	21"	18"	21"			
8' 0"	21"	18"	18"	18"	21"			
7' 6"	18"	18"	18"	18"	18"			
7' 0"	21"	21"	21"	21"				
6' 6"	21"	18"	18"	21"				

TABLE 3

Section	Panel Type	Center Stile Location (Measured from Left Edge)
Width (ft)		
8' 0"	Short, Bead Board	48.000
8' 0"	Long	48.000
8' 2"	Short, Bead Board	49.000
8' 2"	Long	49.000
8' 4"	Short, Bead Board	50.000
8' 4"	Long	50.000
8' 6"	Short, Bead Board	51.000
8' 6"	Long	51.000
8' 8"	Short, Bead Board	52.000
8' 8"	Long	52.000
8' 10"	Short, Bead Board	53.000
8' 10"	Long	53.000
9' 0"	Short, Bead Board	54.000
9' 0"	Long	54.000

TABLE 2

DOOR HEIGHT	TRACK ATTACHMENT								
	A	B	C	D	E	F	G	H	I
6' 6"	3.5"	10"	21"	39"	57"				
7'	3.5"	10"	21"	42"	63"				
7' 6"	3.5"	10"	18"	36"	54"	72"			
8'	3.5"	10"	21"	39"	57"	75"			
8' 6"	3.5"	10"	21"	42"	63"	81"			
9'	3.5"	10"	18"	36"	54"	72"	90"		
9' 6"	3.5"	10"	21"	39"	57"	75"	93"		
10'	3.5"	10"	21"	42"	63"	81"	99"		
10' 6"	3.5"	10"	21"	42"	63"	84"	105"		
11'	3.5"	10"	21"	39"	57"	75"	93"	111"	
11' 6"	3.5"	10"	21"	42"	63"	81"	99"	117"	
12'	3.5"	10"	21"	42"	63"	84"	105"	123"	
12' 6"	3.5"	10"	21"	39"	57"	75"	93"	111"	129"
13'	3.5"	10"	21"	42"	63"	81"	99"	117"	135"
13' 6"	3.5"	10"	21"	42"	63"	84"	105"	123"	141"
14'	3.5"	10"	21"	42"	63"	84"	105"	126"	147"

ALL TRACK ATTACHMENT SPACING +/-2" ALLOWED WITH SYP OR SPF NO. 2 OR BETTER ONLY

TABLE 4

SECTION	STRUT SIZE
8TH	3"
	3"
7TH	3"
	3"
6TH	3"
	3"
5TH	3"
	3"
4TH	3"
	3"
3RD	3"
	3"
2ND	3"
	3"
BOTTOM	3"
	3"


REV	DESCRIPTION OF REVISIONS	DATE	BY
A	ADDED HERITAGE MODEL/DRAWING UPDATES	3/1/22	RLR

MAX SIZE
9' x 14'

DESIGN LOADS
+35.6 PSF
-42.1 PSF

TEST LOADS
+53.4 PSF
-63.2 PSF


LARGE MISSILE
IMPACT
RESISTANCE



This document has been digitally signed & sealed by Thomas L. Shelmerdine, PE on the date shown. Printed copies of this document are not considered signed & sealed, and the signature must be verified on any electronic copies.

Thomas L. Shelmerdine, PE (TX PE #85829)
Structural Solutions, PA (TX Firm #F-004063)
5921-G W. Friendly Ave., Greensboro, NC 27410

TX



MODEL #625 AMARR LINCOLN 1000, 2000
MODEL #675 AMARR HILLCREST 1000, 2000
MODEL #950 AMARR HERITAGE 1000, 2000

SIZE	DRAWN BY	DRC	DATE	DRAWING NUMBER
B			4/13/20	IRC-6209-150-15-1
	CHECKED BY	RLR	DATE	5/13/20

AMARR COMPANY
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

SHEET 3 OF 3