

# **SLIDING GLASS DOOR - NON-IMPACT**

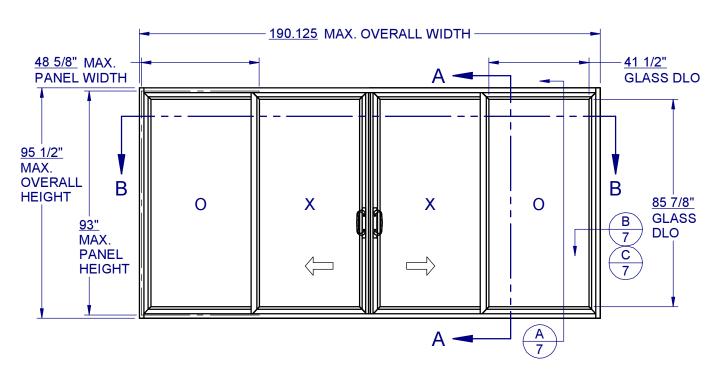

#### GENERAL NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE REQUIREMTNS OF THE 2018 INTERNATIONAL BUILDING CODE AND INTERNATIONAL RESIDENTIAL CODE.
- 2. GLAZING OPTIONS: (SEE SHEET 2)
- 3. APPROVED CONFIGURATIONS INCLUDE BUT ARE NOT LIMITED TO: "XO", "OX", "OXO", "OXXO".
- 4. ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. SEE SHEET 7 FOR ANCHOR DETAILS. WINDLOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 5. NOT APPROVED FOR IMPACT RESISTANCE. IMPACT PROTECTIVE SYSTEM IS REQUIRED IN WIND BORNE DEBRIS REGION.
- 6. ALL FRAMES ARE PROCESSED AND SCREWED TOGETHER. VENTS ARE FULLY WELDED.
- 7. SERIES / MODEL DESIGNATION SGD-8900
- 8. THE DESIGNATION X AND O STAND FOR THE FOLLOWING: X = OPERABLE SASH, O = FIXED SASH
- 9. SECTION CALLOUTS APPLY TO ALL CONFIGURATIONS IN A SIMILAR LOCATION.
- 10. WEEP SLOTS = 1/4" x 1-1/4" LOCATED 3" FROM BOTH ENDS.

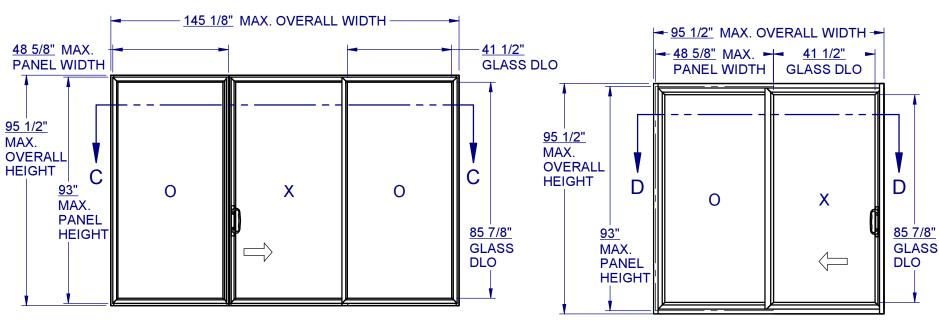

#### TABLE OF CONTENTS

GENERAL NOTES & ELEVATIONS	51
SECTION VIEWS	2-3
BOM & EXTRUSIONS	4
ANCHOR SCHEDULE & NOTES	5
INSTALLATION DETAILS	6

MAX. PANEL SIZE	DESIGN PRESSURE RATING	IMPACT RATING
48-5/8" x 93"	+/- 60 PSF	NONE

MAX. OF FOUR (4) PANELS IS ALLOWED AS LONG AS INDIVIDUAL PANELS DO NOT EXCEED PANEL SIZE AS SHOWN.



1900 SW 44TH AVE. OCALA, FLORIDA 34474 WWW.CWS.CC

### 8900 PVC SLIDING GLASS DOOR NON-IMPACT

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.




3/16/2020


LUCAS A. TURNER, P.E. TX PE #115094 TBPE REG. #FL-18075 2428 OLD NATCHEZ TRC TRL CAMDEN, TN 38320 PH. 941-380-1574


SHEET DESCRIPTION:

# GENERAL NOTES AND ELEVATIONS

DRAWN BY:	DATE:
ADE	10/30/09
DWG #:	REV.:
TDI-496	-
SCALE:	SHEET
1:40	1 OF 6

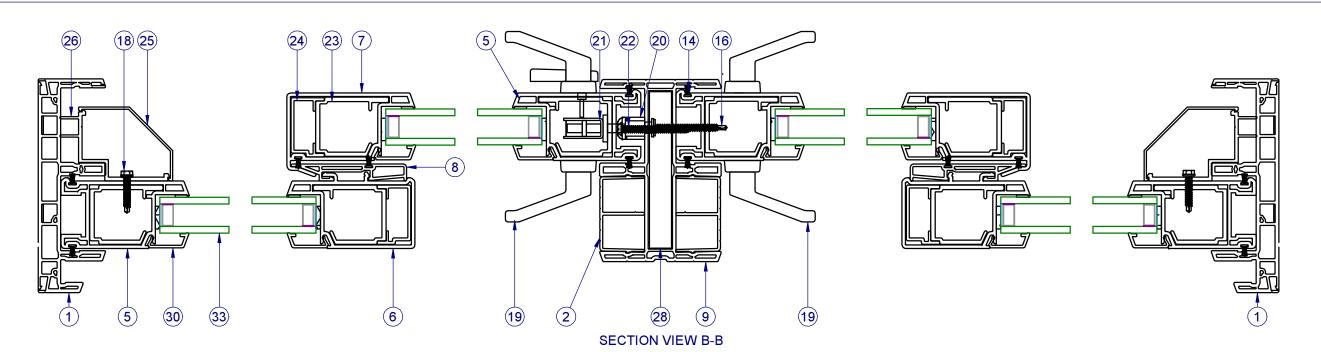

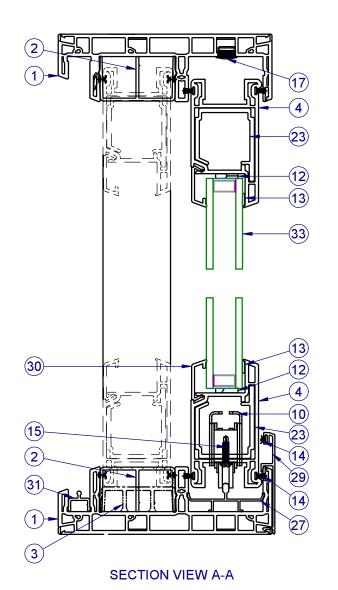

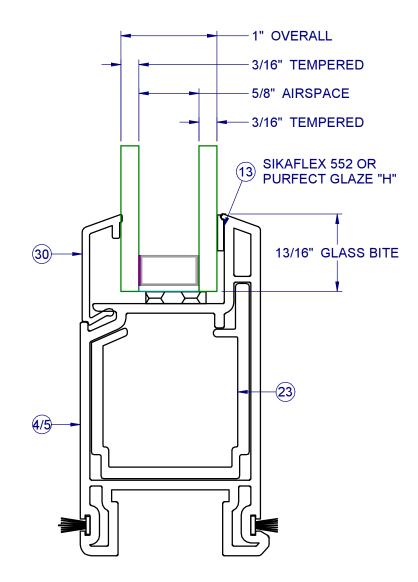

**GLASS TYPE A** 

	MAX.
SILL RISER	POSITIVE DP
* NONE	60
1737	60

<sup>\*</sup> INSTALLATION WITH NO SILL RISER ALLOWED ONLY WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED.

# CUSTOM WINDOW SYSTEMS

1900 SW 44TH AVE. OCALA, FLORIDA 34474 WWW.CWS.CC

### 8900 PVC SLIDING GLASS DOOR NON-IMPACT

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS INC. IS DECLIED.




3/16/2020


LUCAS A. TURNER, P.E. TX PE #115094 TBPE REG. #FL-18075 2428 OLD NATCHEZ TRC TRL CAMDEN, TN 38320 PH. 941-380-1574

SHEET DESCRIPTION:

# SECTION VIEWS OXXO

DRAWN BY:	DATE:
ADE	10/30/09
DWG #:	REV.:
TDI-496	-
SCALE:	SHEET
1:2.67	2 OF 6

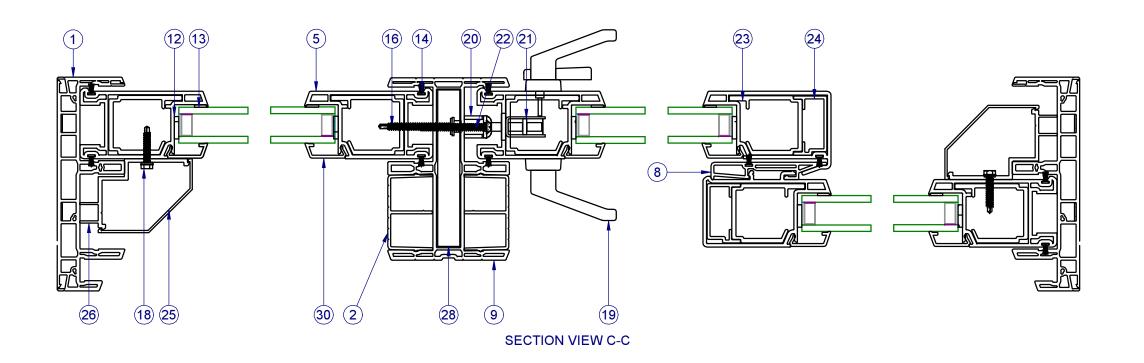

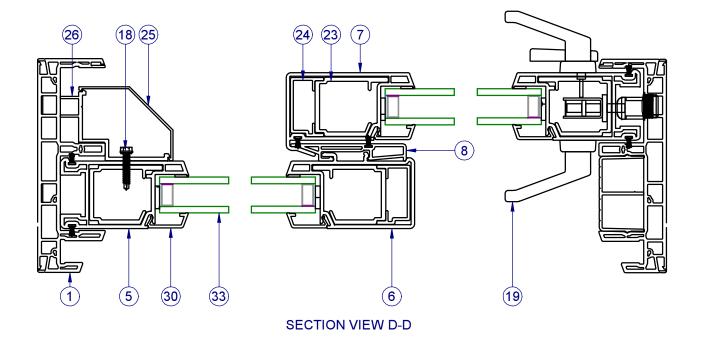



1900 SW 44TH AVE. OCALA, FLORIDA 34474 WWW.CWS.CC

## 8900 PVC SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.




3/16/2020


LUCAS A. TURNER, P.E. TX PE #115094 TBPE REG. #FL-18075 2428 OLD NATCHEZ TRC TRL CAMDEN, TN 38320 PH. 941-380-1574

SHEET DESCRIPTION:

# SECTION VIEWS OXO & OX

DRAWN BY:	DATE:
ADE	10/30/09
DWG #:	REV.:
TDI-496	-
SCALE:	SHEET
1:2.63	3 OF 6

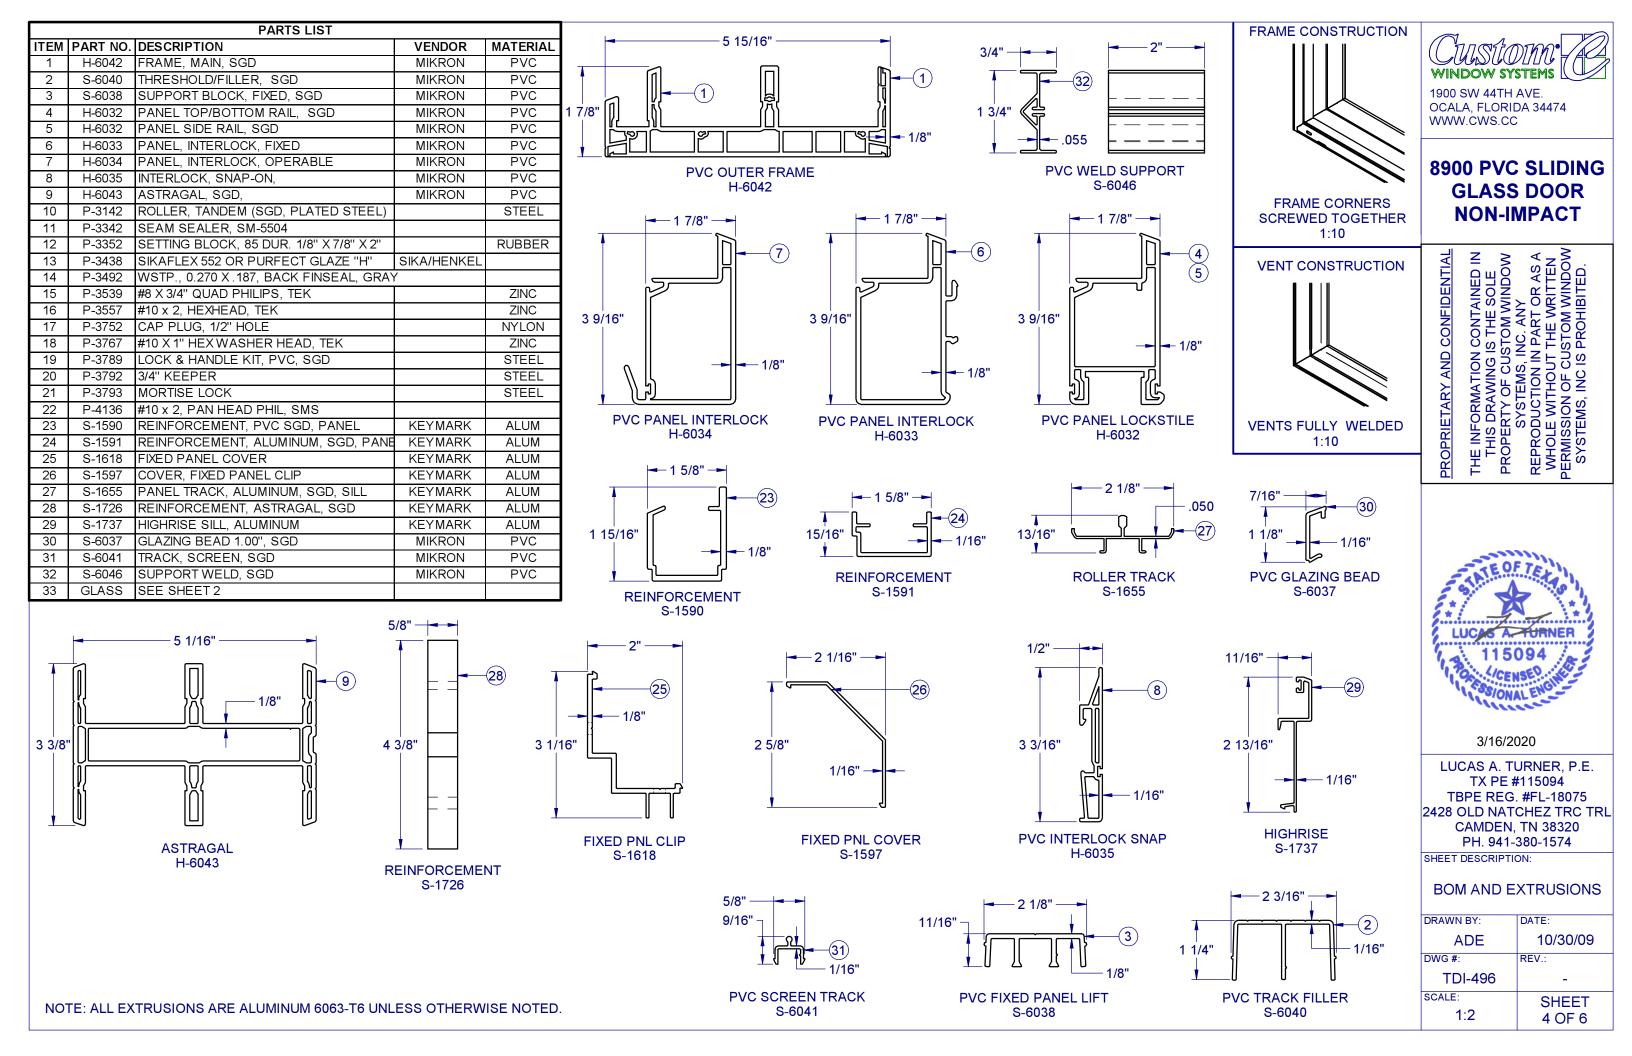

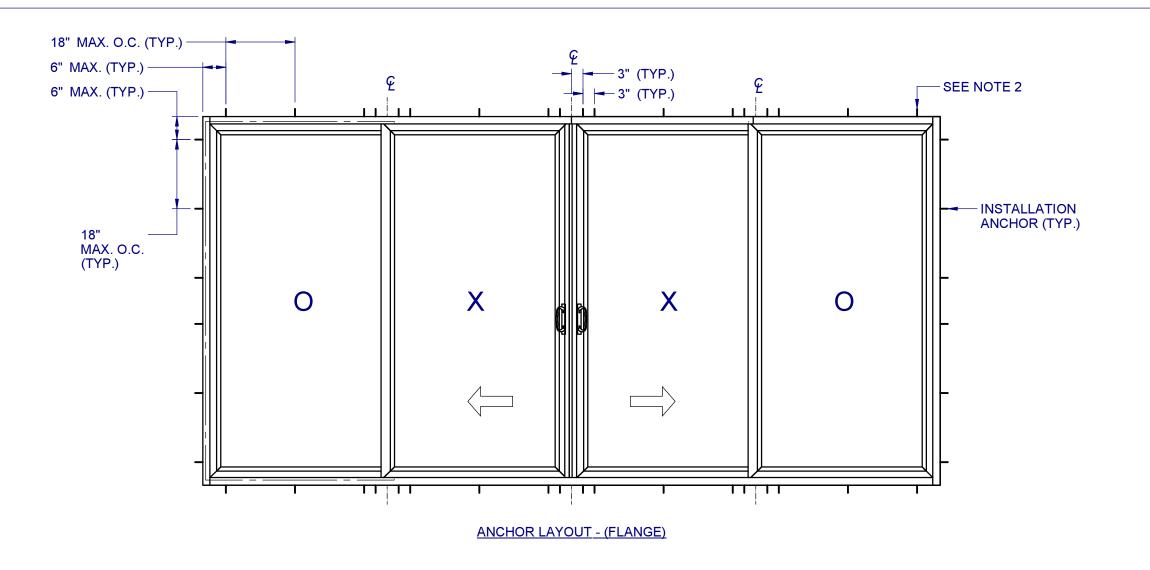

#### NOTES:

- 1. INSTALL TWO ANCHORS AT EACH INSTALLATION LOCATION. SILL ANCHOR SPACING SAME AS HEAD.
- 2. SHIM AS REQ AT EACH INSTALLATION ANCHOR USING LOAD BEARING SHIMS. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT. LOAD BEARING SHIMS SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. WOOD SHIMS ARE NOT ALLOWED.
- 3. ANCHOR TYPE, SIZE, SPACING AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS, SEE TABLE 1. SHEET 6
- 4. ALL INSTALLATION ANCHORS MUST BE MADE OF OR PROTECTED WITH A CORROSION RESISTANT MATERIAL OR COATING. DISSIMILAR METALS OR MATERIALS IN CONTACT WITH PRESSURE TREATED WOOD MUST BE PROTECTED TO PREVENT REACTION.
- 5. INSTALLATION ANCHORS SHALL BE IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM SPECIFIED IN TABLE 1, SHEET 6.
- 6. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR CONCRETE/CMU OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, INTO SUBSTRATE 1X BUCKS ARE OPTIONAL.
- 7. A MINIMUM CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL FASTENERS: 2-7/16" FOR MASONRY, 2" FOR FIXED PANEL CLIPS (ALL SUBSTRATES), 1" FOR WOOD AND METAL.
- 8. WOOD OR MASONRY OPENINGS, BUCKS AND BUCK FASTENERS SHALL BE PROPERLY DESIGNED BY THE ARCHITECT OR ENGINEER OF RECORD AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
  SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE1. SHEET 6. CONCRETE AND MASONRY SUBSTRATES MAY NOT BE CRACKED.
- 9. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS FOLLOWING THE CURRENT VERSION OF THE REFERENCE DOCUMENTS: FMA/AAMA 100(FIN WINDOWS), FMA/AAMA 200(FLANGE WINDOWS), FMA/WDMA 250(BOX WINDOWS), FMA/AAMA/WDMA 300(EXTERIOR DOORS)



1900 SW 44TH AVE. OCALA, FLORIDA 34474 WWW.CWS.CC

# 8900 PVC SLIDING GLASS DOOR NON-IMPACT

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.



3/16/2020

LUCAS A. TURNER, P.E. TX PE #115094 TBPE REG. #FL-18075 2428 OLD NATCHEZ TRC TRL CAMDEN, TN 38320 PH. 941-380-1574

SHEET DESCRIPTION:

ANCHOR SCHEDULE AND NOTES

DRAWN BY:	DATE:
ADE	10/30/09
DWG #:	REV.:
TDI-496	-
SCALE:	SHEET
1:25	5 OF 6



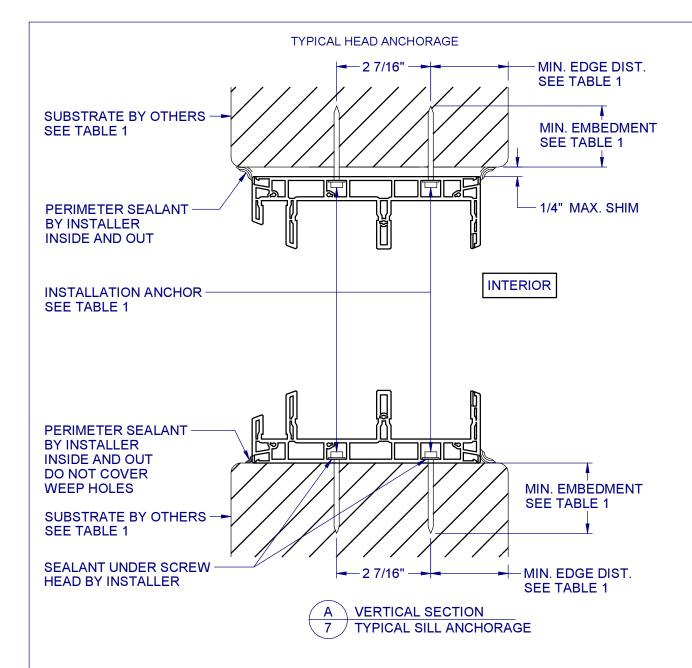


TABLE 1: APPROVED INSTALLATION FASTENERS			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN.)	3/16" ITW TAPCON	1"	3''
CONCRETE (2.85 KSI MIN.)	3/16" ELCO ULTRACON	1-3/4"	1"
HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" ELCO ULTRACON	1-1/4''	1"
2X MIN. SPRUCE-PINE-FIR (G=0.42)	3/16" ITW TAPCON OR ELCO ULTRACON	1-3/8"	7/8''
2X MIN. SPRUCE-PINE-FIR (G=0.42)	#10 WOOD SCREW	1-3/8"	7/8''
16 GAUGE (0.060") MIN. STEEL STUD (33 KSI YIELD MIN)	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	FULL THREAD THRU 0.060"	1/2"
1/8" ALUM. (6063-T5 MIN.) OR 1/8" STEEL (33 KSI MIN.)	#10 GRADE 5 SELF-TAPPING / DRILLING SCREW	FULL THREAD THRU 0.125"	1/2"
FIXED PANEL CLIP ANCHORS INTO CONCRETE (2.0 KSI MIN.) OR HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	3"
FIXED PANEL CLIP ANCHORS INTO CONCRETE (2.85 KSI MIN.) OR HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" ELCO ULTRACON	1-1/4"	2-1/2"



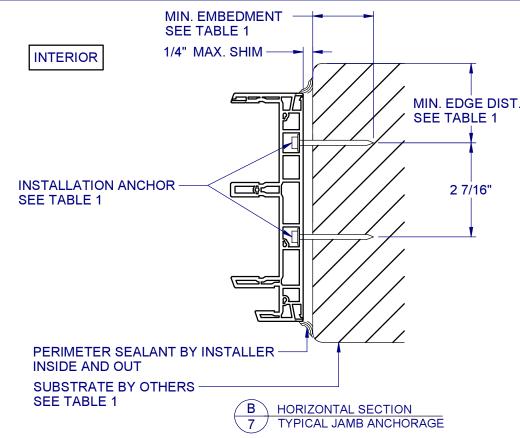

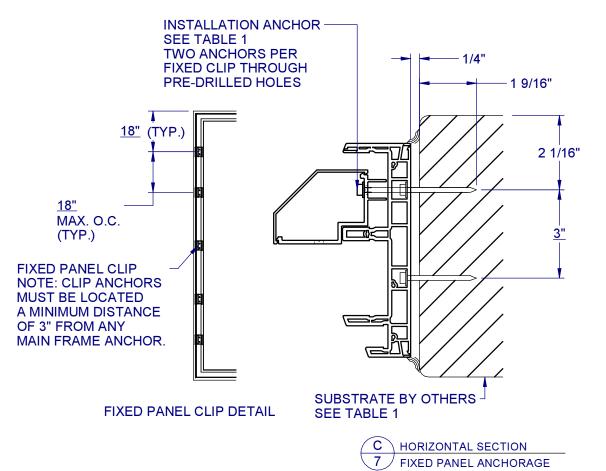

### 8900 PVC SLIDING GLASS DOOR NON-IMPACT

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.



3/16/2020

LUCAS A. TURNER, P.E. TX PE #115094 TBPE REG. #FL-18075 2428 OLD NATCHEZ TRC TRL CAMDEN, TN 38320 PH. 941-380-1574

SHEET DESCRIPTION:

### INSTALLATION DETAILS

DRAWN BY:	DATE:
ADE	10/30/09
DWG #:	REV.:
TDI-496	-
SCALE:	SHEET
1:2.5	6 OF 6

NOTE: FIXED PANEL CLIP ANCHORS INTO WOOD OR METAL SHALL FOLLOW THE ANCHOR TYPE, MIN. EMBEDMENT AND MIN. EDGE DISTANCE LISTED IN TABLE 1.