



THERMA-TRU® DOORS

Fiber-Classic® & Smooth-Star®

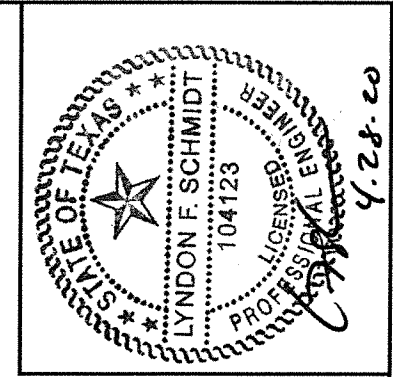

FLUSH GLAZED FIBERGLASS DOOR IN SWING/OUT SWING "NON-IMPACT"

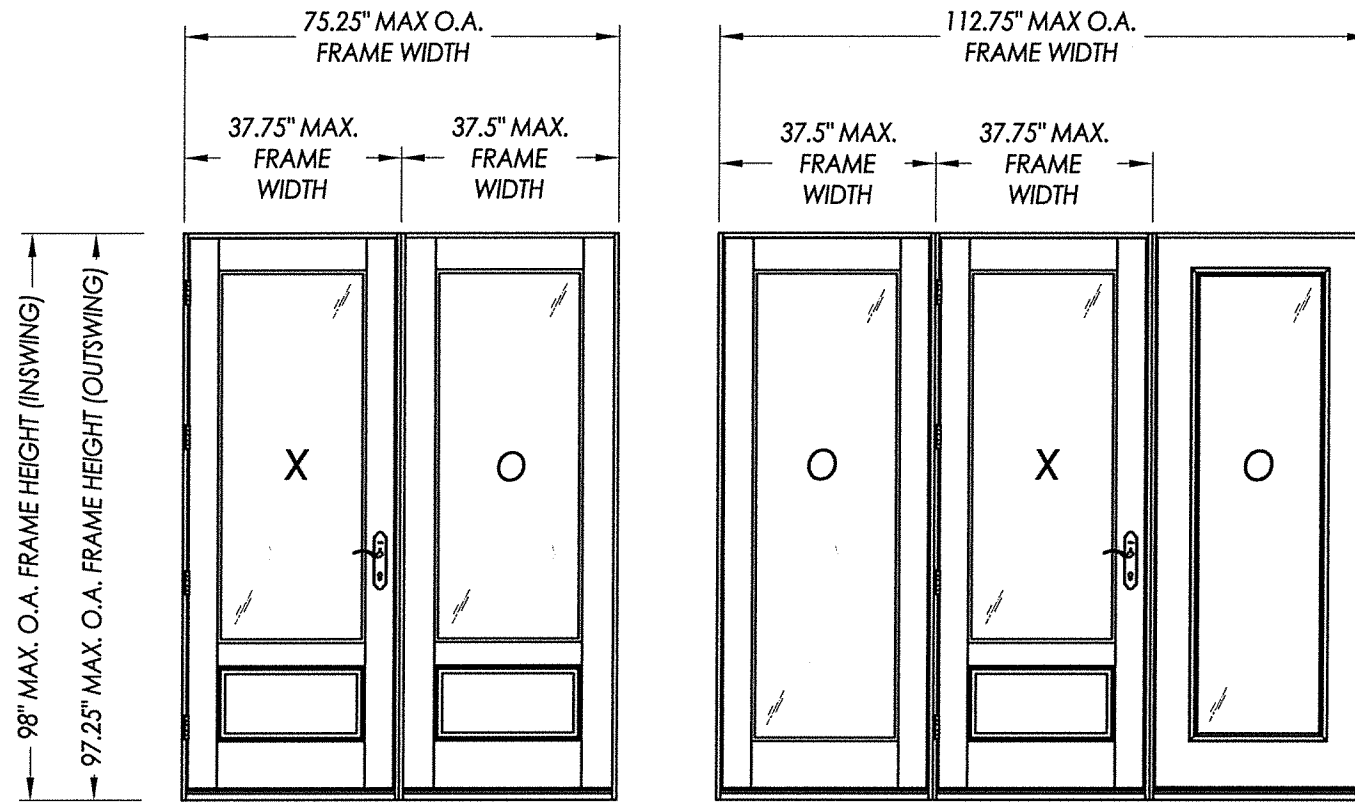

EVALUATED FOR USE IN THE STATE OF TEXAS

The Fiberglass Door system described herein complies with the 2018 International Residential Code (IRC), Sections R301 & R609 and the 2018 International Building Code (IBC), Sections 1404.13, 1609, 1709.5, 2403 and 2404 subject to the following conditions:

1. Anchors shall be as listed and spaced as shown in the details. Anchor embedment to base material shall be beyond wall dressing or stucco.
2. When used in areas requiring wind-borne debris protection, this system is required to be protected with an impact resistant covering that complies with Section R301.2.1.2 of the IRC and Section 1609.2 of the IBC.
3. Allowable design pressure requirements must be equal to or less than the design pressure rating shown in the design pressure chart, sheet 1 of this drawing.
4. Conditions not covered by this drawing are subject to further engineering analysis.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	Table of contents, design pressure and general notes
2	Door/Sidelite panel & glazing details
3	Sidelite panel & glazing details
4	Elevators
5	Horizontal cross sections
6	Vertical cross sections
7	Frame anchoring & hardware details
8	Bill of materials and components

CONFIGURATION	MAX FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
OX/XO	53.25" X 98.0"	+55.0	-60.0	+40.0	-40.0
OX/XO	75.25" X 98.0"	+40.0	-45.0	+40.0	-40.0
O XO	68.75" X 98.0"	+55.0	-60.0	+40.0	-40.0
O XO	112.75" X 98.0"	+40.0	-45.0	+40.0	-40.0

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197




TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: THERMA-TRU
FLUSH GLAZED DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

NO.	DATE	DESCRIPTION	BY
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE	LFS




DATE: 7/28/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4561
SHEET 1 OF 8

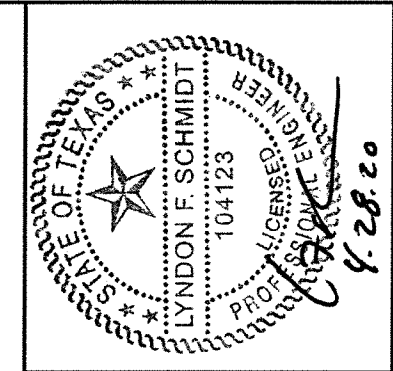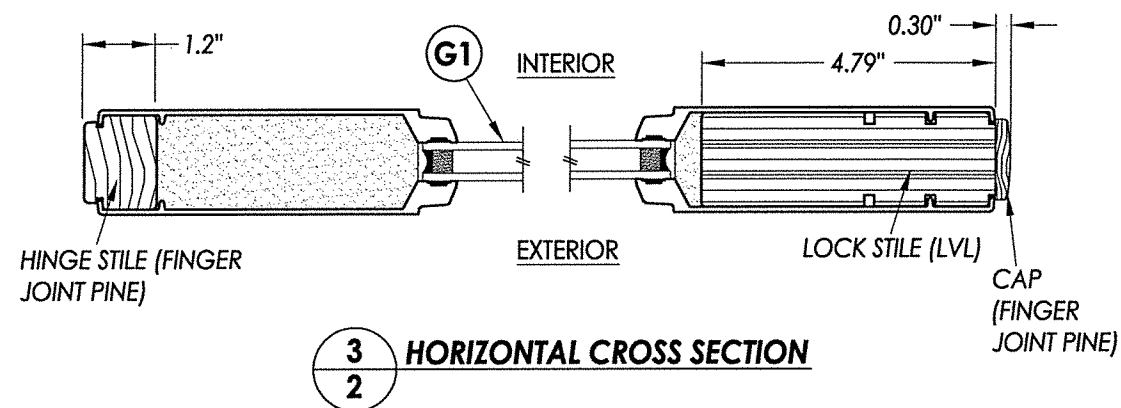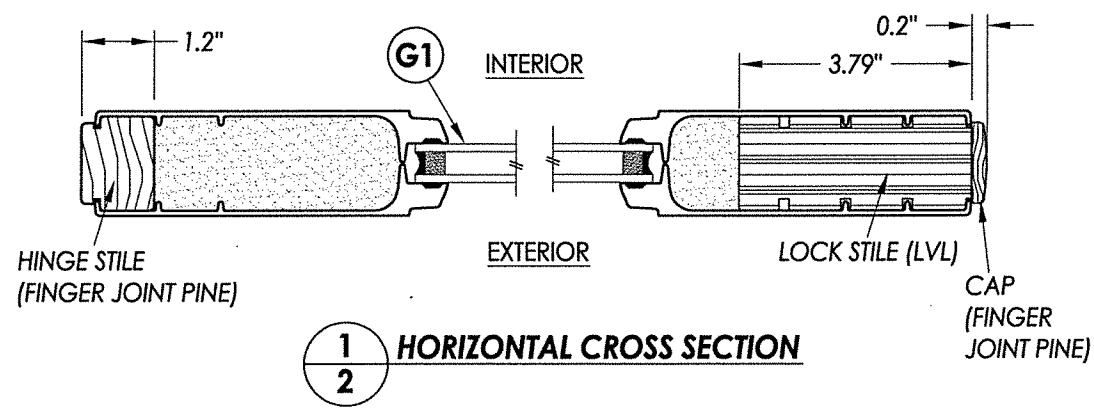

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Vairico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

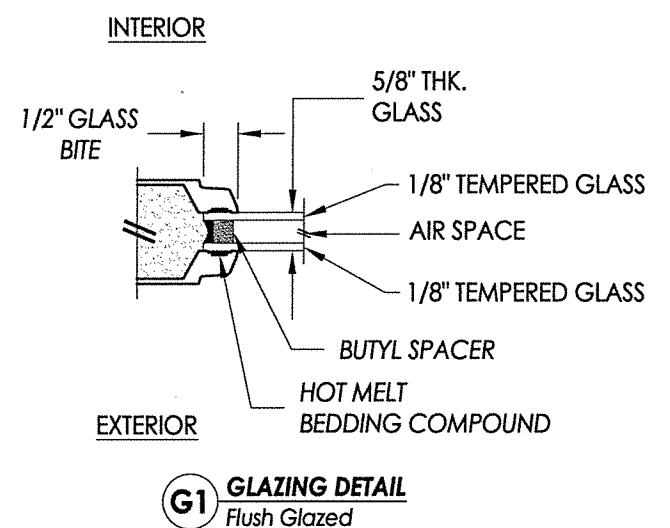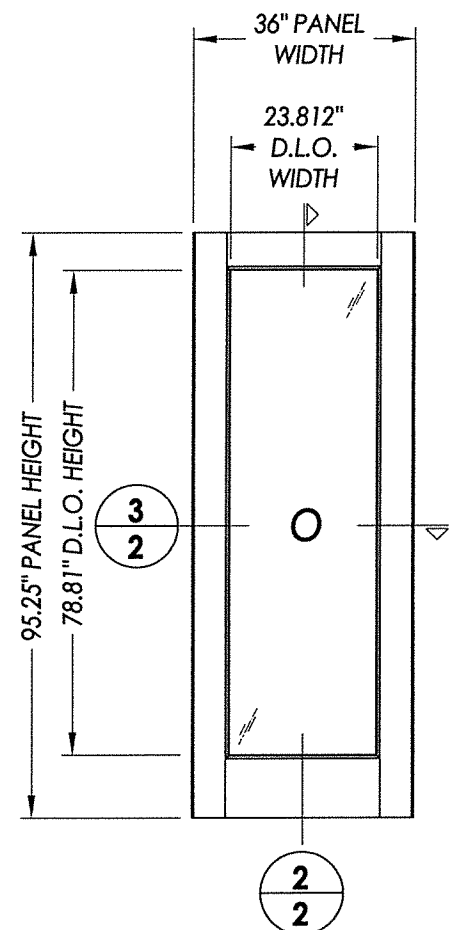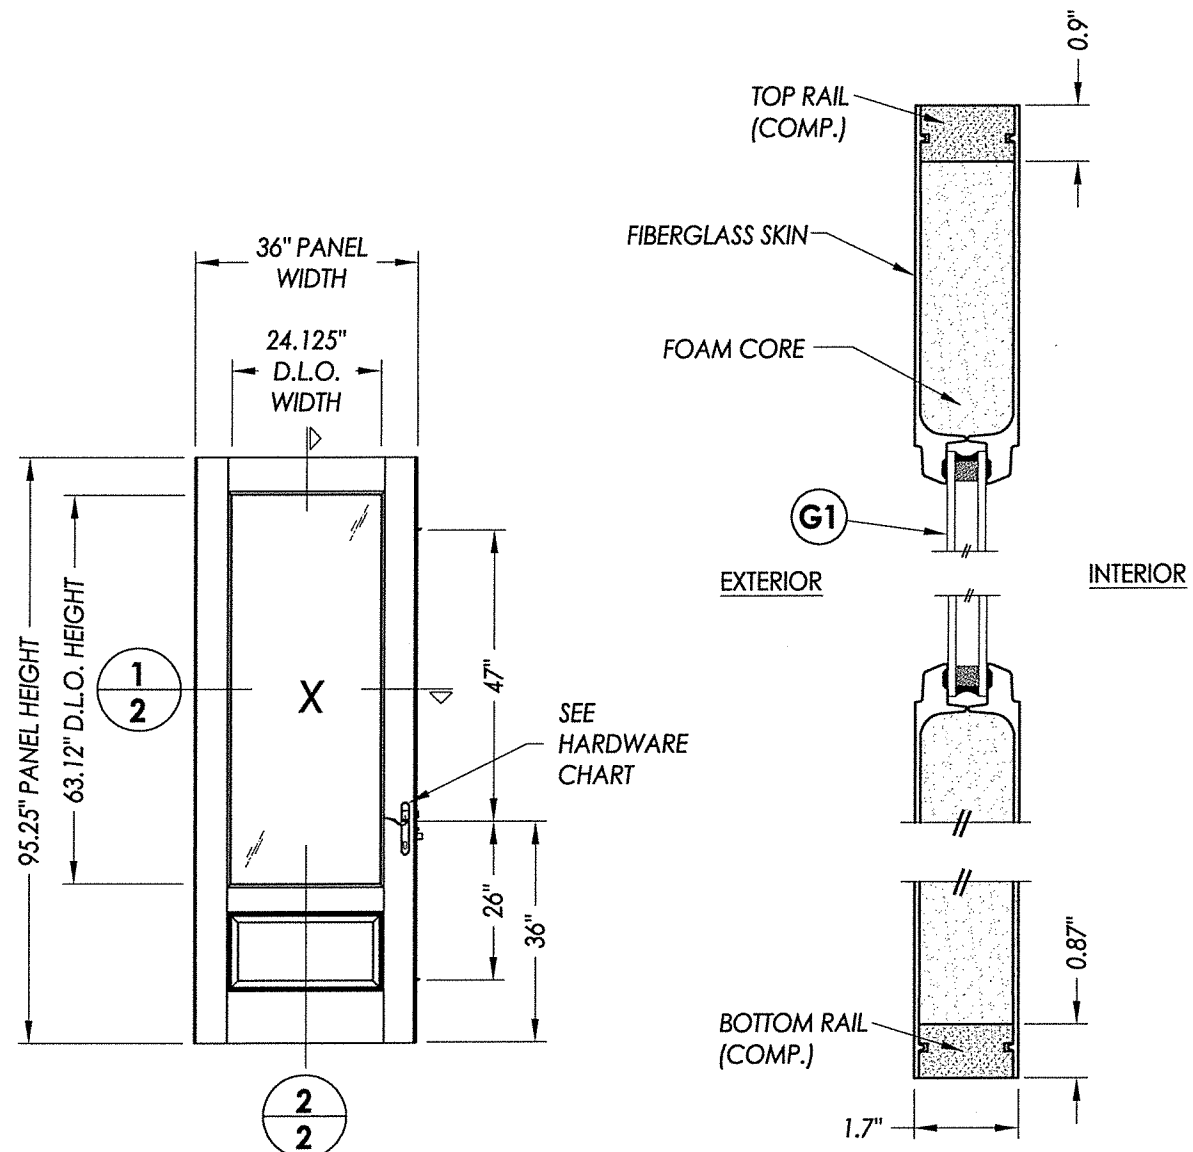

40 **3'-0" DOOR/SIDELITE PANEL**
Fiber-Classic or Smooth-Star
3/4 Lite (Flush Glazed)

FIBERGLASS SKIN: 0.077" THICKNESS
FOAM CORE: POLYURETHANE

2
2 **VERTICAL CROSS SECTION**










50 **3'-0" SIDELITE PANEL**
Fiber-Classic or Smooth-Star
Full Lite (Flush Glazed)

FIBERGLASS SKIN: 0.077" THICKNESS
FOAM CORE: POLYURETHANE

HARDWARE TABLE	
MANUFACTURER	MODEL
Therma-Tru	MULTI POINT LOCK: MPDGART

PRODUCT:	THERMA-TRU FLUSH GLAZED DOOR
PART OR ASSEMBLY:	DOOR/SIDELITE PANEL & GLAZING DETAILS
NO.	1
DATE	4/28/20
UPDATE TO	2018 IBC/IRC CODE
LFS	BY
REVISIONS	
DATE:	7/28/15
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	TX-4561
SHEET	2 OF 8

R:\Clients\Therma Tru PERMANENT\B - Texas Dept of Ins\TDI - DR 763 - 80 Flush Glazed Classic Craft Door Panels\C - Drawings\TX-4560-62.dwg, 3.2

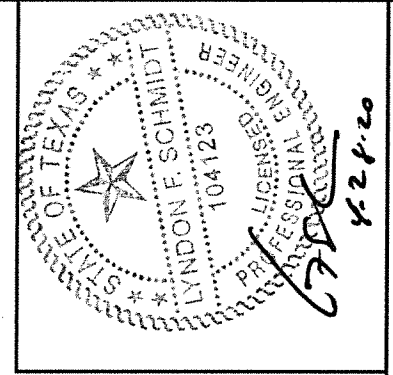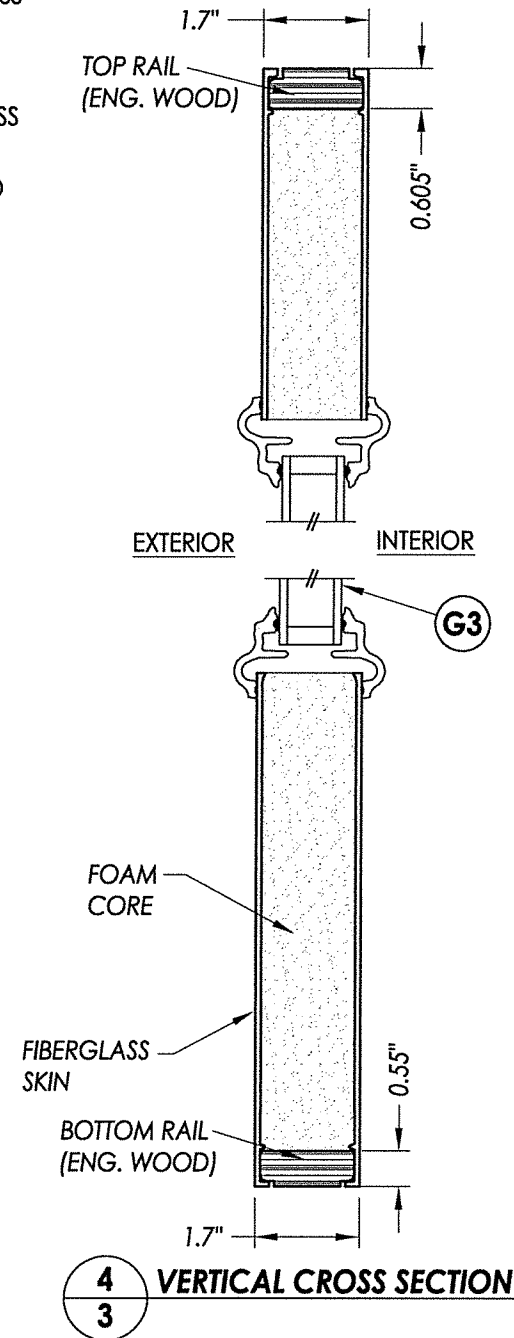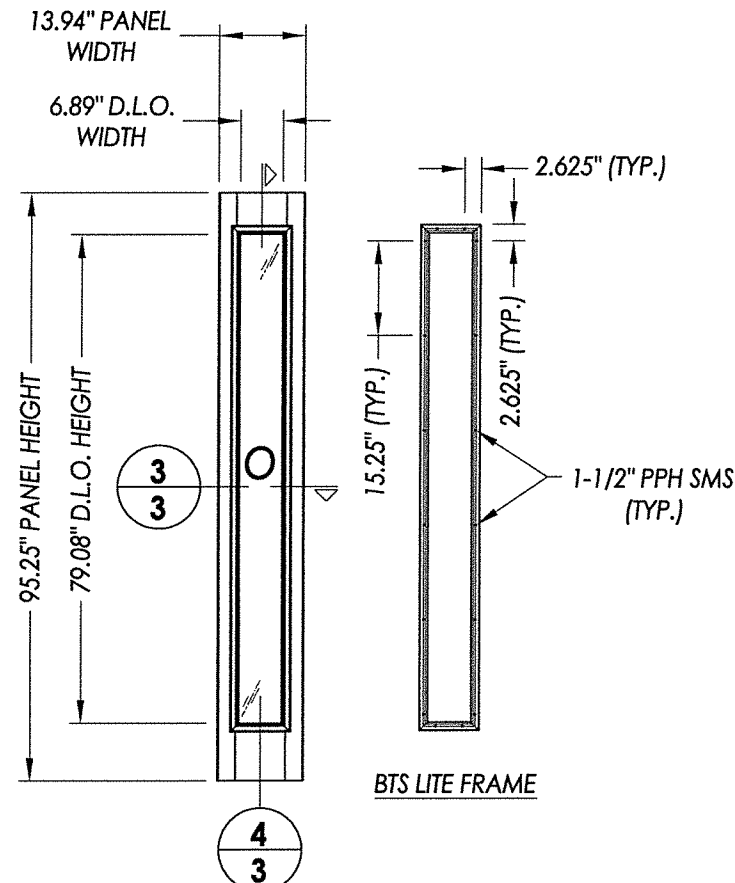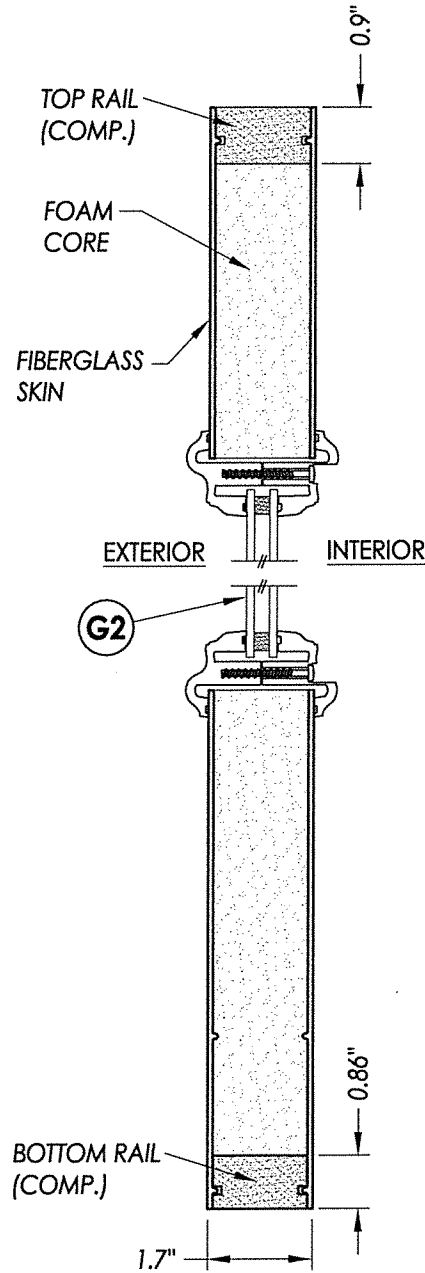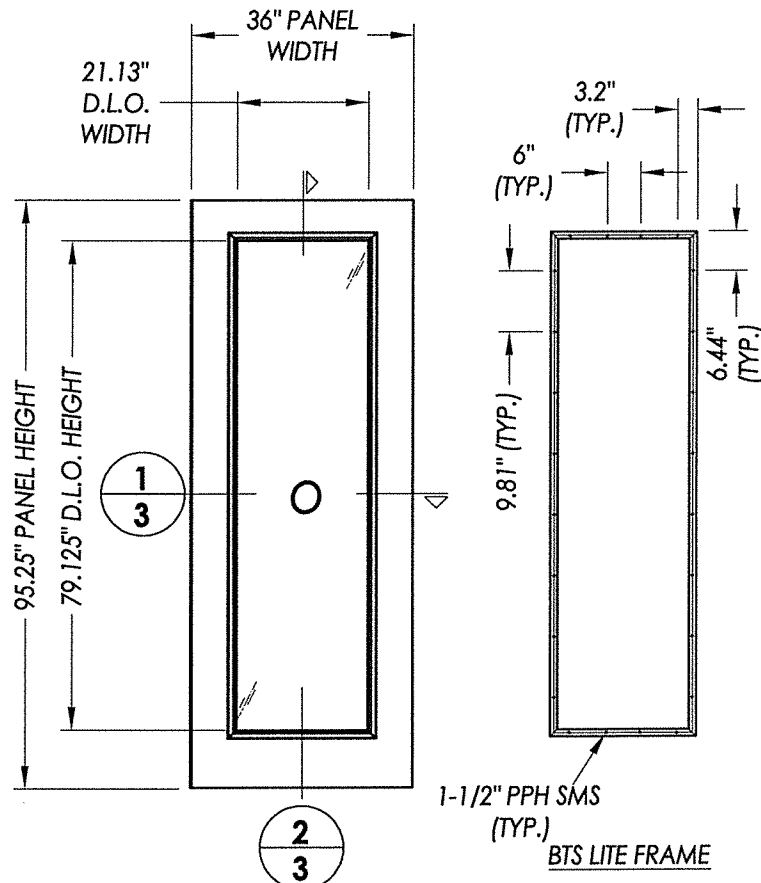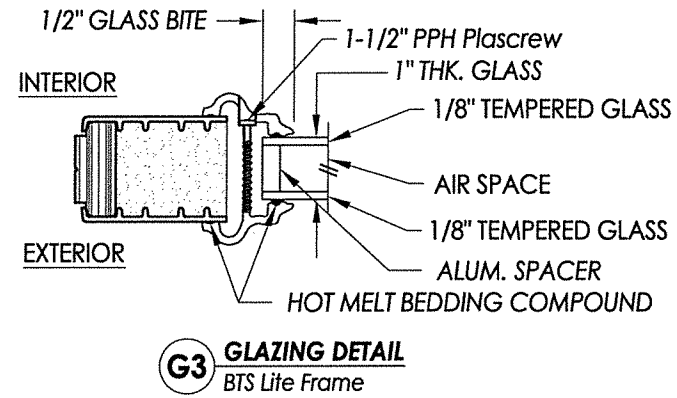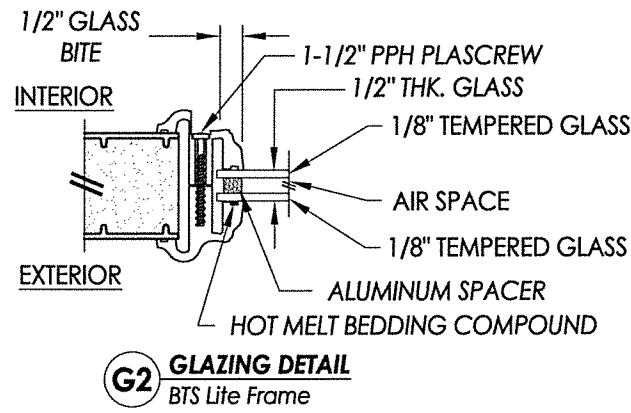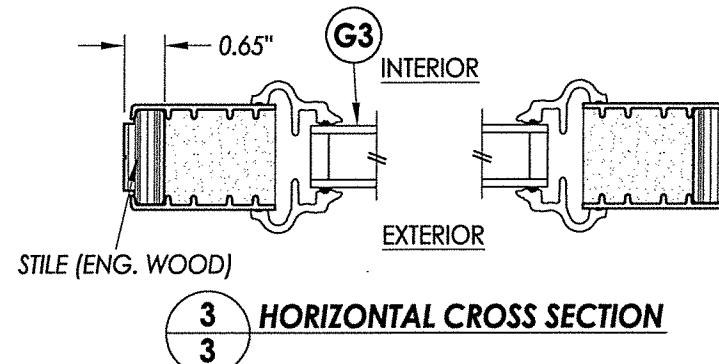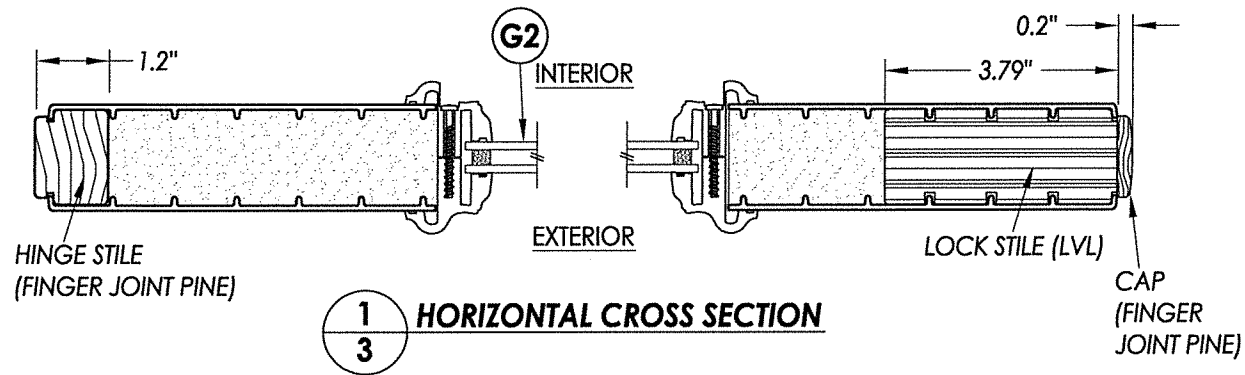

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123


RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: THERMA-TRU FLUSH GLAZED DOOR
PART OR ASSEMBLY: SIDELITE PANEL & GLAZING DETAILS


NO.	DATE	REVISIONS
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE
		LFS
		BY

DATE: 7/28/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4561
SHEET 3 OF 8


© 2015 R.W. BUILDING CONSULTANTS INC.

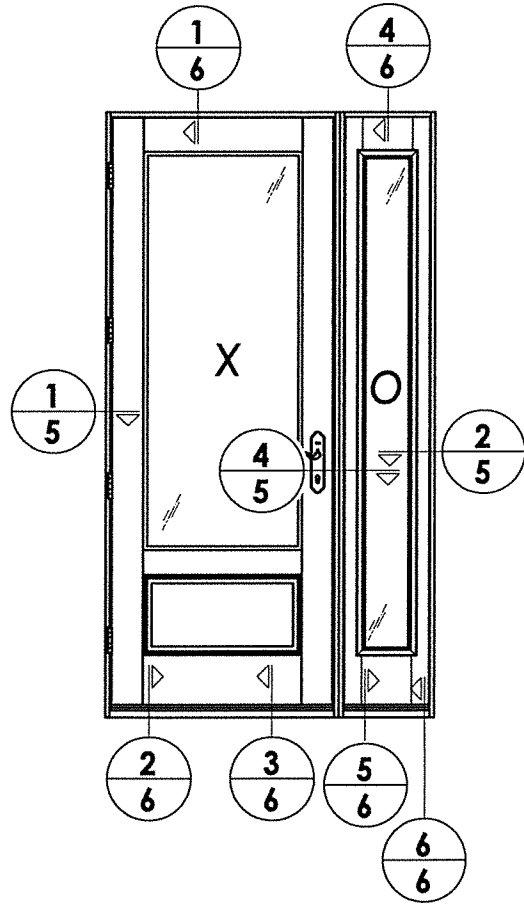


3'-0" Door Panel w/ 14" Sidelite

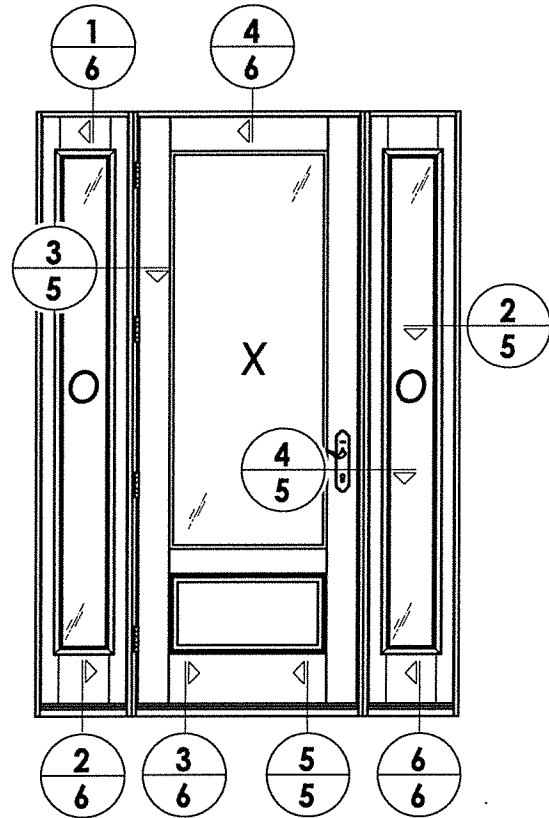


3'-0" Door Panel w/ 14" Sidelites

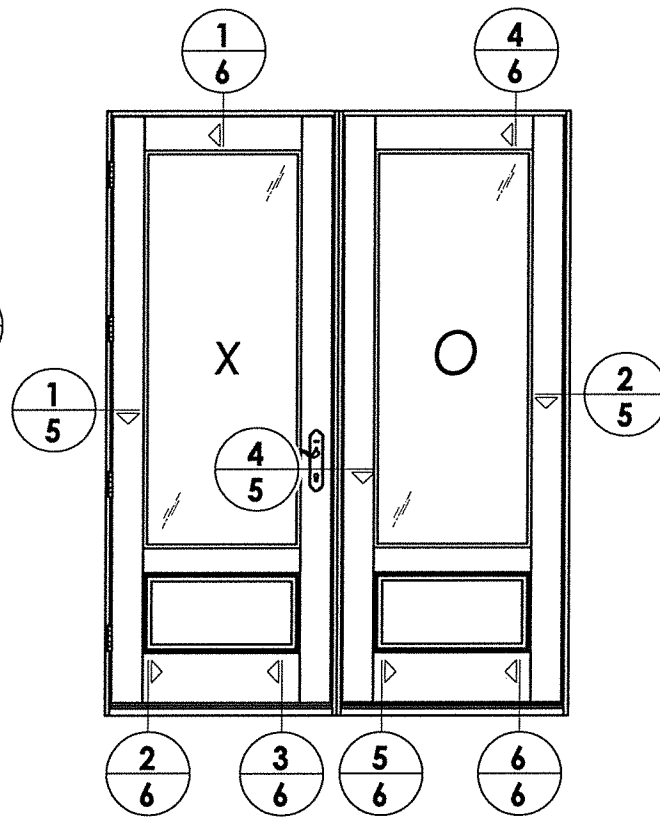

3'-0" Door Panel w/ 36" Sidelite

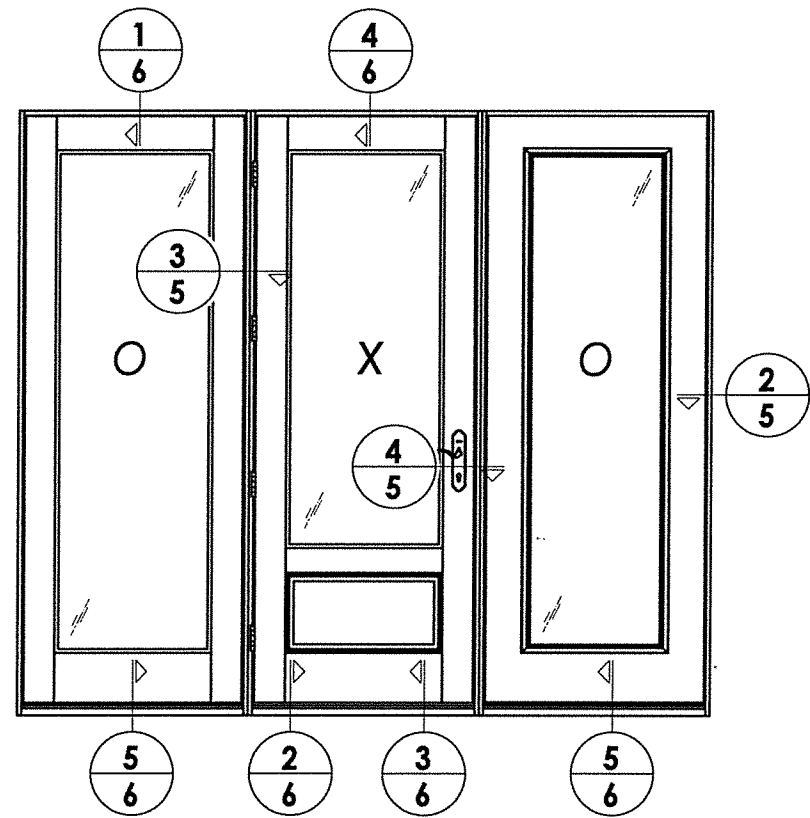

3'-0" Door Panel w/ 36" Sidelites

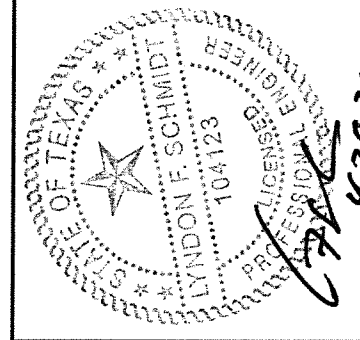


Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852


PRODUCT: THERMA-TRU
FLUSH GLAZED DOOR
PART OR ASSEMBLY:
SIDELITE PANEL DETAILS &
GLAZING DETAIL

NO.	DATE	DESCRIPTION	LFS	BY
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE		


DATE: 7/28/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4561
SHEET 4 OF 8

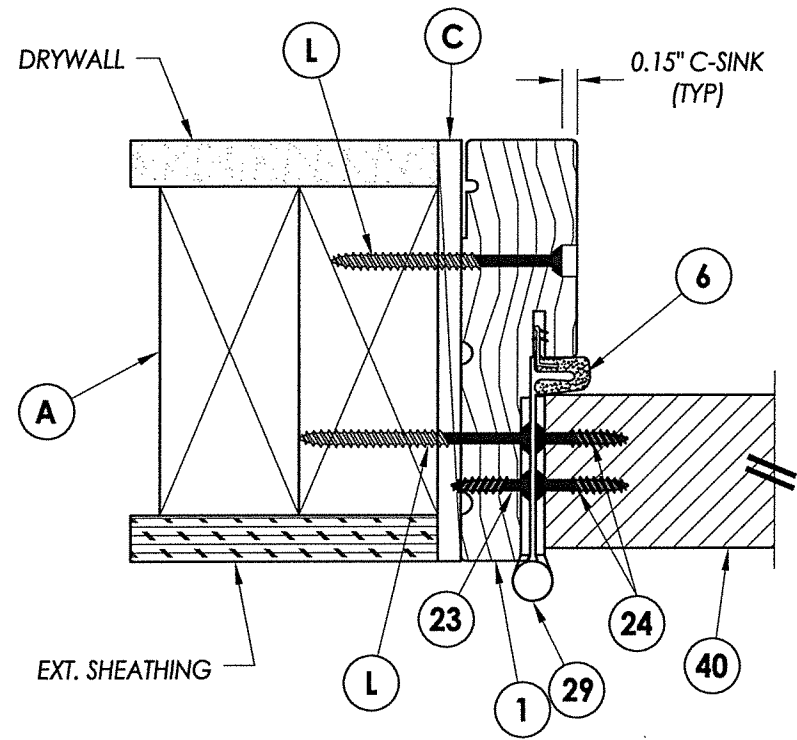

1 HORIZONTAL CROSS SECTION
5 Outswing Shown (Inswing similar)

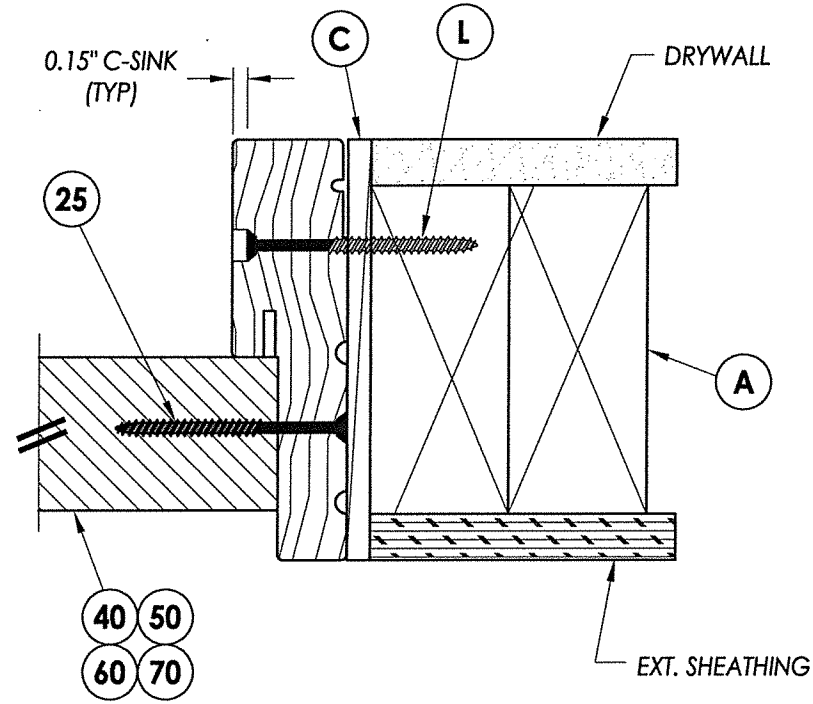

2 HORIZONTAL CROSS SECTION
5 Outswing Shown (Inswing similar)

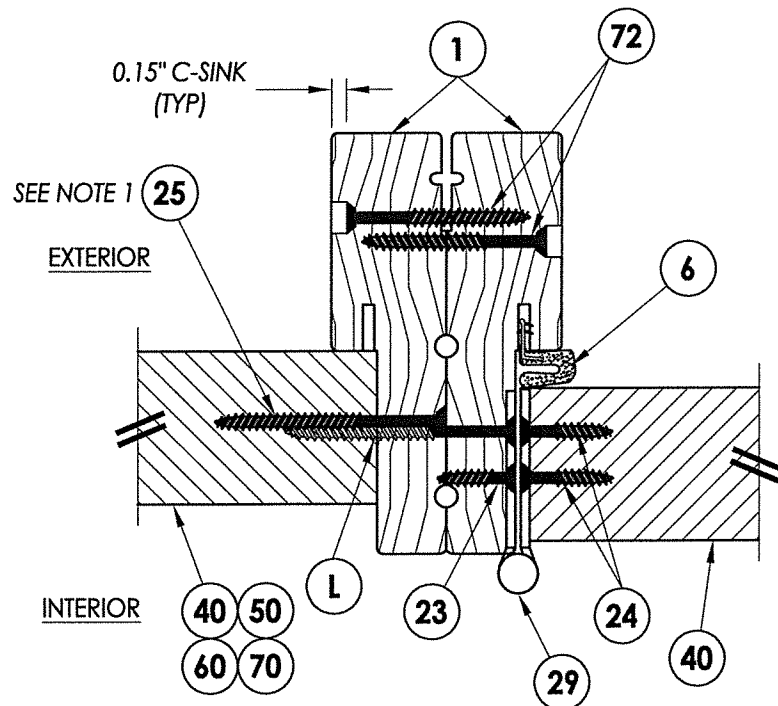


3 HORIZONTAL CROSS SECTION
5 Outswing Shown (Inswing similar)

INTERIOR


EXTERIOR

INTERIOR

EXTERIOR

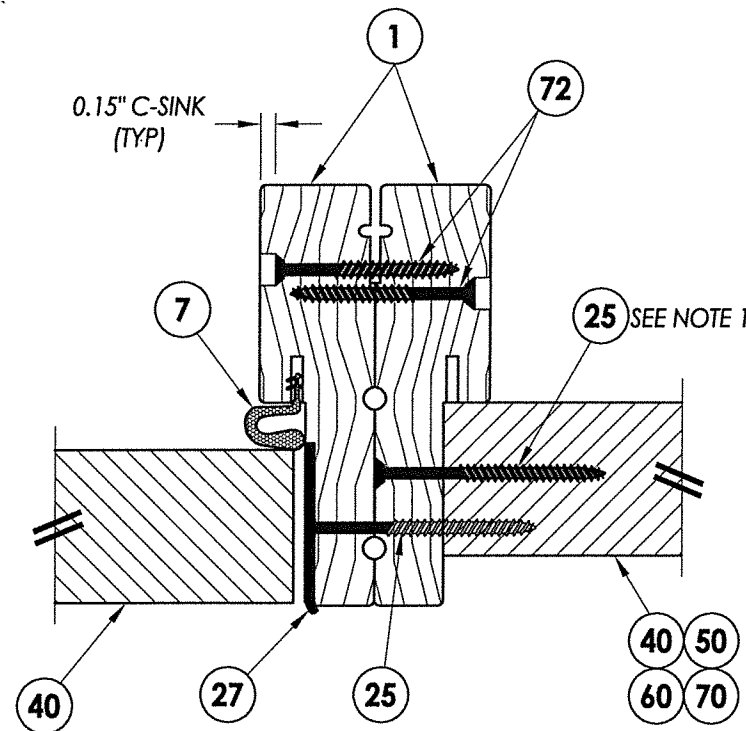

4 HORIZONTAL CROSS SECTION
5 Outswing Shown (Inswing similar)

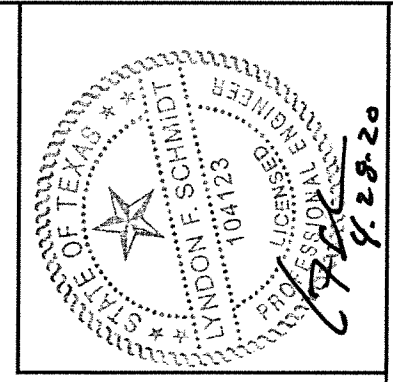


Note:
1. Sidelite assembly screws located 8" from each end then 2 more equally spaced (4 total).

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123
RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL, 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852


PRODUCT: THERMA-TRU FLUSH GLAZED DOOR
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

NO.	DATE	DESCRIPTION	BY
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE	LFS


DATE: 7/28/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4561
SHEET 5 OF 8

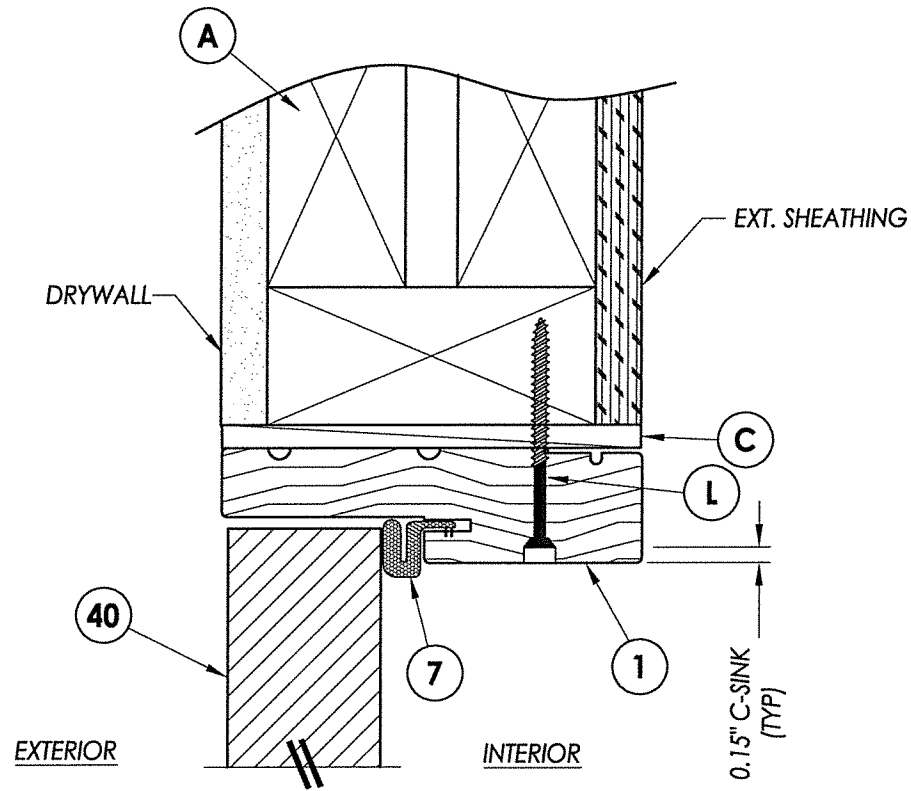

1 VERTICAL CROSS SECTION
6 Outswing Shown (Inswing similar)

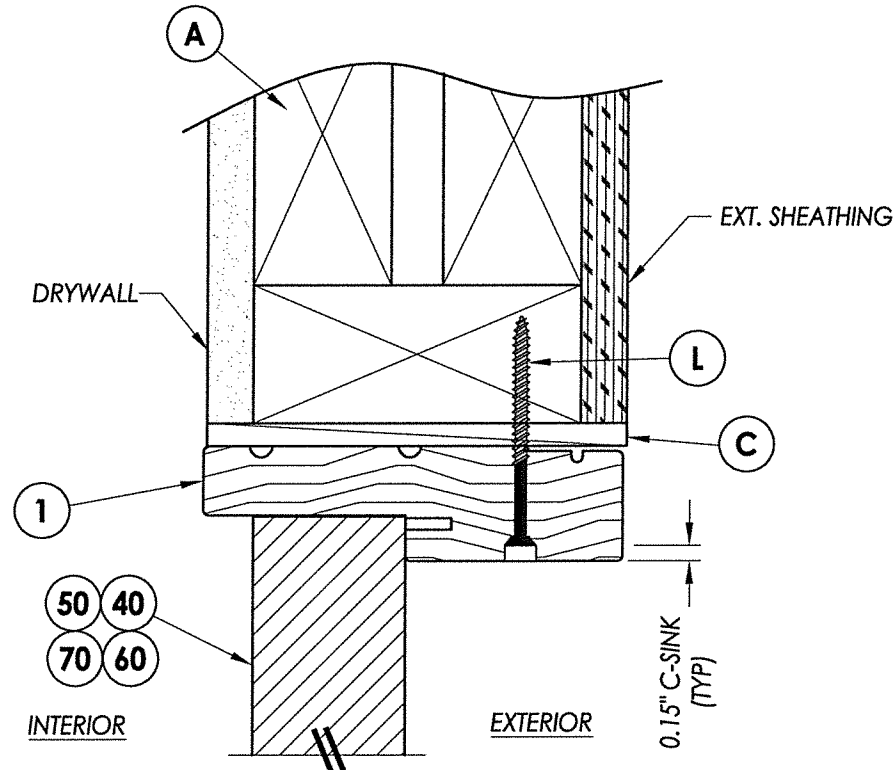


4 VERTICAL CROSS SECTION
6 Outswing Shown (Inswing similar)

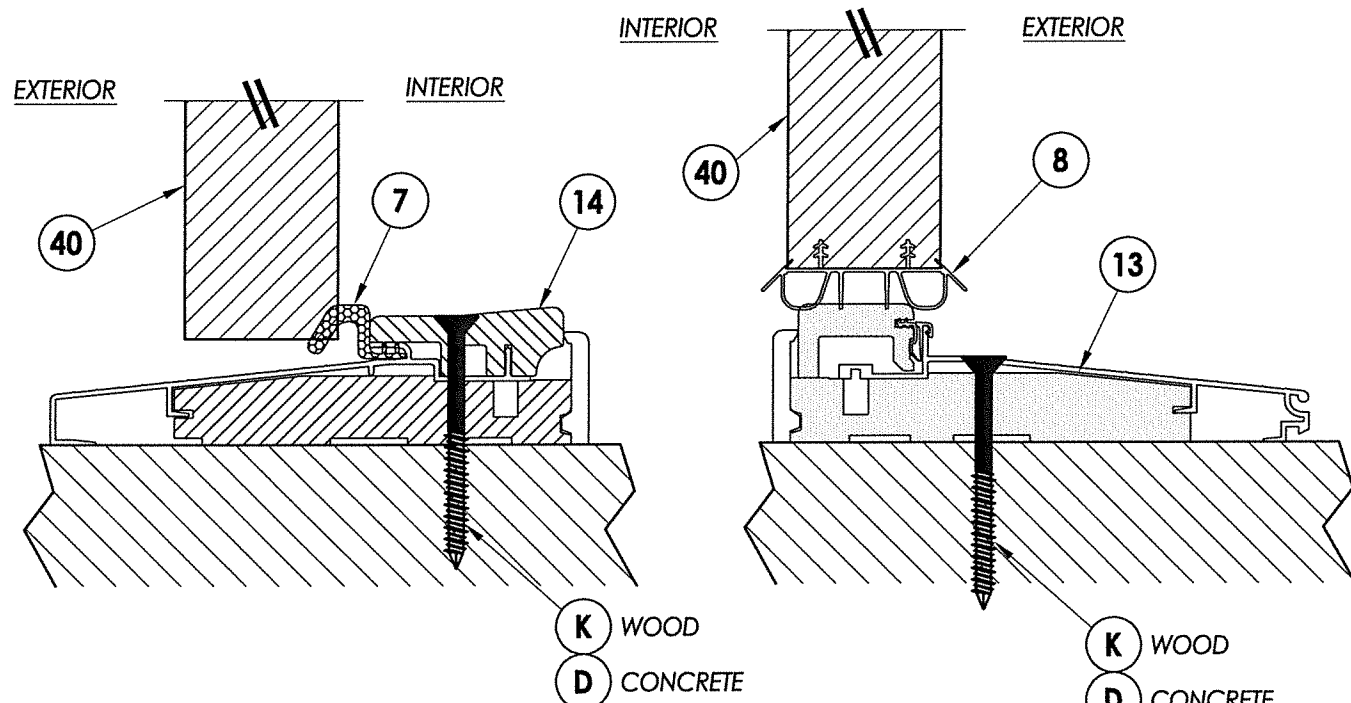


2 VERTICAL CROSS SECTION
6 Outswing Sill

3 VERTICAL CROSS SECTION
6 Inswing Sill

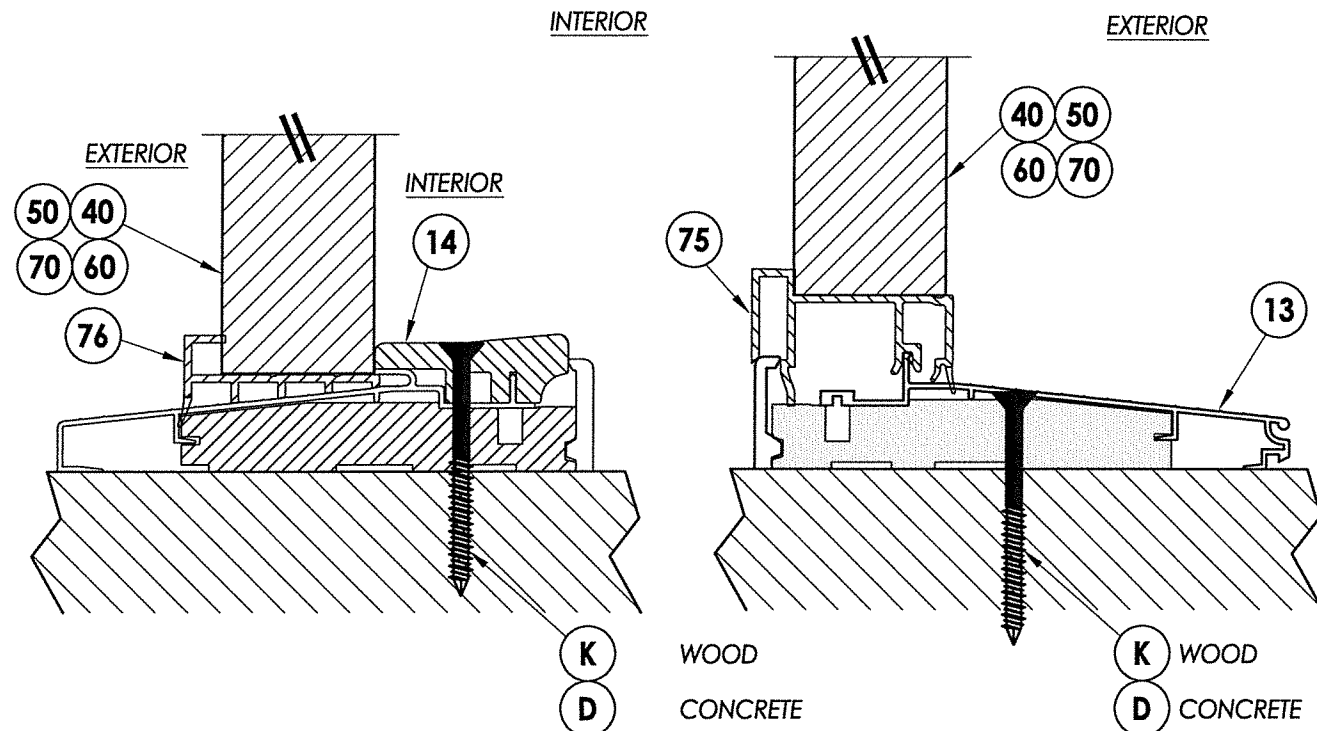

5 VERTICAL CROSS SECTION
6 Outswing Sill

6 VERTICAL CROSS SECTION
6 Inswing Sill

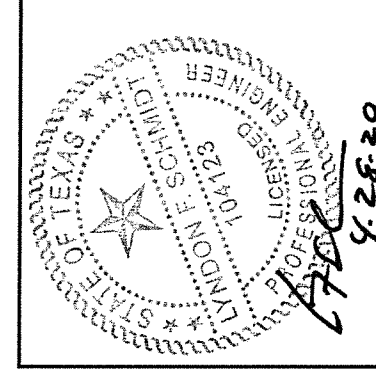

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197












TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: THERMA-TRU
FLUSH GLAZED DOOR

PART OR ASSEMBLY:
VERTICAL
CROSS SECTIONS

NO.	DATE	DESCRIPTION	BY
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE	LFS

DATE: 7/28/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4561
SHEET 6 OF 8

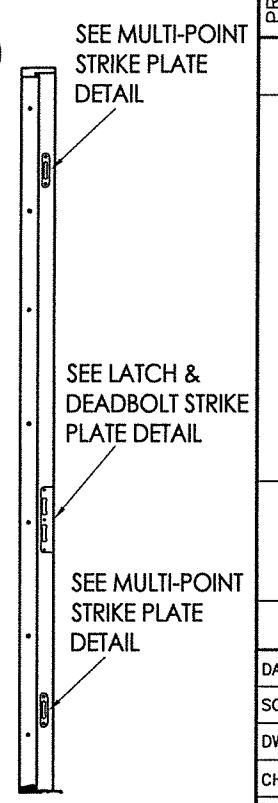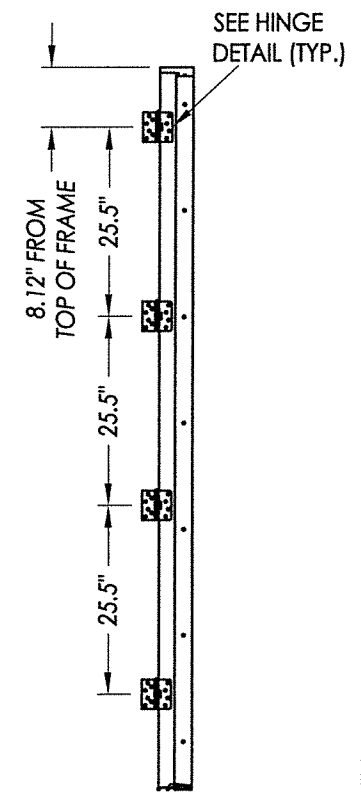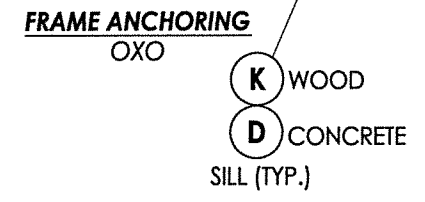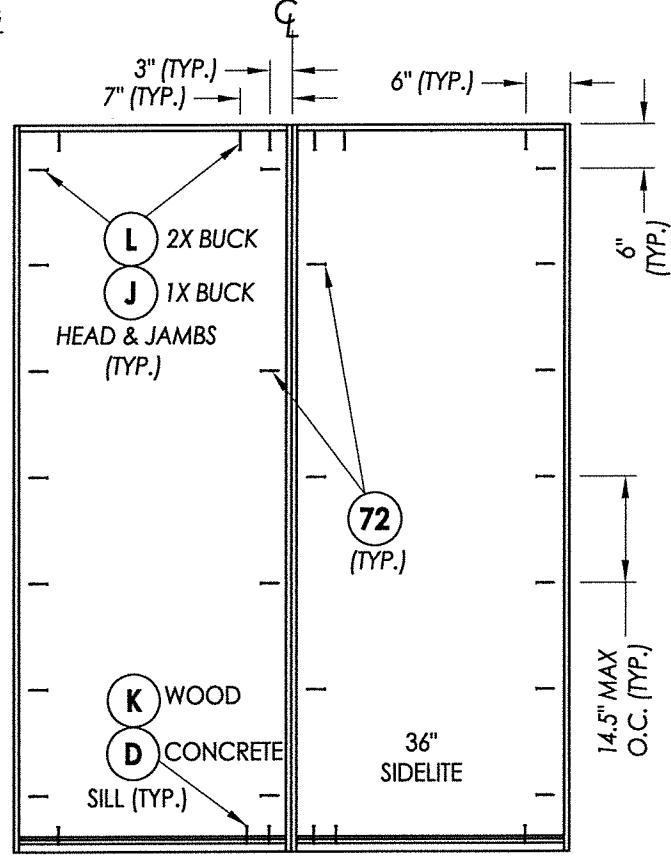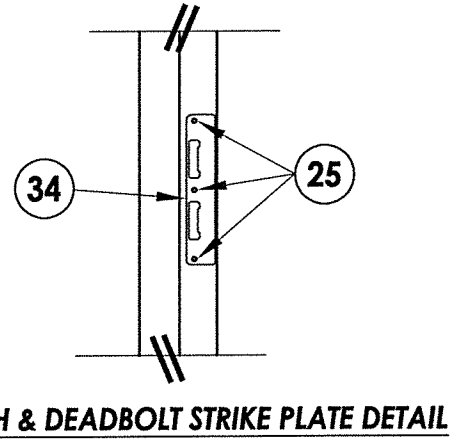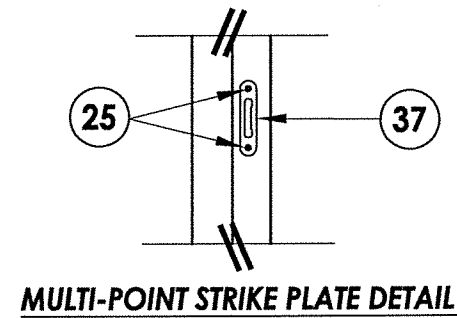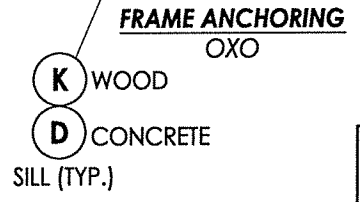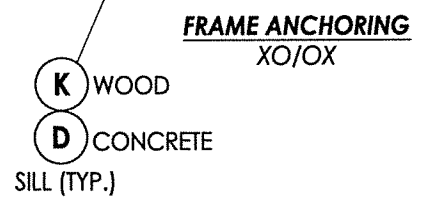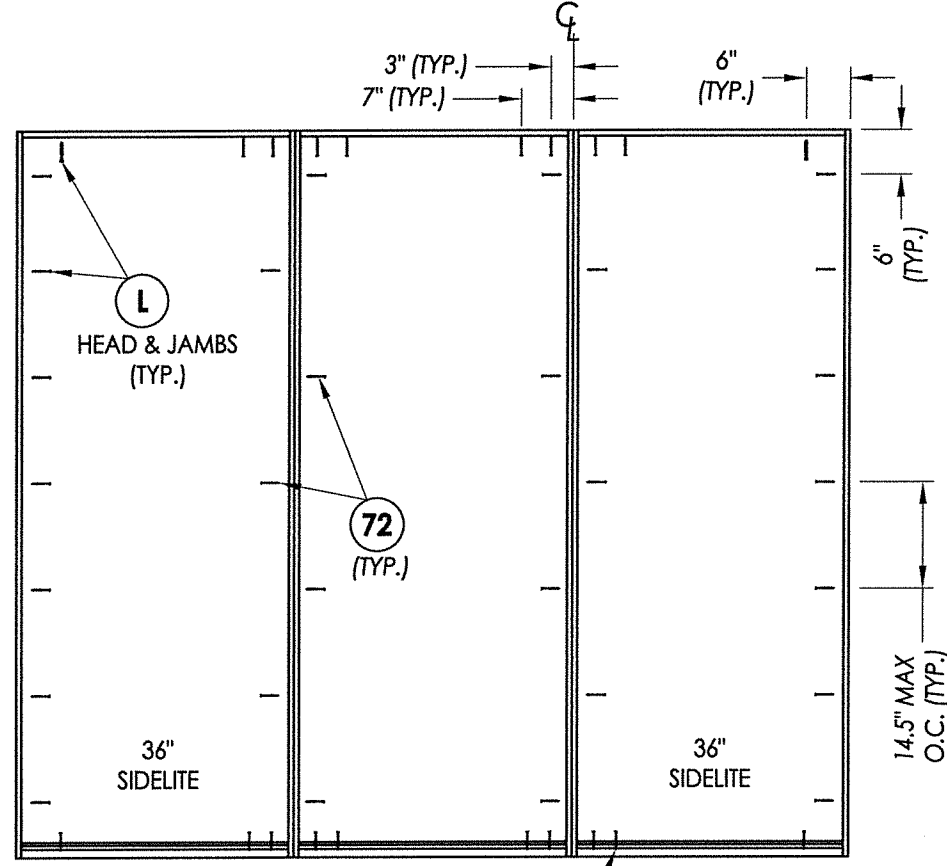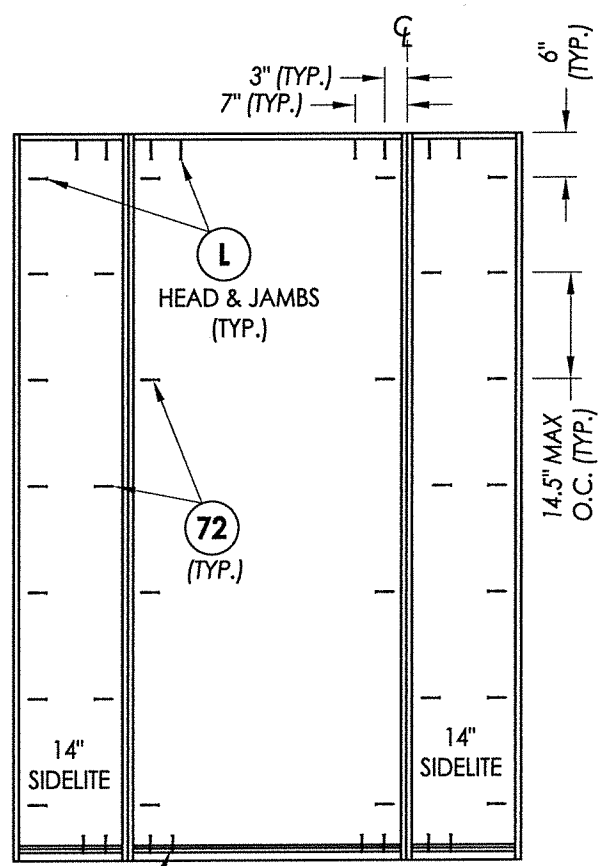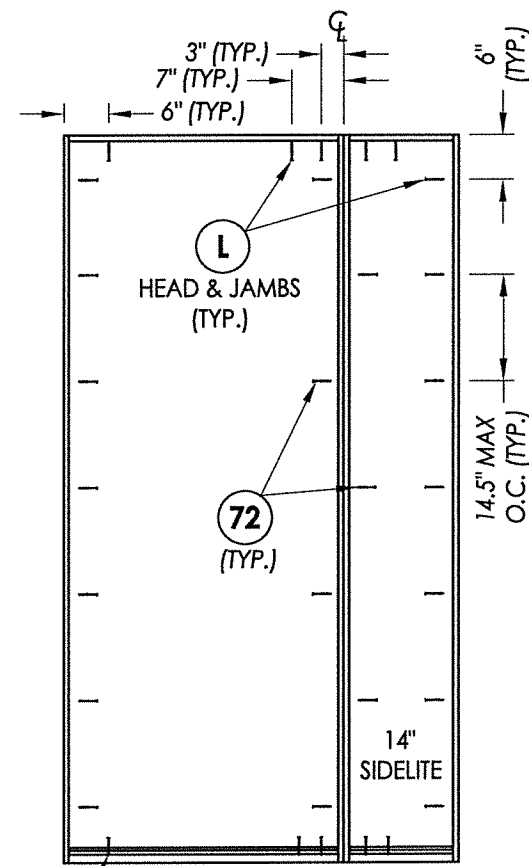


FRAME ANCHORING
2X stud framing
w/ wood/concrete substrate

FRAME ANCHORING
XO/OX

HINGE JAMB

STRIKE JAMB

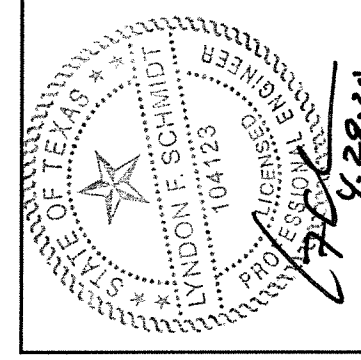

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Vairico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: TAYLOR DOOR STEEL DOOR

PART OR ASSEMBLY: FRAME ANCHORING & HARDWARE DETAILS


NO.	DATE	DESCRIPTION	BY
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE	LFS

DATE: 11/3/14
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4561
SHEET 7 OF 8


R:\Clients\Therma Tru PERMANENT\B - Texas Dept of Ins\TDI - DR 763 - 80 Flush Glazed Classic Craft Door Panels\C - Drawings\TX-4560-62.dwg, 8.2

BILL OF MATERIALS


ITEM #	DESCRIPTION	MATERIAL
A	2X FRAMING (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" PFH ELCO OR ITW CONCRETE SCREW (1-3/4" MIN. EMBEDMENT)	STEEL
K	#10 PFH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
1	JAMB - FINGER JOINTED PINE	WOOD
6	WEATHERSTRIP (Medium Reach by Therma-Tru)	FOAM
7	WEATHERSTRIP (Long Reach by Therma-Tru)	FOAM
8	SWEEP	VINYL
13	INSWING THRESHOLD	ALUM/COMP
14	OUTSWING THRESHOLD	ALUM/COMP
23	#10 x 3/4" PFH WOOD SCREW	STEEL
24	#10 x 1" PFH WOOD SCREW	STEEL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE	STEEL
29	4" X 4" HINGE	STEEL
34	LATCH & DEADBOLT STRIKE PLATE	STEEL
37	MULTI-POINT STRIKE PLATE	STEEL
40	3'-0" DOOR/SIDELITE PANEL - 3/4 LITE (FLUSH GLAZED)	-
50	3'-0" SIDELITE PANEL - FULL LITE (FLUSH GLAZED)	-
60	3'-0" SIDELITE PANEL - FULL LITE (BTS LITE FRAME)	-
70	1'-2" SIDELITE PANEL - FULL LITE (BTS LITE FRAME)	-
72	#10 X 2" PFH WOOD SCREW	STEEL
75	SIDELITE SPACER (INSWING)	PVC
76	SIDELITE SPACER (OUTSWING)	PVC

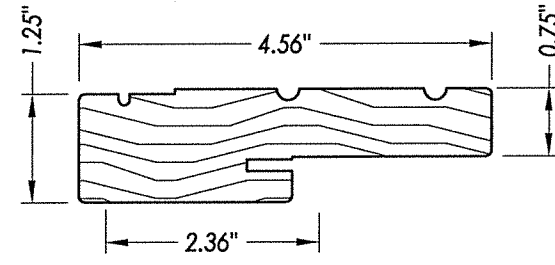


1 WOOD JAMB




8 SWEEP




6 WEATHERSTRIP
Medium Reach




7 WEATHERSTRIP
Long Reach

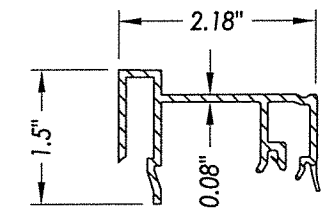


75 SIDELITE SPACER
Inswing

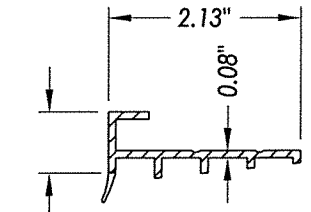


76 SIDELITE SPACER
Outswing

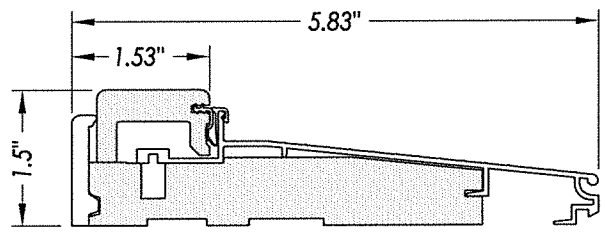

13 INSWING THRESHOLD

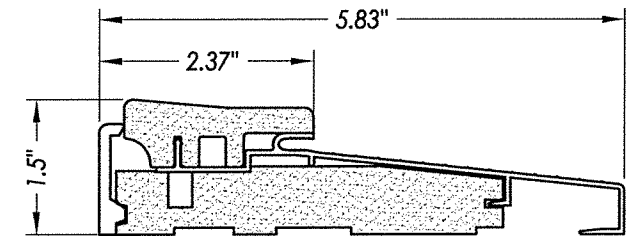

14 OUTSWING THRESHOLD

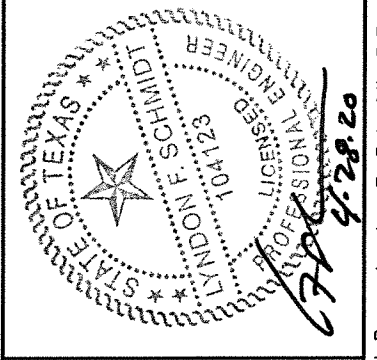

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT:	Therma-Tru FLUSH GLAZED DOOR
PART OR ASSEMBLY:	BILL OF MATERIALS & COMPONENTS

NO.	DATE	DESCRIPTION	BY
1	4/28/20	UPDATE TO 2018 IBC/IRC CODE	LFS

DATE:	7/28/15
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	TX-4561
SHEET	8 OF 8

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-3/4"	2-1/2"	3"
ELCO ULTRACON®	1/4"	1-3/4"	1"	3"

MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90