


**GENERAL NOTES**

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE REQUIREMENTS OF THE 2018 INTERNATIONAL BUILDING CODE AND 2018 INTERNATIONAL RESIDENTIAL CODE.
2. THIS DOCUMENT ADDRESSES ONLY PRODUCT ANCHORAGE TO ACHIEVE THE INDICATED DESIGN PRESSURES AT THE INDICATED SIZES, IN THE CONFIGURATION SHOWN IN THE ELEVATIONS. INSTALL PRODUCTS WITH MAXIMUM SHIM GAP, MINIMUM EDGE DISTANCE AND EMBEDMENT, AND WITH FASTENER TYPE AS SHOWN IN THE DETAILS AND AS INDICATED IN TABLE 1. FOR FULL PRODUCT CONSTRUCTION DETAILS SEE AT/INTERTEK TEST REPORTS C7941.03-501-44-R0, D0979.03-501-44-R1, C8717.02-501-44-R0, AND D1113.02-501-44-R0.
3. THIS PRODUCT AS SHOWN IN THIS DRAWING IS NON-IMPACT RESISTANT AND REQUIRES THE USE OF IMPACT PROTECTIVE DEVICES (SHUTTERS) IN WINDBORNE DEBRIS REGIONS.
4. GLAZING SHALL BE COMPLIANT WITH ASTM E-1300.
5. THE 4/3 ALLOWABLE STRESS INCREASE FACTOR (SHORT-TERM INCREASE FACTOR) HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM. THE 1.6 Cd FACTOR WAS USED IN THE ANALYSIS OF ANCHORAGE INTO WOOD SUBSTRATE.
6. THE OPENING SUBSTRATE MATERIALS (FRAMING, MASONRY, BUCKS) AND ATTACHMENT OF BUCKS TO THE SUBSTRATE ARE BY OTHERS AND SHALL BE VERIFIED BY THE ARCHITECT OR ENGINEER OF RECORD OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION (AHJ). BUCKING, OPENINGS, & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED BY OTHERS IN ACCORDANCE WITH THE FBC TO TRANSFER SUPERIMPOSED LOADS TO THE STRUCTURE. WITH MASONRY OPENINGS, WOOD BUCKS ARE OPTIONAL.
7. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE COATED OR OTHERWISE PROTECTED TO PREVENT GALVANIC REACTIONS. WOOD BUCKS, IF USED, SHALL BE PRESSURE TREATED, WITH EITHER A TREATMENT OR COATING COMPATIBLE WITH THIS PRODUCT.
8. ANCHORAGE NOTES: ALL ANCHORS USED SHALL BE OF A MATERIAL OR HAVE A COATING COMPATIBLE WITH THE PRESSURE TREATED WOOD BUCKS AND ALL OTHER WINDOW MATERIALS. INSTALL ONE ANCHOR AT EACH LOCATION SHOWN IN THE ELEVATION. INSTALL SHIMS AT EACH ANCHOR LOCATION WHERE A GAP OF 1/16" OR GREATER EXISTS BETWEEN PRODUCT FRAME AND SUBSTRATE. SHIMS SHALL BE LOAD-BEARING (PLASTIC OR METALLIC) AND CAPABLE OF TRANSFERRING LOADS TO SUBSTRATE. SPECIFIED ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL FINISH OR STUCCO. FOR MASONRY WITH WOOD BUCKS LESS THAN 1-1/2" THICK EMBEDMENT SHALL BE BEYOND WOOD BUCKS AND INTO MASONRY. WOOD BUCKS 1-1/2" THICK OR GREATER SHALL HAVE EMBEDMENT INTO THE WOOD BUCKS.
9. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS, OR AS APPROVED, SIGNED, AND SEALED BY A TEXAS-REGISTERED PROFESSIONAL ENGINEER ON A SITE-SPECIFIC BASIS.
10. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT SHALL BE THE RESPONSIBILITY OF OTHERS AND ARE NOT ADDRESSED BY THIS DOCUMENT.

**CAMELOT SLIDING GLASS DOOR OXO**

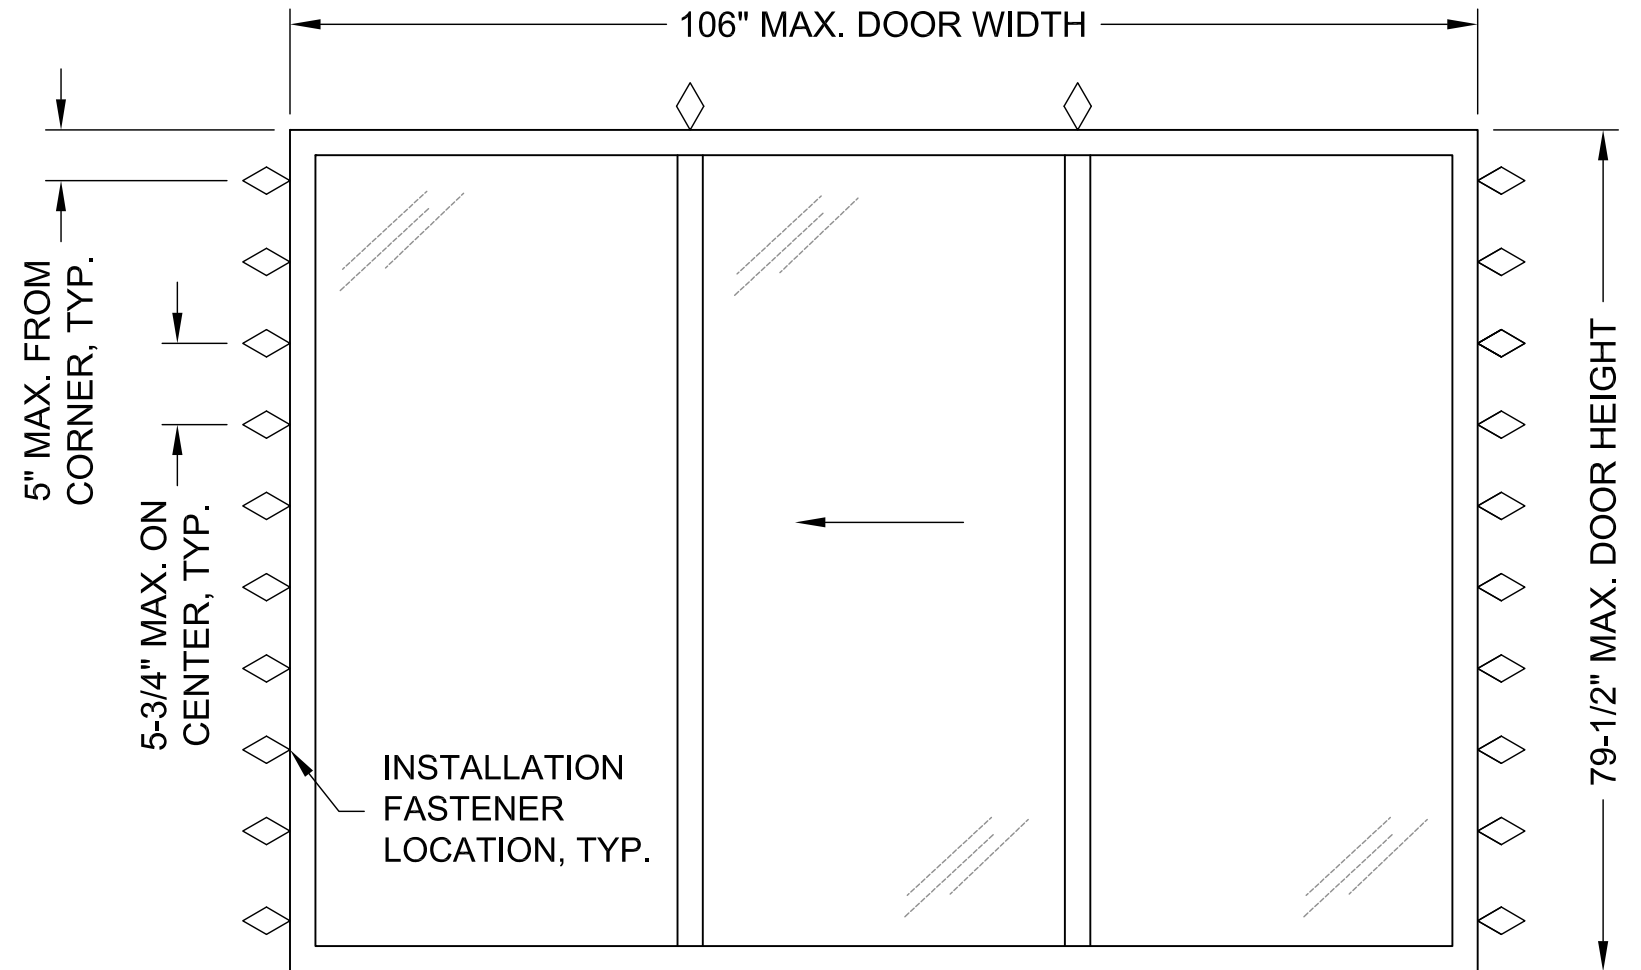

**REPLACEMENT ELEVATION  
SEE DETAILS SHEET 3**


| OXO FRAME TYPE | MAX. SIZE      | DESIGN PRESSURE RATING |
|----------------|----------------|------------------------|
| REPLACEMENT    | 106" X 79-1/2" | +40/-50 PSF            |

|   |                           |
|---|---------------------------|
| <b>NORTHEAST BUILDING PRODUCTS</b>  |                           |
| 4280 Aramingo Ave., Philadelphia, PA 19124<br>Ph. (215) 535-7110 www.camelotwindows.com |                           |
| SHEET DESCRIPTION:<br>NOTES, ELEVATION  | DATE DRAWN:<br>12/21/2015 |
| SCALE: NTS  | REV: A                    |
| DRAWING: TDI-CAMELOT-SGD  | SHEET: 1 OF 4             |
| REV A, 9/29/20: UPDATE TO 2018 IBC/IRC  |                           |




9/29/2020  
Lucas A. Turner, P.E.  
TX PE #115094  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
Ph. 941-380-1574

# CAMELOT SLIDING GLASS DOOR OX OR XO

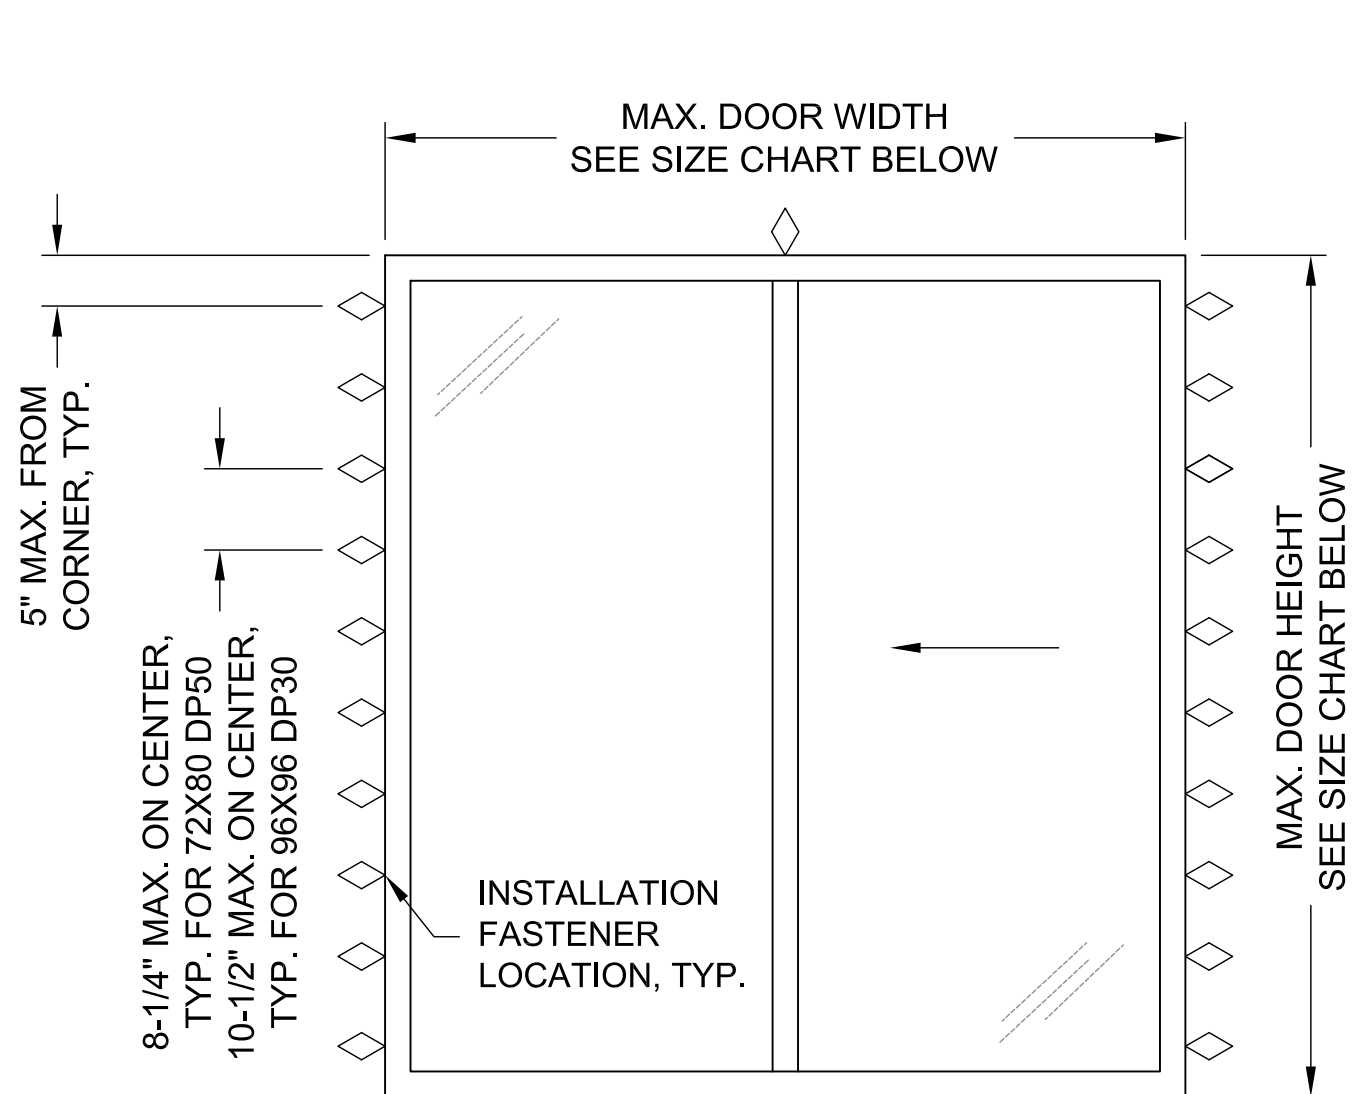

**REPLACEMENT ELEVATION**  
**SEE DETAILS SHEET 3**

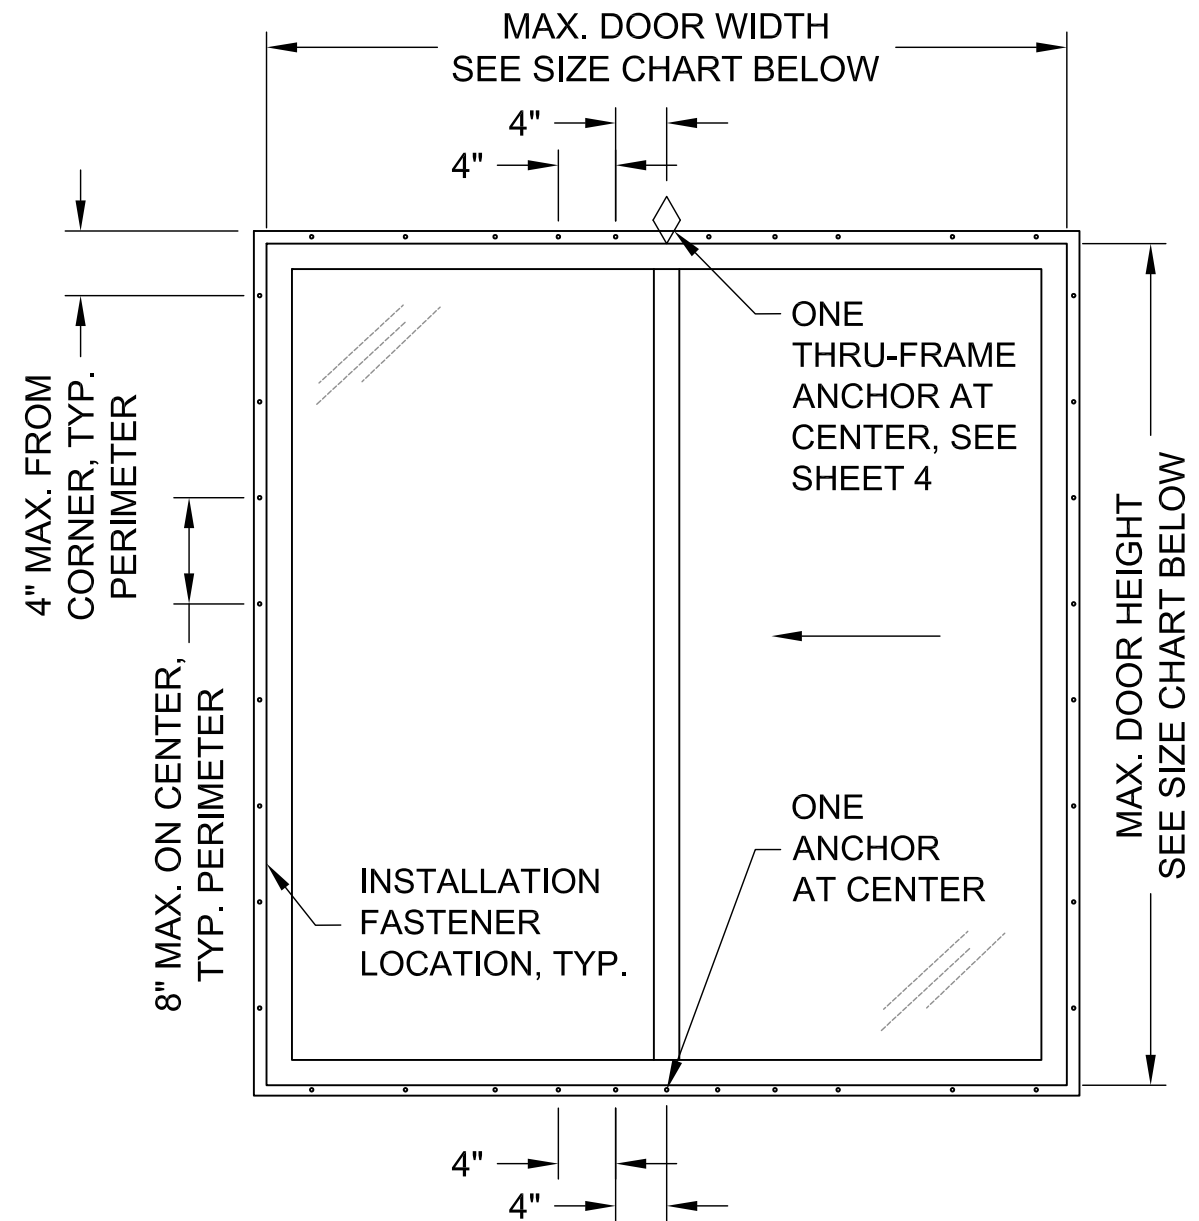

**NEW CONSTRUCTION ELEVATION**  
**SEE DETAILS SHEET 4**

| OX OR XO FRAME TYPE | MAX. SIZE         | DESIGN PRESSURE RATING |
|---------------------|-------------------|------------------------|
| NEW CONSTRUCTION    | 71-1/2" X 79-1/2" | +50/-55 PSF            |
| REPLACEMENT         | 71-1/2" X 79-1/2" | +50/-55 PSF            |
| NEW CONSTRUCTION    | 96" X 96"         | +/-25 PSF              |
| REPLACEMENT         | 96" X 96"         | +/-30 PSF              |


**NORTHEAST BUILDING PRODUCTS**  
4280 Aramingo Ave., Philadelphia, PA 19124  
Ph. (215) 535-7110 www.camelotwindows.com

|  |                           |
|--|---------------------------|
| SHEET DESCRIPTION:<br>ELEVATIONS       | DATE DRAWN:<br>12/21/2015 |
| SCALE: NTS                             | REV: A                    |
| DRAWING: TDI-CAMELOT-SGD               | SHEET: 2 OF 4             |
| REV A, 9/29/20: UPDATE TO 2018 IBC/IRC |                           |




9/29/2020  
Lucas A. Turner, P.E.  
TX PE #115094  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
Ph. 941-380-1574

# CAMELOT SLIDING GLASS DOOR, REPLACEMENT

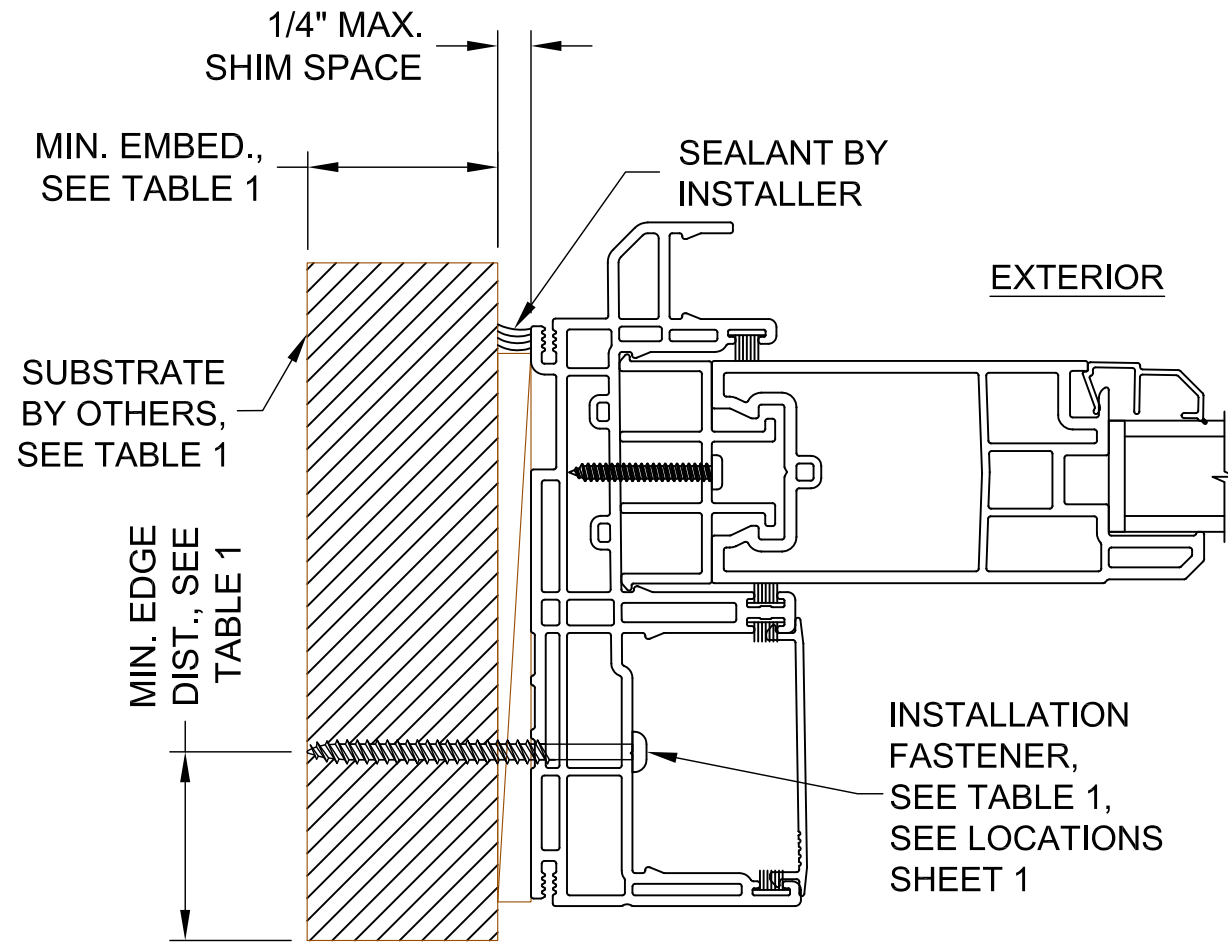

**TYPICAL JAMB HORIZONTAL SECTION**  
(FIXED JAMB SHOWN, LOCK JAMB ANCHORAGE SIMILAR)

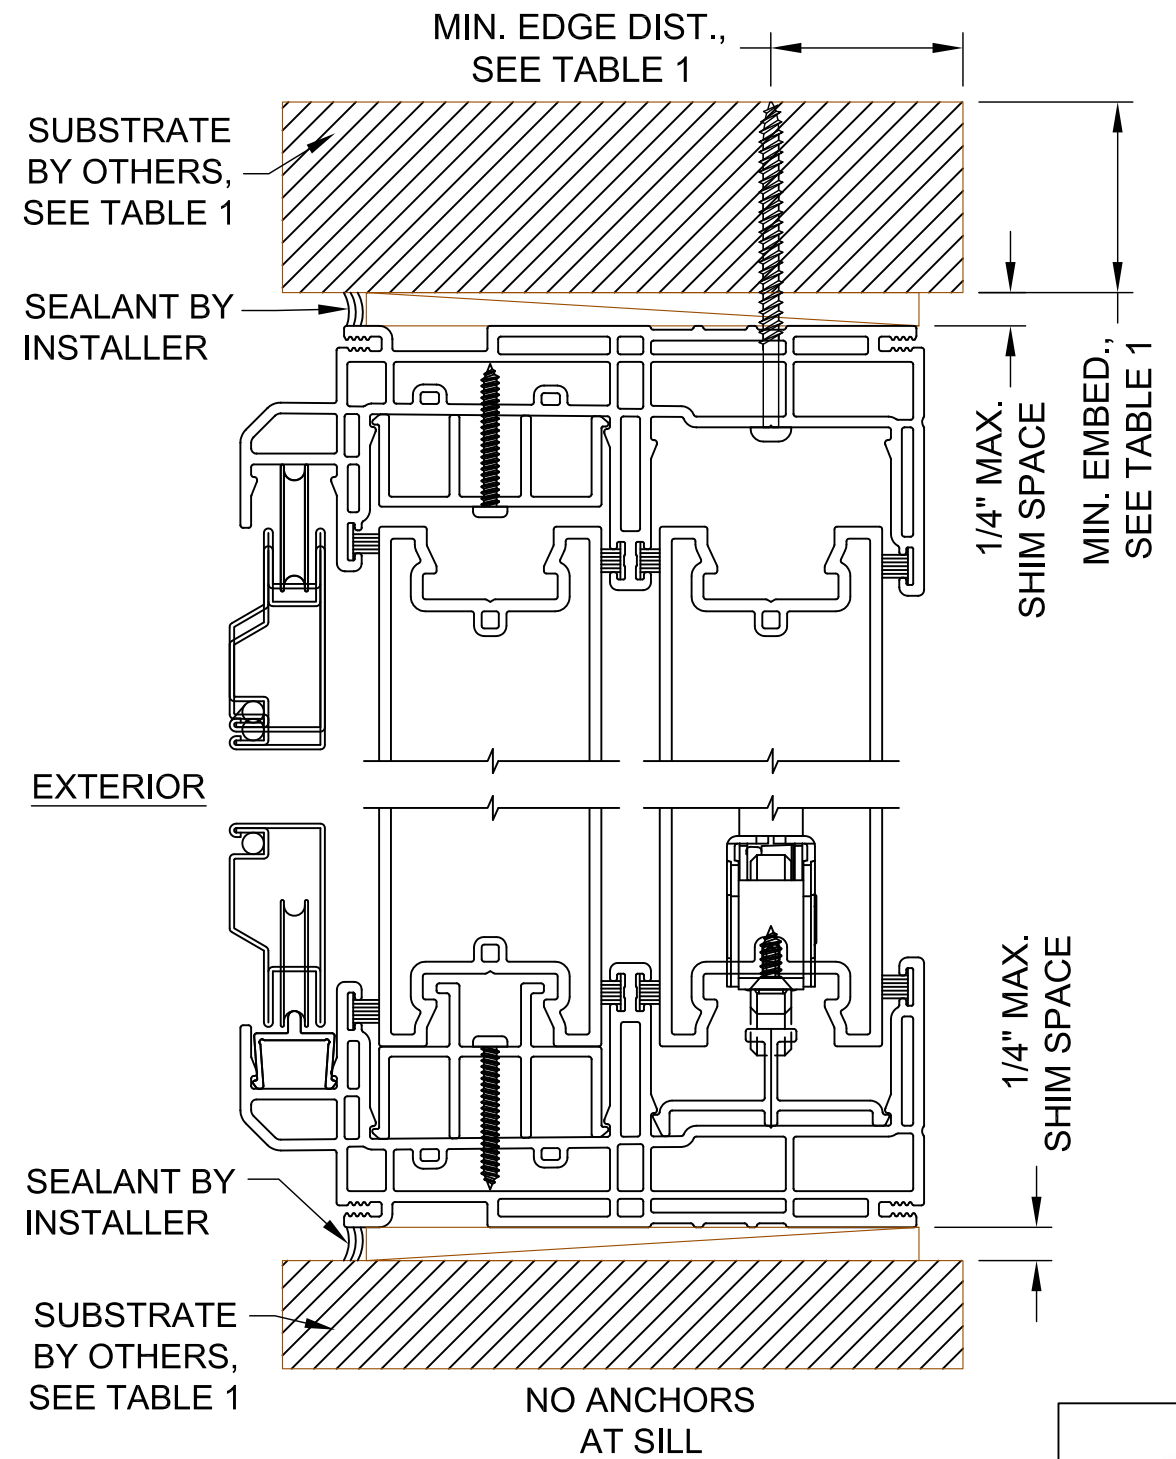

**TYPICAL FRAME VERTICAL SECTION**

TABLE 1: REPLACEMENT FRAME INSTALLATION ANCHOR REQUIREMENTS TABLE

| SUBSTRATE TYPE  | ANCHOR TYPE  | MIN. EMBED. | MIN. EDGE DIST. |
|---|--|-------------|-----------------|
| CONCRETE (2.0 KSI MIN)  | 3/16" ITW TAPCON                                       | 1"          | 1 1/8"          |
| HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)                                       | 3/16" ITW TAPCON                                       | 1"          | 2"              |
| CONCRETE (2.85 KSI MIN.)  | 3/16" ELCO ULTRACON                                    | 1"          | 1"              |
| HOLLOW OR GROUT-FILLED CMU (ASTM C90)   | 3/16" ELCO ULTRACON                                    | 1-1/4"      | 2 1/2"          |
| 2X MIN. SPRUCE-PINE-FIR WOOD (G=0.42)   | #8 WOOD SCREW  | 1-3/8"      | 1"              |
| 16 GAUGE (0.060") MIN. STEEL STUD, 33KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN. | #10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW | FULL        | 1/2"            |


**NORTHEAST BUILDING PRODUCTS**  
4280 Aramingo Ave., Philadelphia, PA 19124  
Ph. (215) 535-7110 www.camelotwindows.com

|  |                           |
|--|---------------------------|
| SHEET DESCRIPTION:<br>REPLACEMENT INSTALLATION | DATE DRAWN:<br>12/21/2015 |
| SCALE: NTS                                     | REV: A                    |
| DRAWING: TDI-CAMELOT-SGD                       | SHEET: 3 OF 4             |
| REV A, 9/29/20: UPDATE TO 2018 IBC/IRC         |                           |




9/29/2020  
Lucas A. Turner, P.E.  
TX PE #115094  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
Ph. 941-380-1574

# CAMELOT SLIDING GLASS DOOR, NEW CONSTRUCTION

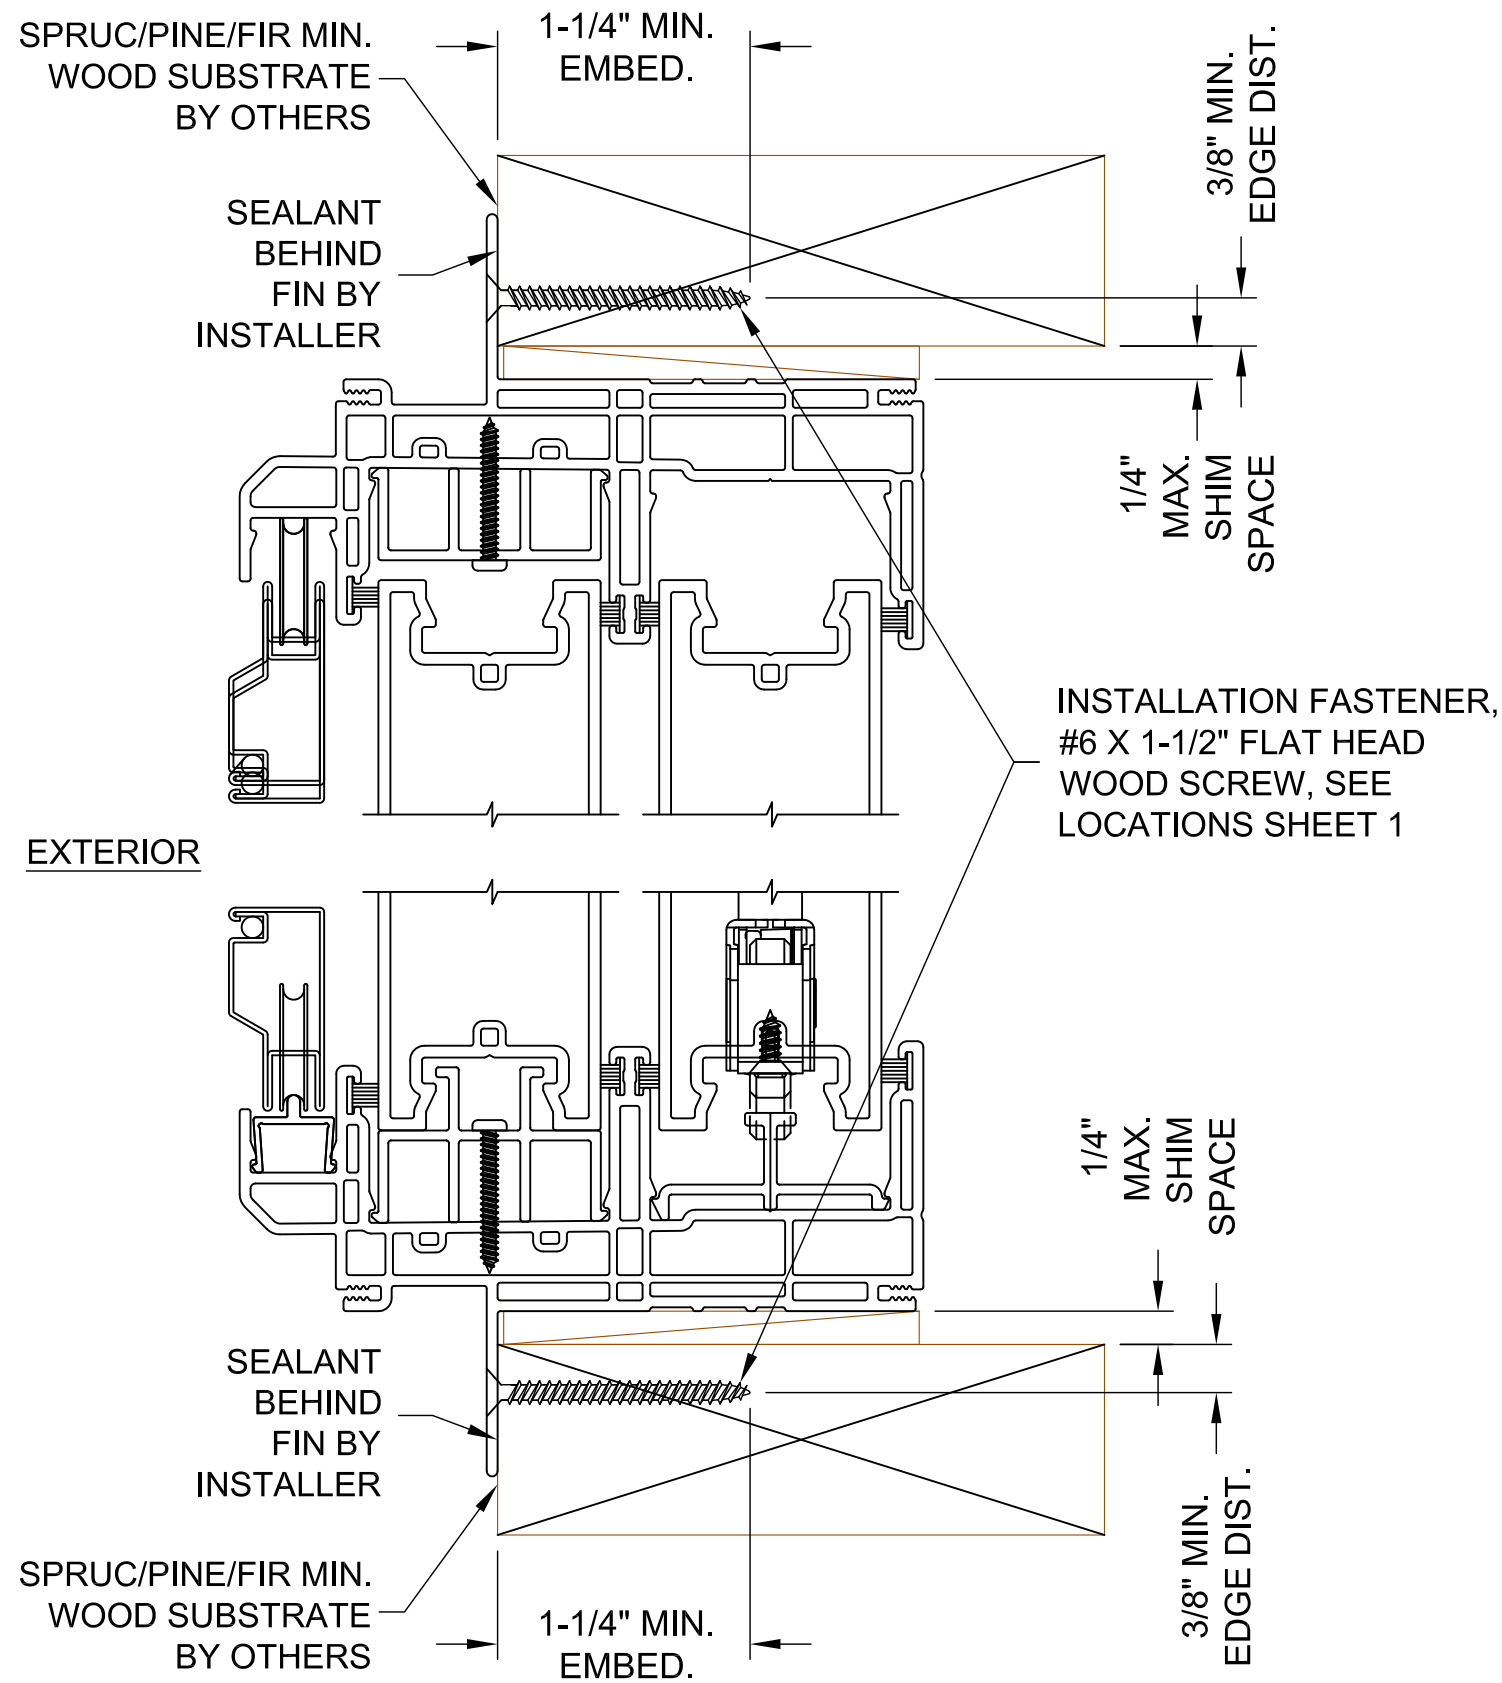

**TYPICAL FRAME VERTICAL SECTION**

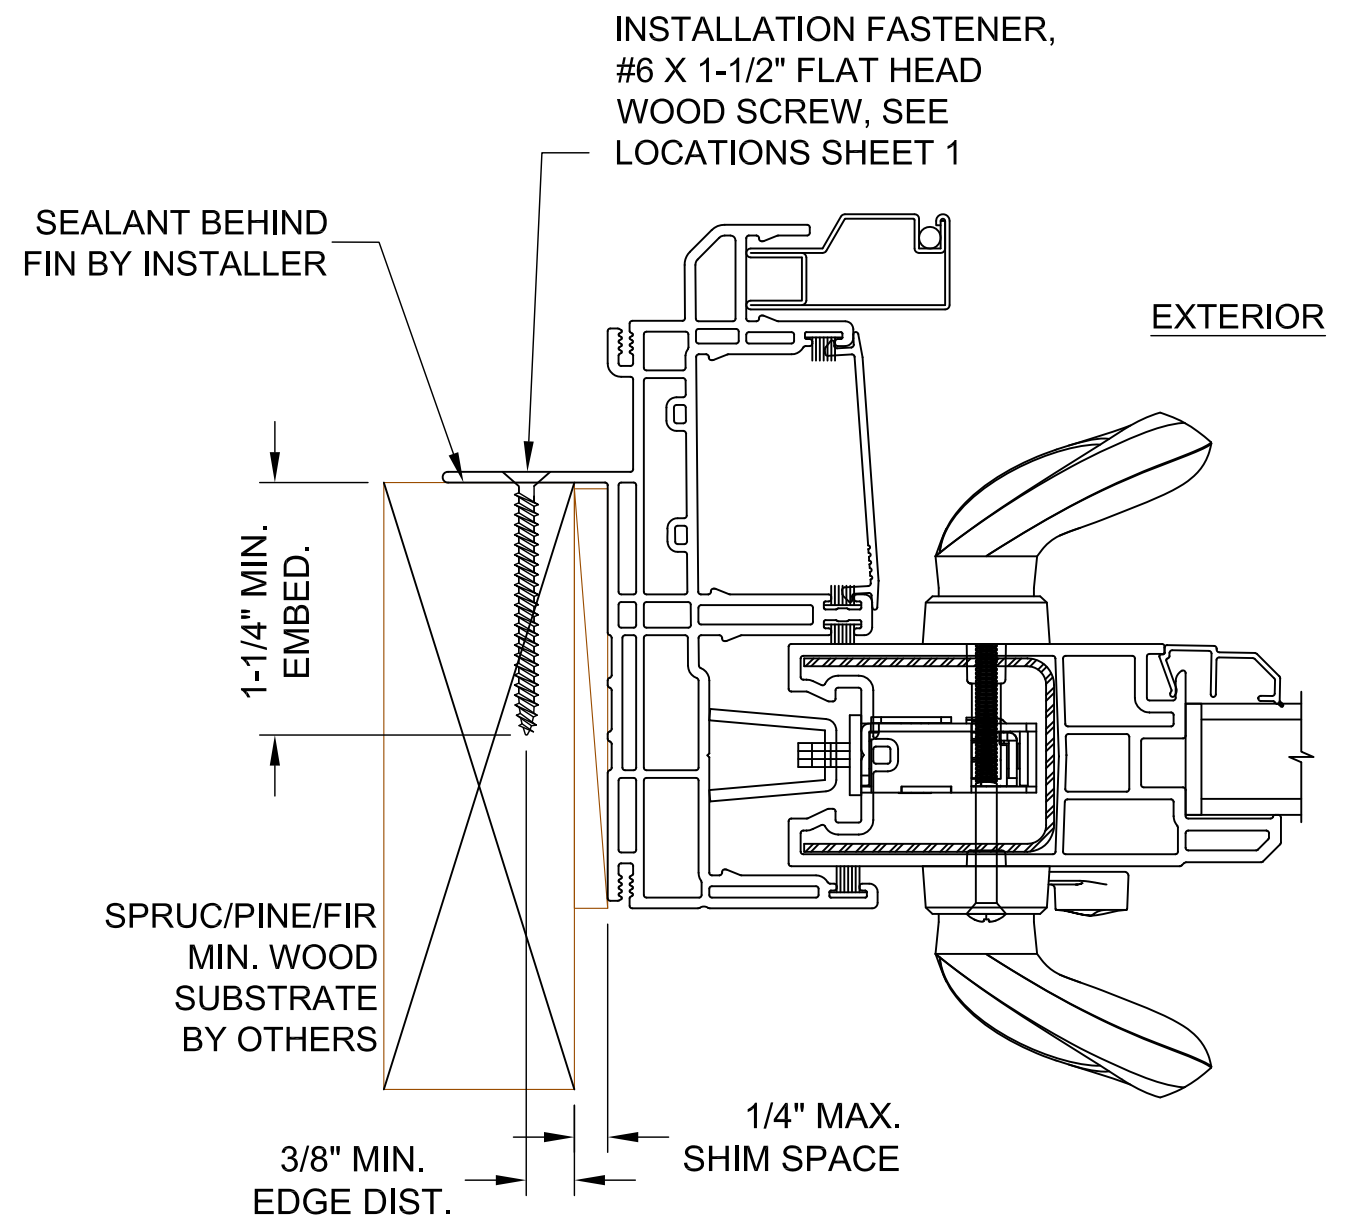

**TYPICAL JAMB HORIZONTAL SECTION**  
(LOCK JAMB SHOWN, FIXED JAMB ANCHORAGE SIMILAR)

**NORTHEAST BUILDING PRODUCTS**  
4280 Aramingo Ave., Philadelphia, PA 19124  
Ph. (215) 535-7110 www.camelotwindows.com

|  |                           |
|--|---------------------------|
| SHEET DESCRIPTION:<br>NEW CONSTR. INSTALLATION | DATE DRAWN:<br>12/21/2015 |
| SCALE: NTS                                     | REV: A                    |
| DRAWING: TDI-CAMELOT-SGD                       | SHEET: 4 OF 4             |
| REV A, 9/29/20: UPDATE TO 2018 IBC/IRC         |                           |



9/29/2020  
Lucas A. Turner, P.E.  
TX PE #115094  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
Ph. 941-380-1574