
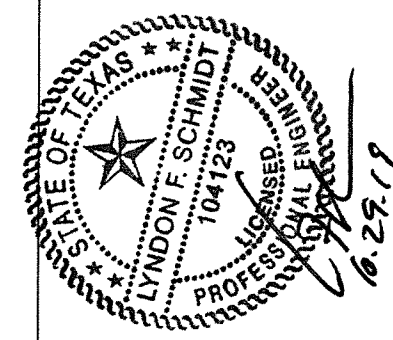


Opaque Steel Door

"NON-IMPACT"
INSWING / OUTSWING

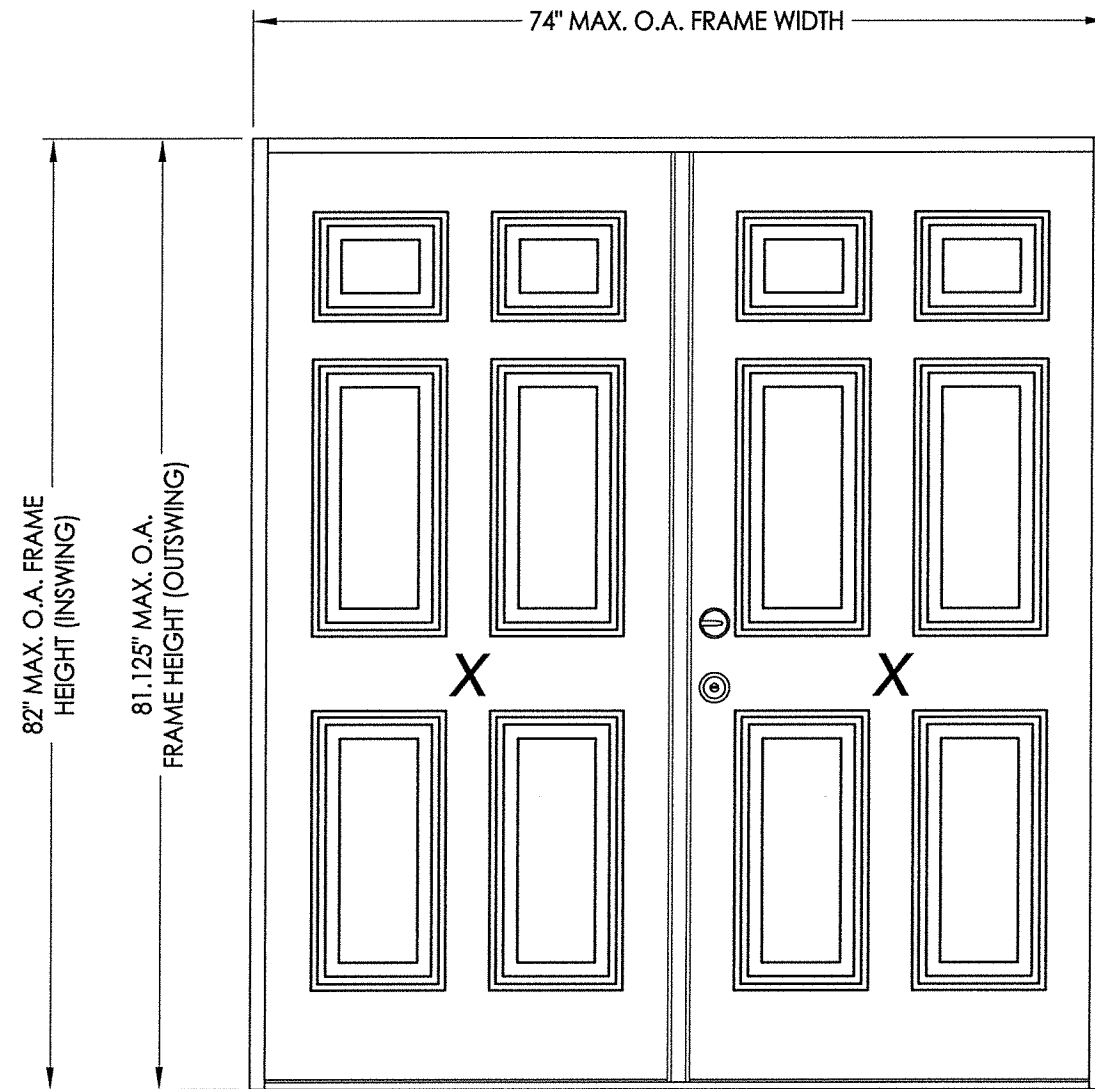

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

EVALUATED FOR USE IN THE STATE OF TEXAS


The Steel Door system described herein complies with the 2018 International Residential Code (IRC), Sections R301 & R609 and the 2018 International Building Code (IBC), Sections 1404.13, 1609, 1709.5, 2403 and 2404 subject to the following conditions:

1. Anchors shall be as listed and spaced as shown in the details. Anchor embedment to base material shall be beyond wall dressing or stucco.
2. When used in areas requiring wind-borne debris protection this product is required to be protected with an impact resistant covering that complies with Section R301.2.1.2 of the IRC and Section 1609.2 of the IBC.
3. Allowable design pressure requirements must be equal to or less than the design pressure rating shown in the design pressure chart, sheet 1 of this drawing.
4. Conditions not covered by this drawing are subject to further engineering analysis.





TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Astragal details (Ultimate Multipoint)
3	Astragal details (Ultimate Hurricane)
4	Door panel details
5	Horizontal & vertical cross sections
6	Vertical cross sections
7	Frame anchoring

CONFIG.	FRAME TYPE	MODEL	DESIGN PRESSURE (PSF) ULTIMATE HURRICANE ASTRAGAL		DESIGN PRESSURE (PSF) ULTIMATE MULTIPOINT ASTRAGAL	
			POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX	PINE	INSWING	+50.0	-50.0	+50.0	-50.0
XX		OUTSWING	+55.0	-55.0	+45.0	-45.0
XX	"FusionFrame"	INSWING	+50.0	-50.0	+50.0	-50.0
XX		OUTSWING	+50.0	-50.0	+45.0	-45.0

PRODUCT:	ENDURA
PART OR ASSEMBLY:	TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES
DATE:	11/08/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	TX-4653
SHEET	1 OF 7

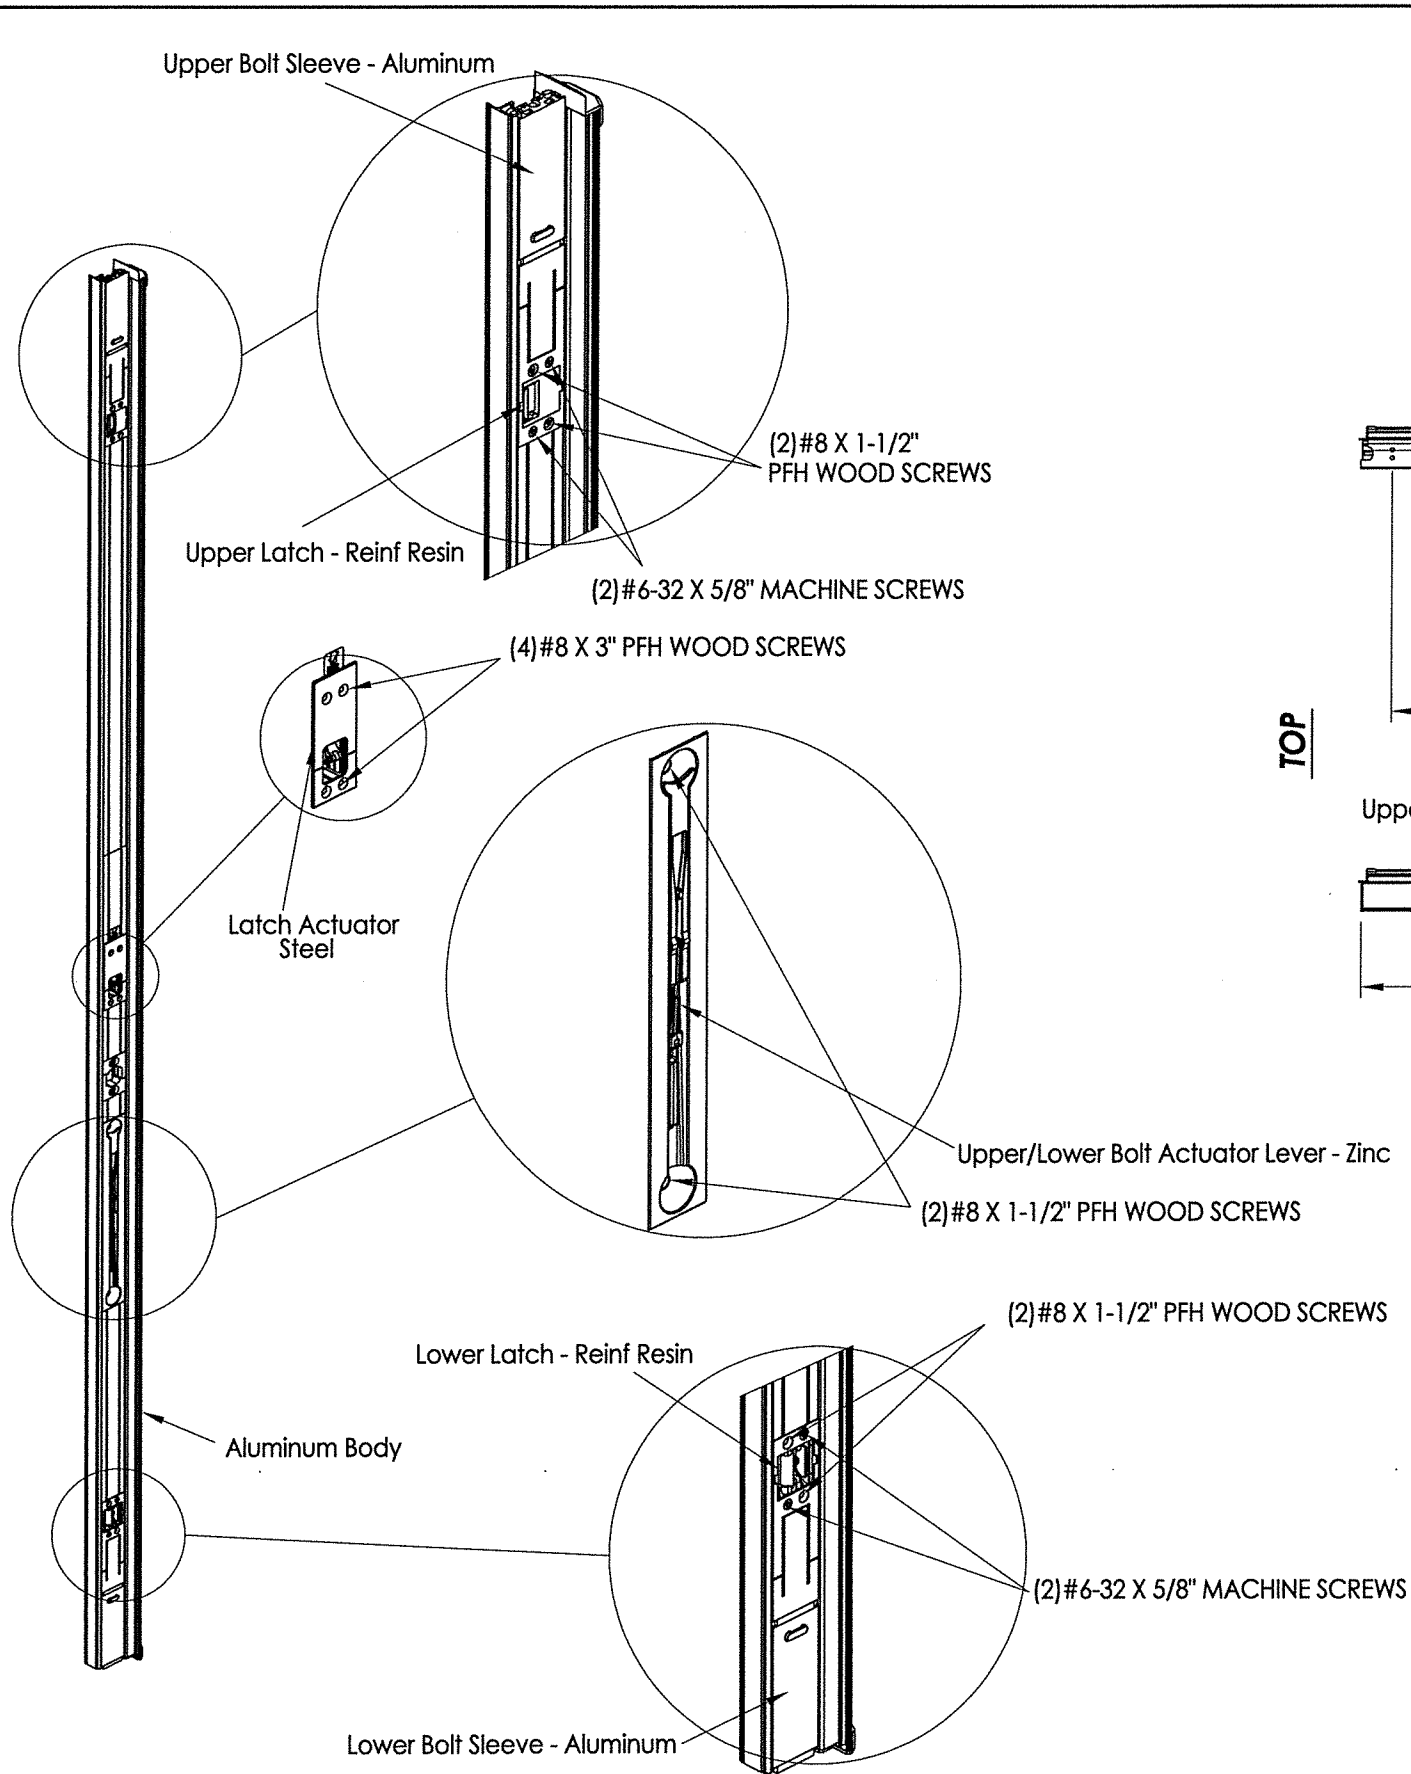

ULTIMATE MULTIPOINT ASTRAGAL

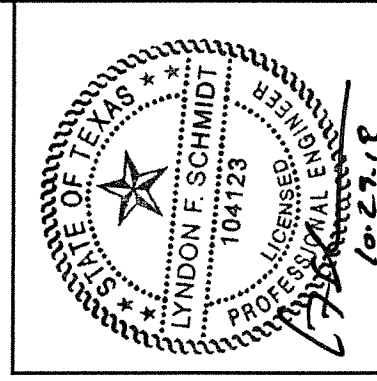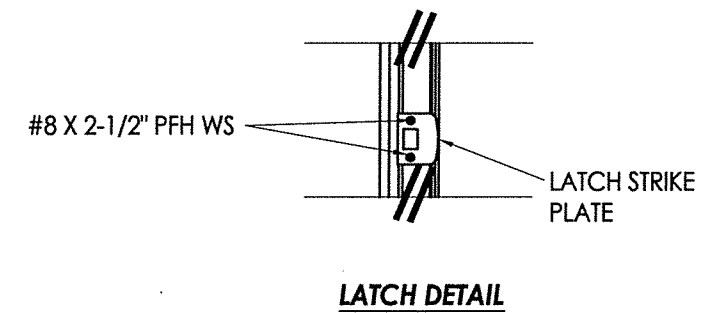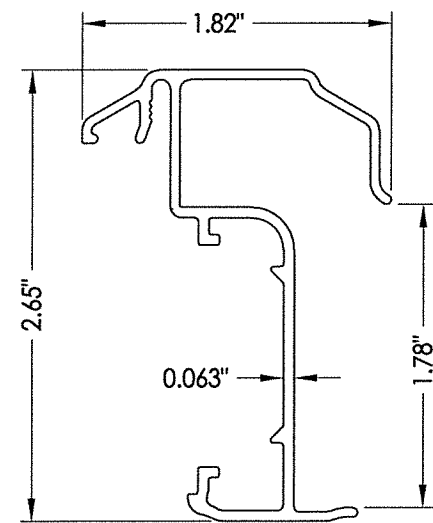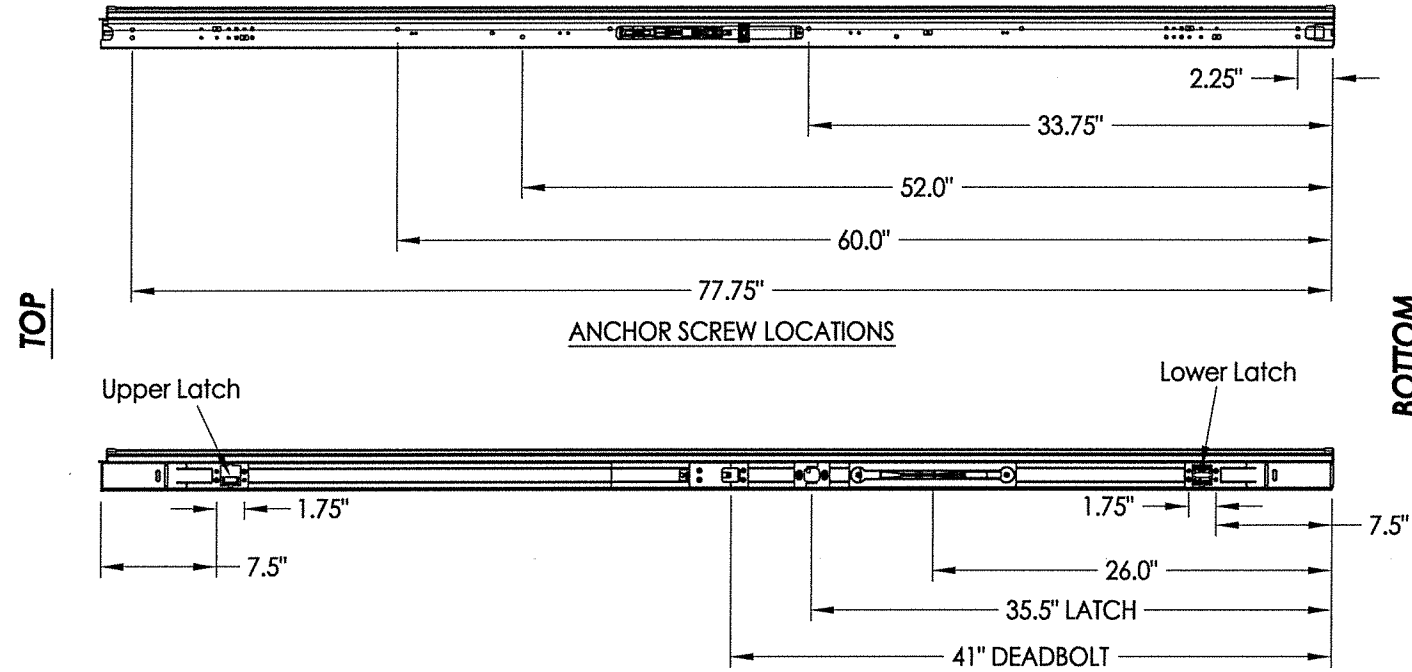

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. # 104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: ENDURA

PART OR ASSEMBLY: ASTRAGAL DETAILS (ULTIMATE MULTI-POINT)

NO.	DATE	REVISIONS	BY
2	10/28/19	ADD "FusionFrame" OPTION & UPDATE TO 2018 IBC/IRC CODE	LFS
1	10/03/18	UPDATE FOR NEW TESTING	LFS

DATE: 11/08/16







SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: TX-4653

SHEET 2 OF 7

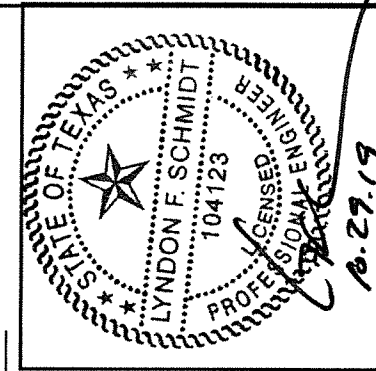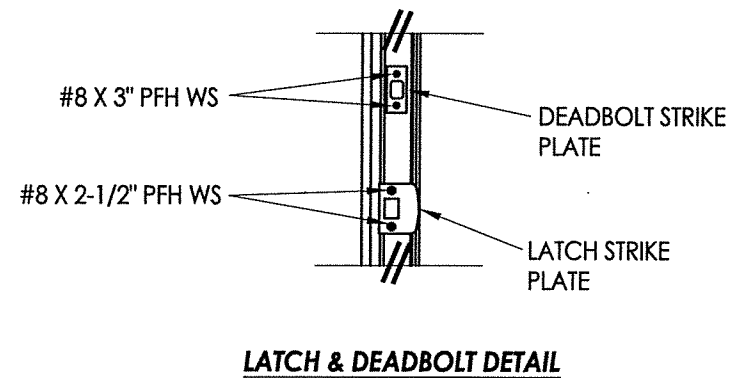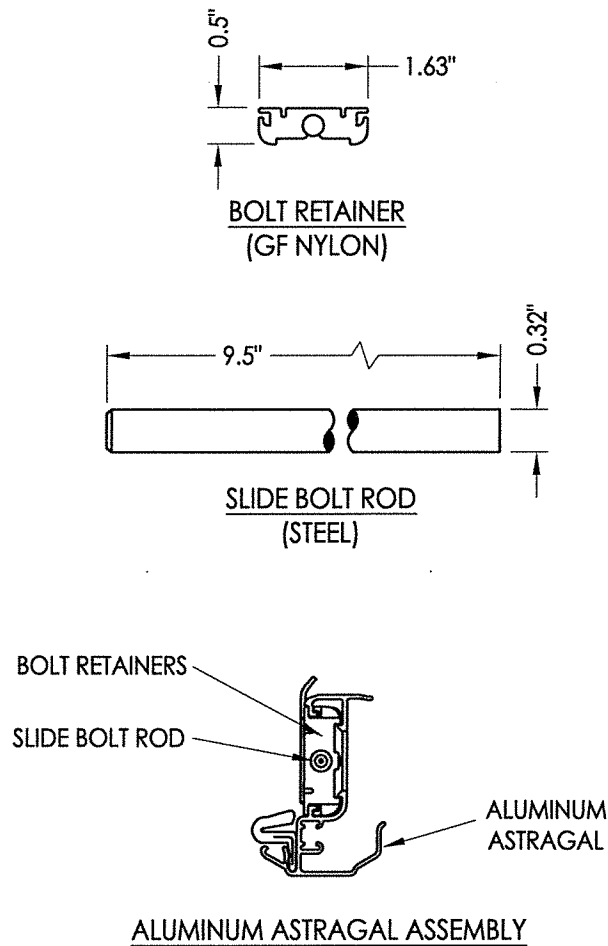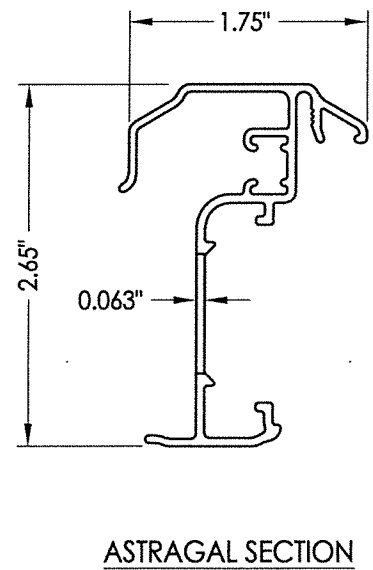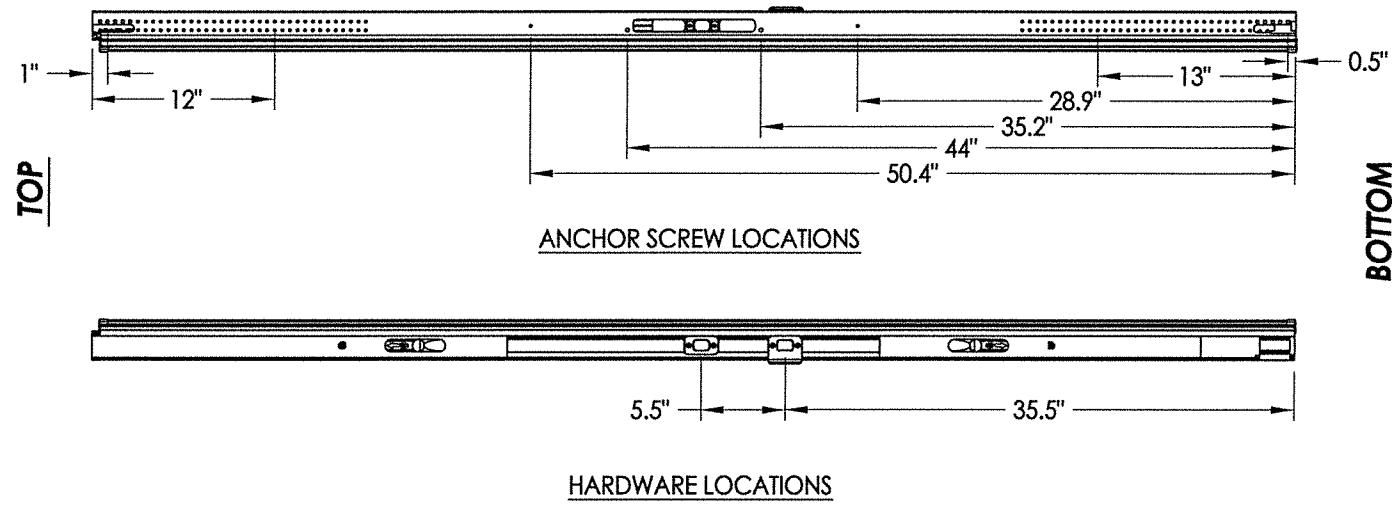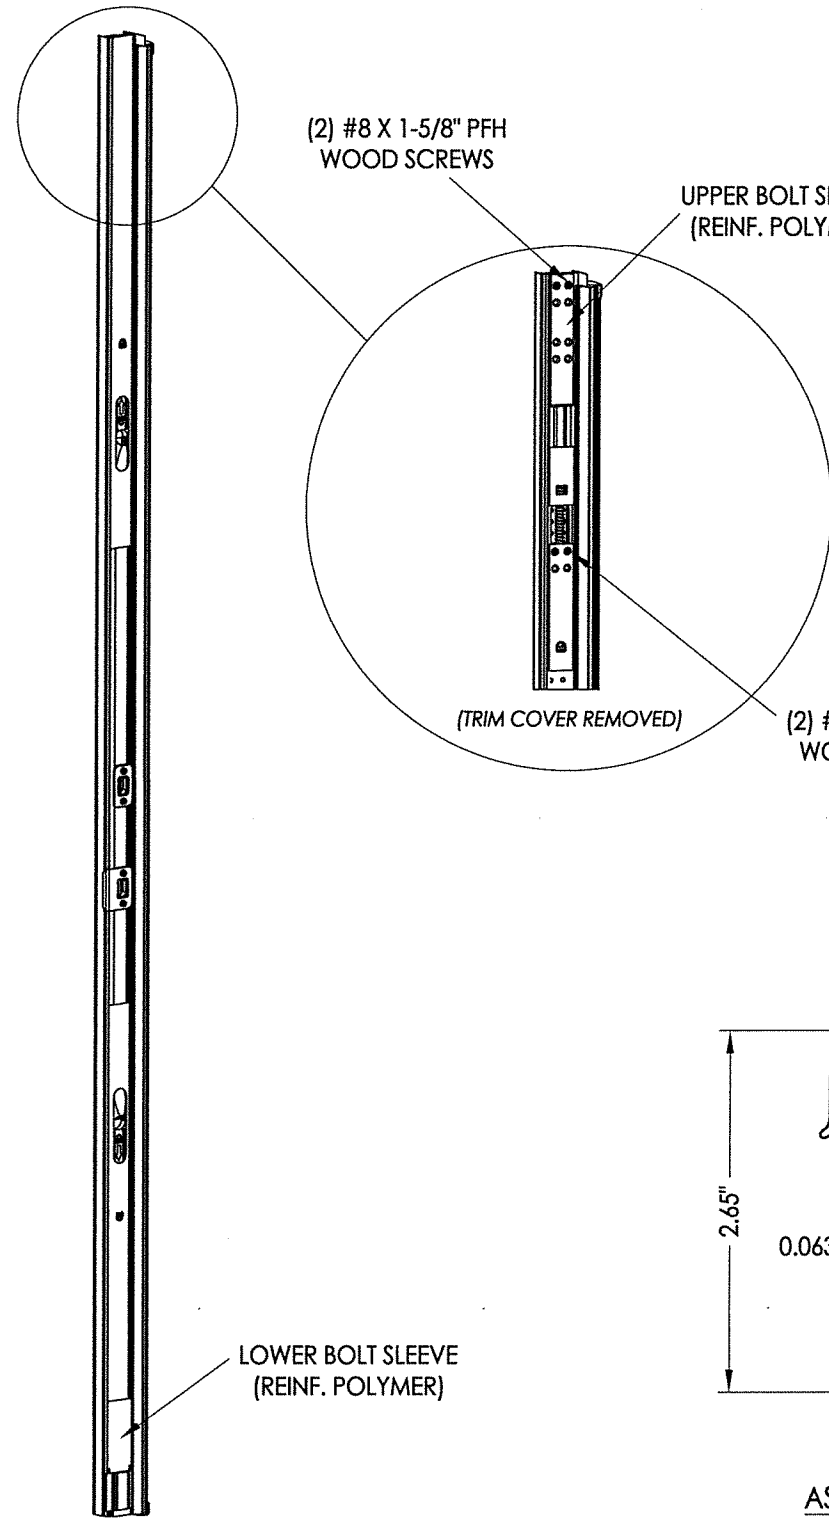

Documents Prepared By: Lyndon F. Schmidt, P.E.
 TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33585
 Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
 CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: ENDURA

PART OR ASSEMBLY: ASTRAGAL DETAILS (ULTIMATE HURRICANE)

NO.	DATE	BY	REVISIONS
2	10/28/19	LFS	ADD "FusionFrame" OPTION & UPDATE TO 2018 IBC/IRC CODE
1	10/03/18	LFS	UPDATE FOR NEW TESTING

DATE: 11/08/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: TX-4653

SHEET 3 OF 7

R:\Clients\Endura PERMANENT\B - Texas Dept of Ins\TDI - DR-850 Masonite ST Opaque (LK,DB)\C - Drawings\TX-4653.56.dwg, 1.4

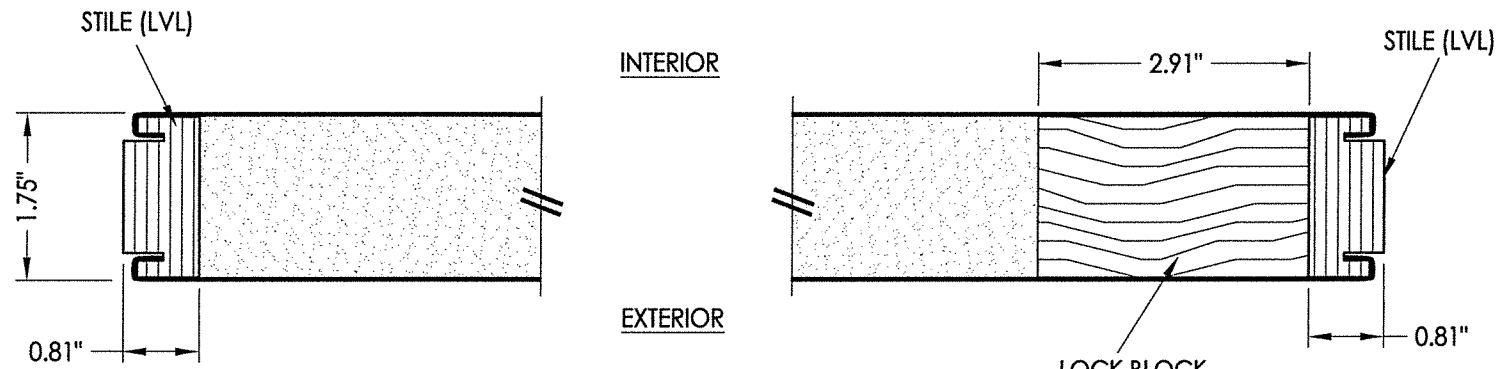


1
2 HORIZONTAL CROSS SECTION

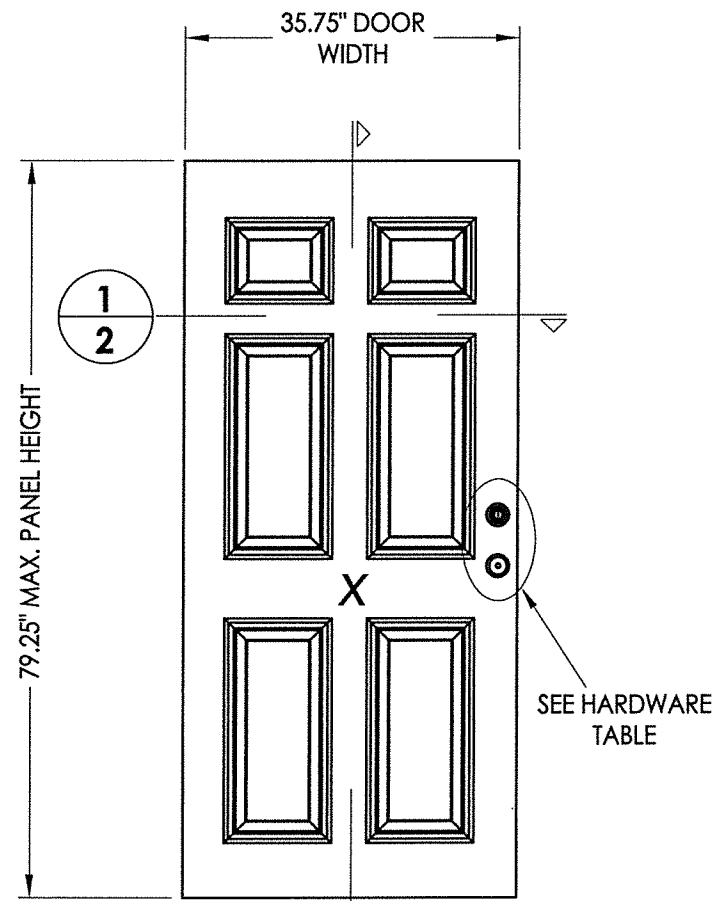


40 DOOR PANEL
Masonite
Steel (Wood Edge)

DOOR SKIN: 25 GA. STEEL (0.020\"/>

HARDWARE TABLE	
MANUFACTURER	MODEL
KWIKSET	LATCH: KWIKSET SIGNATURE SERIES (991) DEADBOLT: KWIKSET SIGNATURE SERIES (980/985)

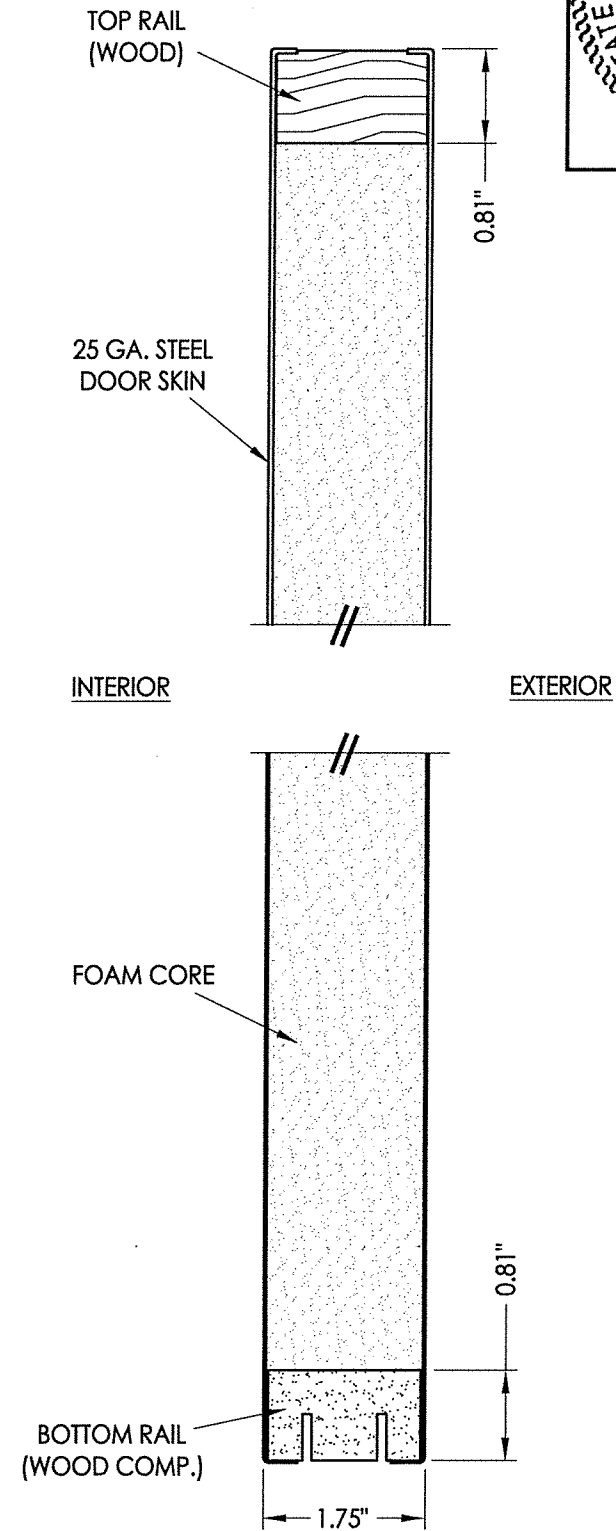

2
2 VERTICAL CROSS SECTION

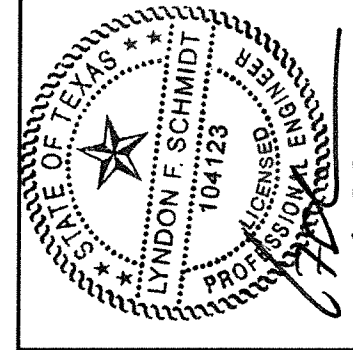

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123



RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: ENDURA
PART OR ASSEMBLY: DOOR PANEL DETAILS & GLAZING DETAIL


NO.	DATE	REVISIONS
2	10/28/19	ADD "FusionFrame" OPTION & UPDATE TO 2018 IBC/IRC CODE
1	10/03/18	UPDATE FOR NEW TESTING
		BY

DATE: 11/08/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4653
SHEET 4 OF 7



R:\Clients\Endura PERMANENT\B - Texas Dept of Ins\TDI - DR-850 Masonite ST Opaque (LK,DB)\C - Drawings\TX-4653.56.dwg, 1.5

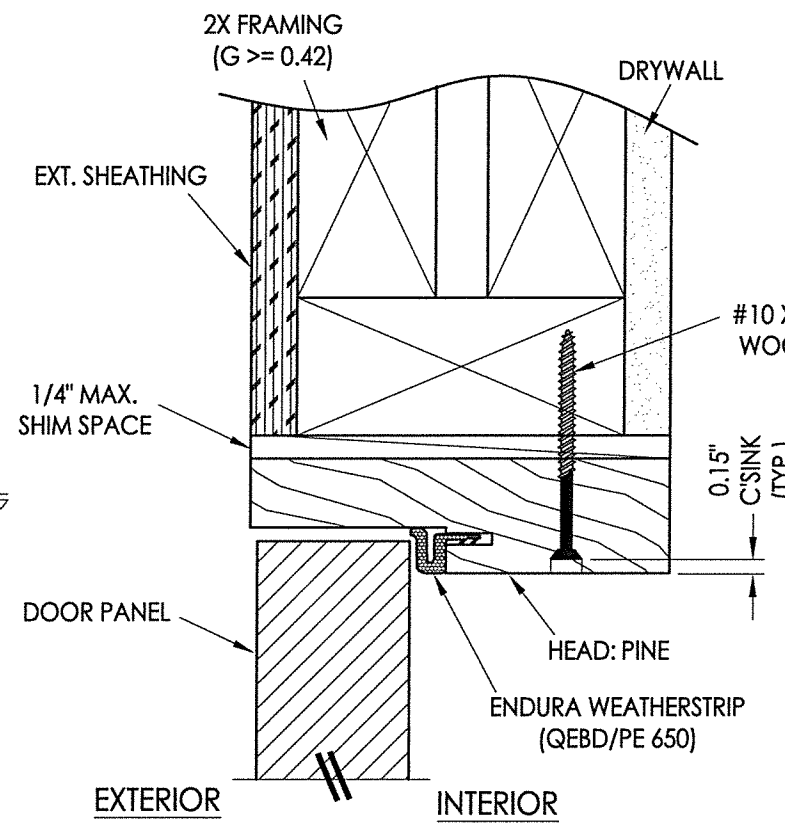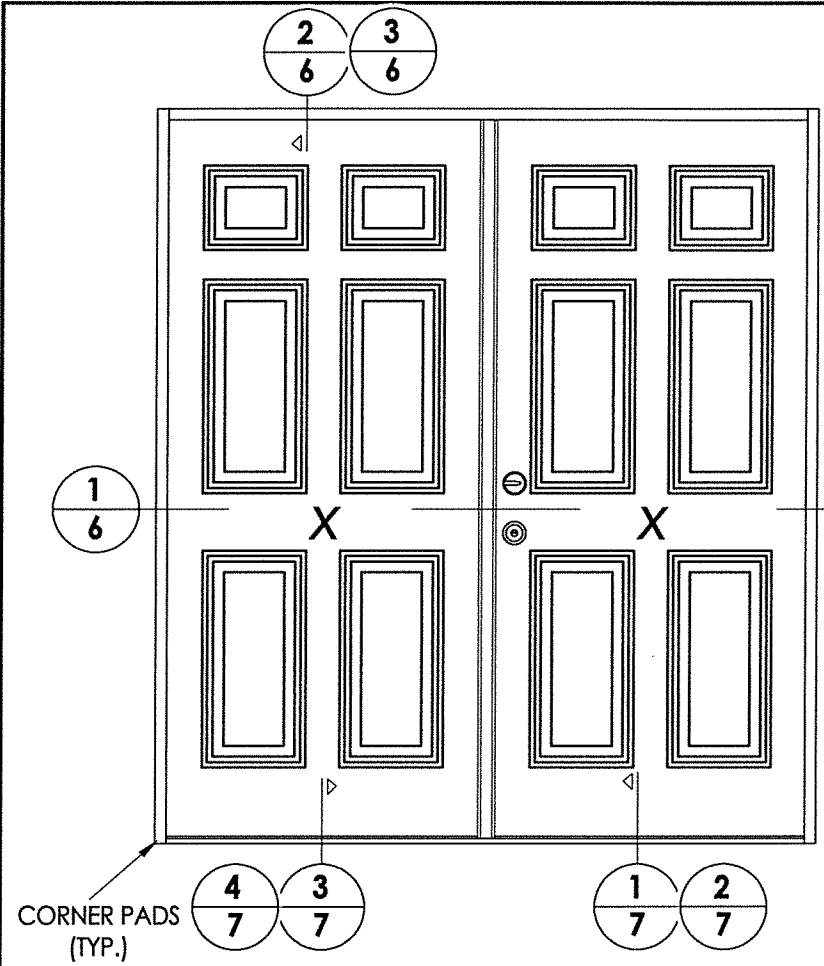


2
6 **VERTICAL CROSS SECTION**
Outswing shown - inswing also approved

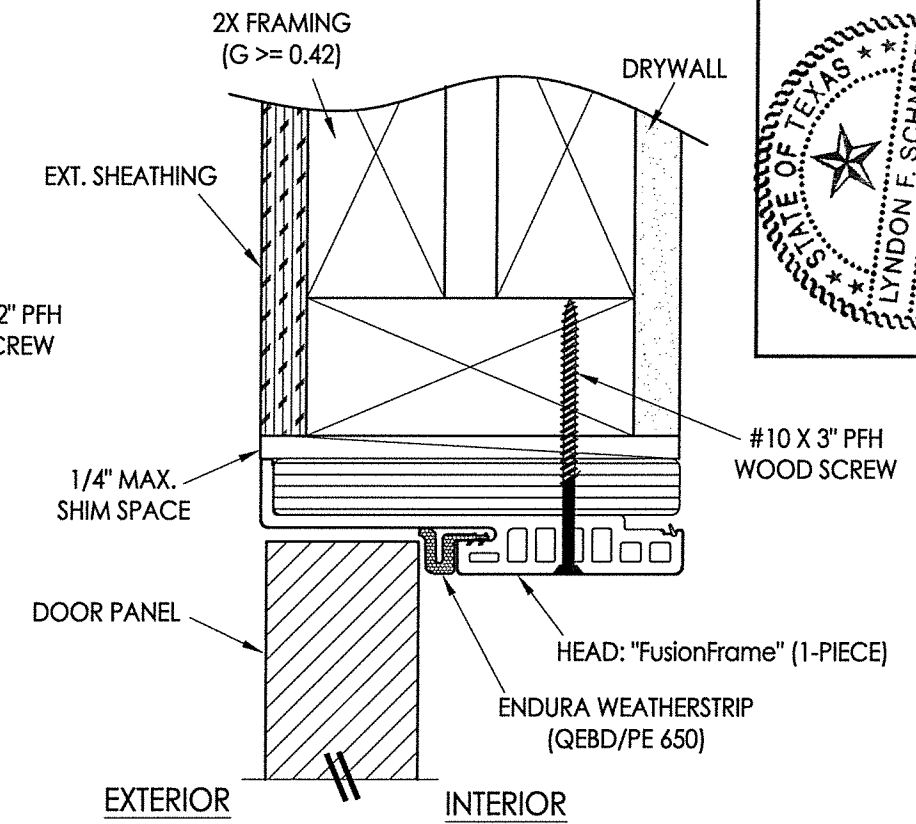

3
6 **VERTICAL CROSS SECTION**
Outswing shown - inswing also approved

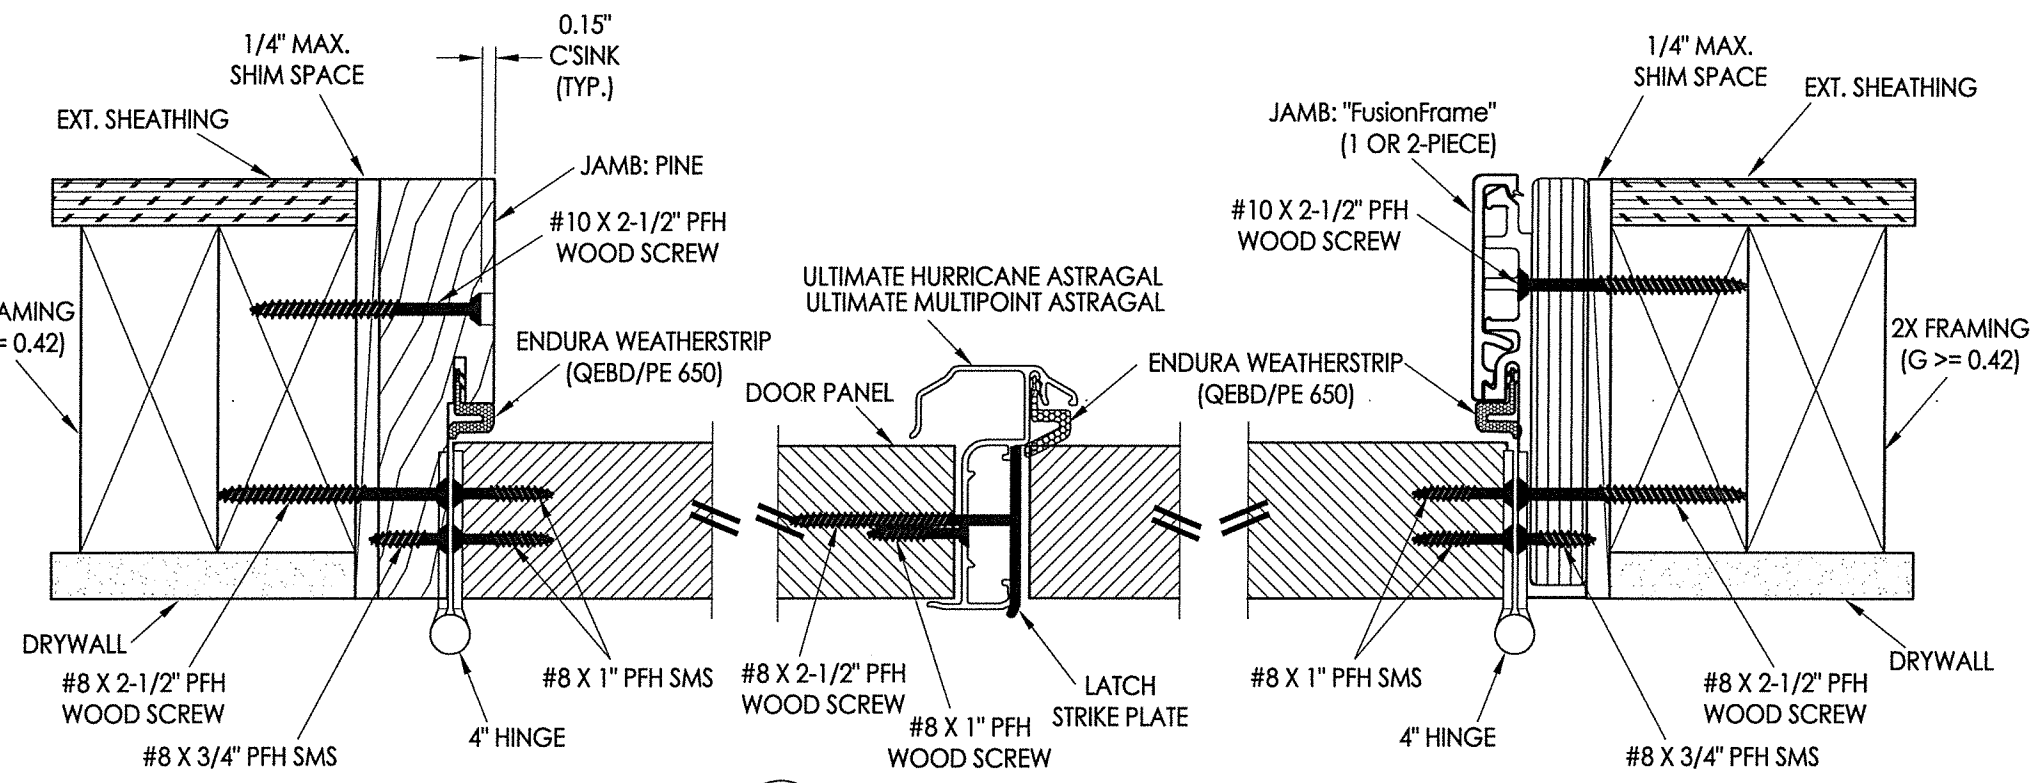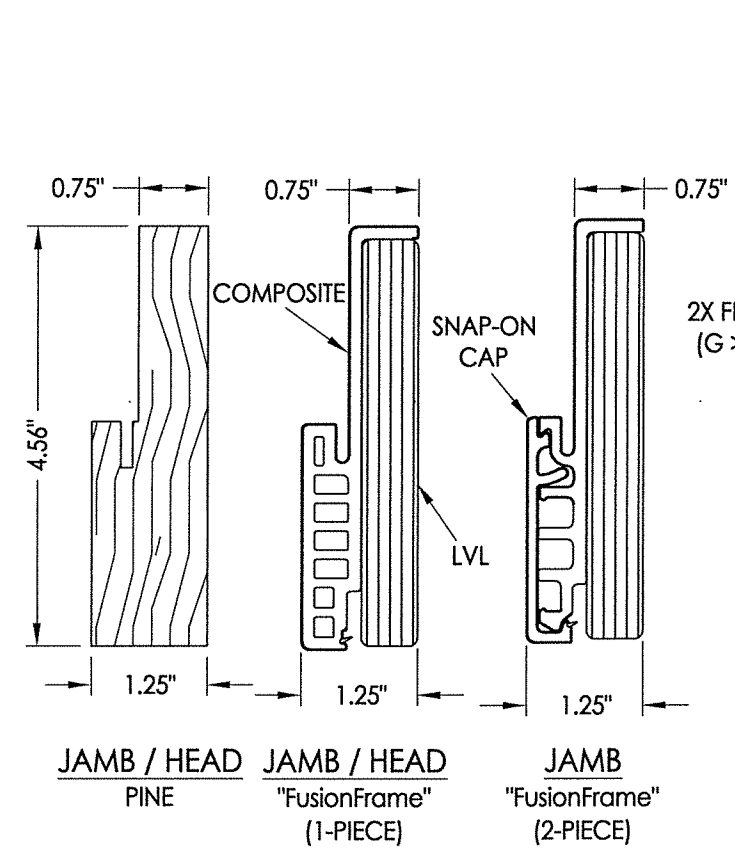

1
6 **HORIZONTAL CROSS SECTION**
Inswing shown - Outswing also approved

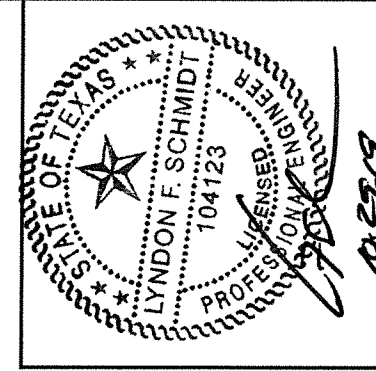

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL, 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: ENDURA

PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS

NO.	DATE	REVISIONS
2	10/28/19	ADD "FusionFrame" OPTION & LFS
1	10/03/18	UPDATE TO 2018 IBC/IRC CODE
		UPDATE FOR NEW TESTING

DATE: 11/08/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: TX-4653


SHEET 5 OF 7

R:\Clients\Endura PERMANENT\B - Texas Dept of Ins\TDI - DR-850 Masonite ST Opaque (LK,DB)\C - Drawings\TX-4653.56.dwg, 1.6

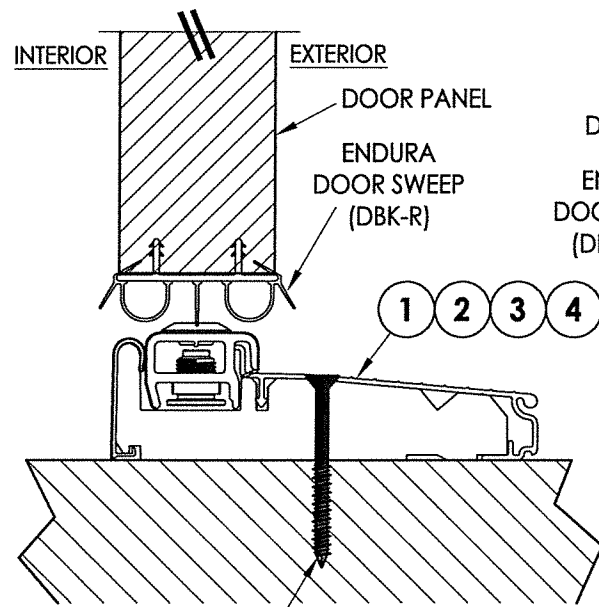


#10 X 2.5" PFH WOOD SCREW OR 1/4" X 2-3/4" ELCO OR ITW CONCRETE SCREW

1 VERTICAL CROSS SECTION
6 Inswing Adjustable Threshold

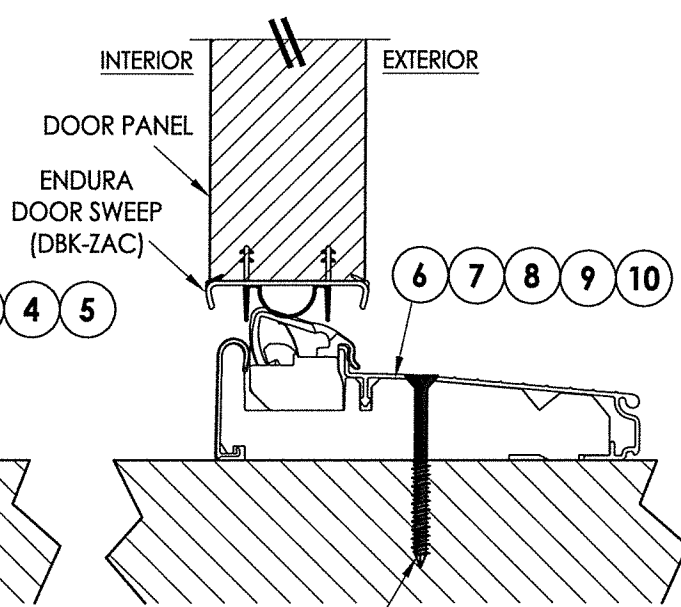


#10 X 2.5" PFH WOOD SCREW OR 1/4" X 2-3/4" ELCO OR ITW CONCRETE SCREW

2 VERTICAL CROSS SECTION
6 Inswing Articulating Threshold w/ Pin Capture

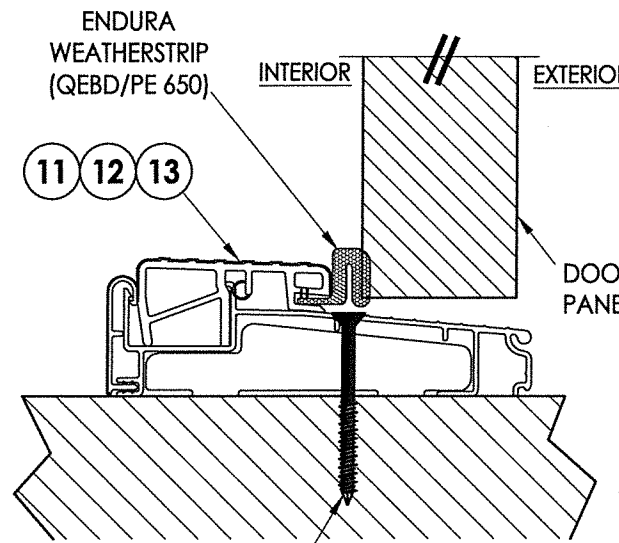


#10 X 2.5" PFH WOOD SCREW OR 1/4" X 2-3/4" ELCO OR ITW CONCRETE SCREW

3 VERTICAL CROSS SECTION
6 Outswing Bump Threshold

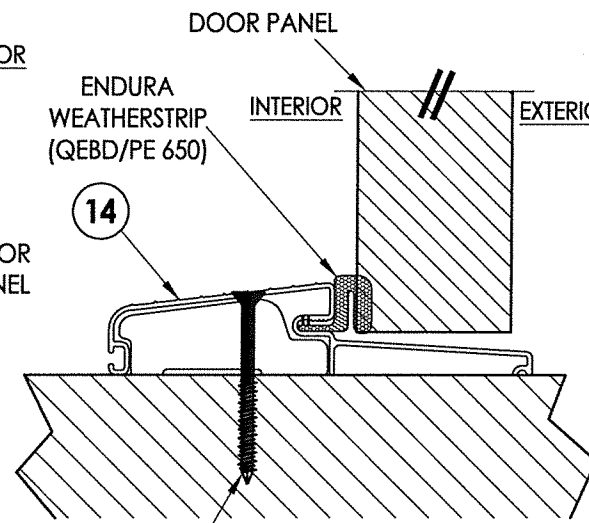


#10 X 2.5" PFH WOOD SCREW OR 1/4" X 2-3/4" ELCO OR ITW CONCRETE SCREW

4 VERTICAL CROSS SECTION
6 Outswing Bump Threshold

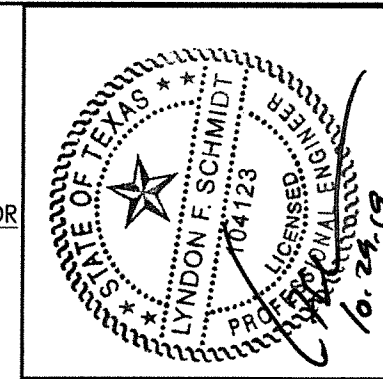


Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123


RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

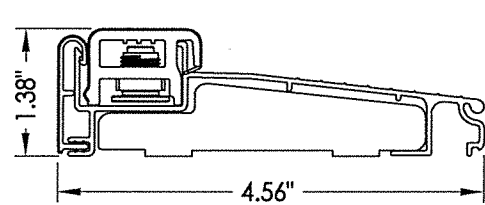


1 INSWING ADJUSTABLE THRESHOLD
ZAIL4565

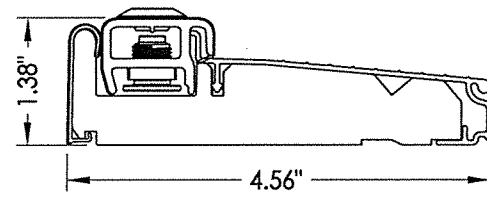


2 INSWING ADJUSTABLE THRESHOLD
ZAI4565FN
MAX. DESIGN PRESSURE = ±40 PSF

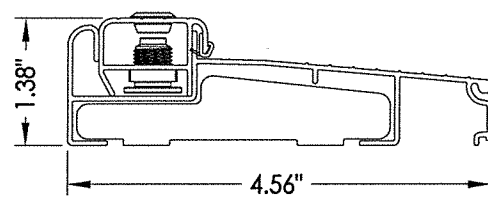


3 INSWING ADJUSTABLE THRESHOLD
ZAILAA4565

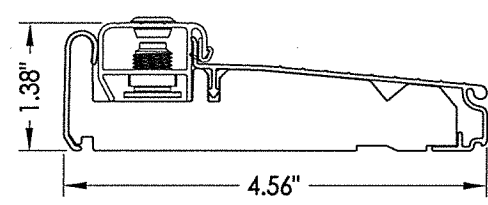


4 INSWING ADJUSTABLE THRESHOLD
ZAIAA4565FN
MAX. DESIGN PRESSURE = ±40 PSF

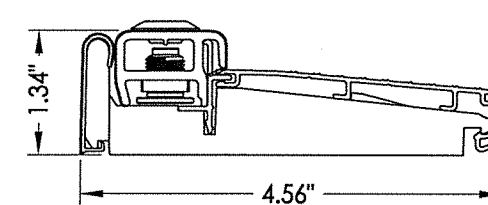


5 INSWING ADJUSTABLE THRESHOLD
ZAI4565RDS

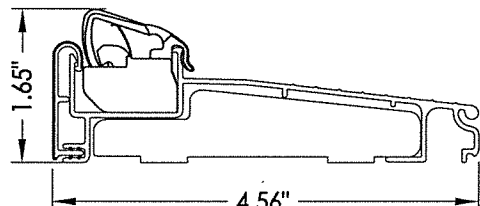


6 INSWING ARTICULATING THRESHOLD
ZACL4565

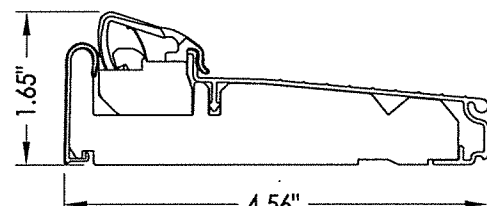


7 INSWING ARTICULATING THRESHOLD
ZAC4565FN
MAX. DESIGN PRESSURE = ±40 PSF

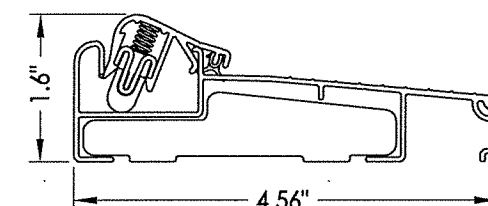


8 INSWING ARTICULATING THRESHOLD
ZACLAA4565

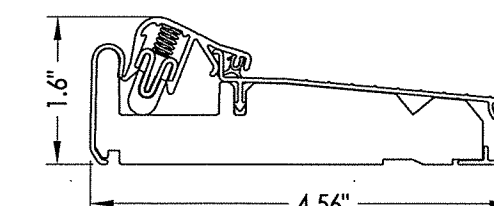


9 INSWING ARTICULATING THRESHOLD
ZACAA4565FN
MAX. DESIGN PRESSURE = ±40 PSF

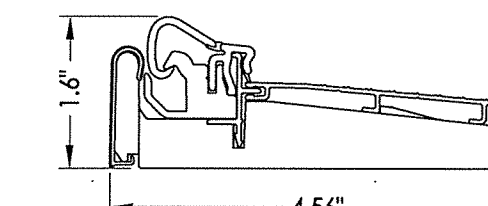


10 INSWING ARTICULATING THRESHOLD
ZAC4565RDS
MAX. DESIGN PRESSURE = ±45 PSF

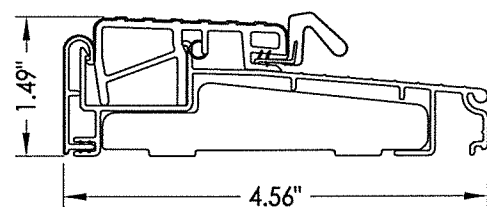


11 OUTSWING THRESHOLD
ZOBL4565

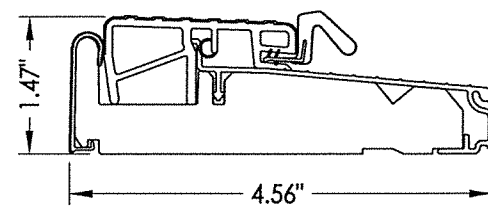

12 OUTSWING THRESHOLD
ZOB4565FN

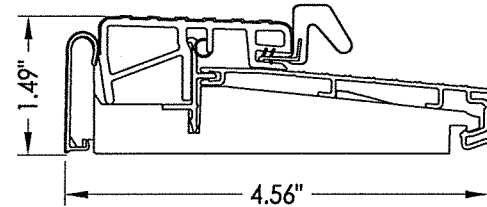





13 OUTSWING THRESHOLD
ZOB4565RDS

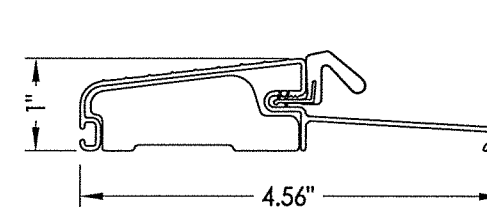

14 OUTSWING THRESHOLD
FOB4566

PRODUCT:	ENDURA
PART OR ASSEMBLY:	VERTICAL CROSS SECTIONS
DATE:	11/08/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	TX-4653
SHEET	6 OF 7

© 2016 R.W. BUILDING CONSULTANTS INC.

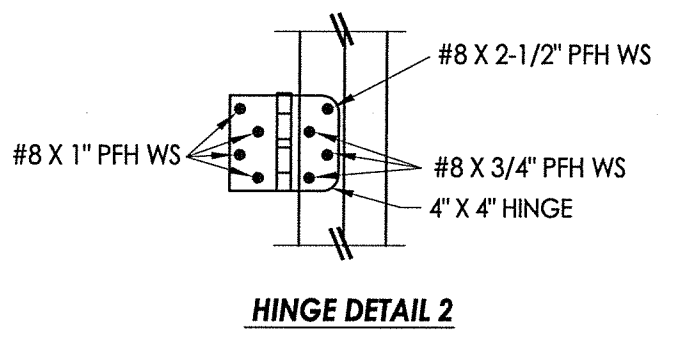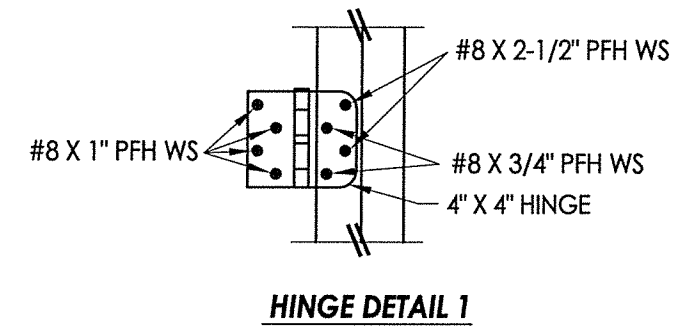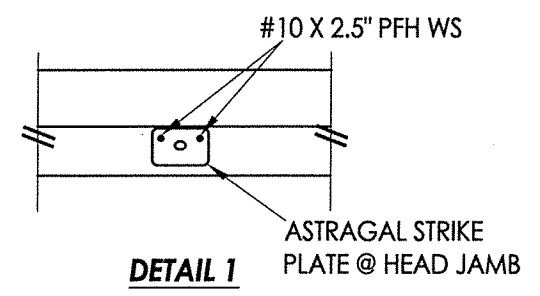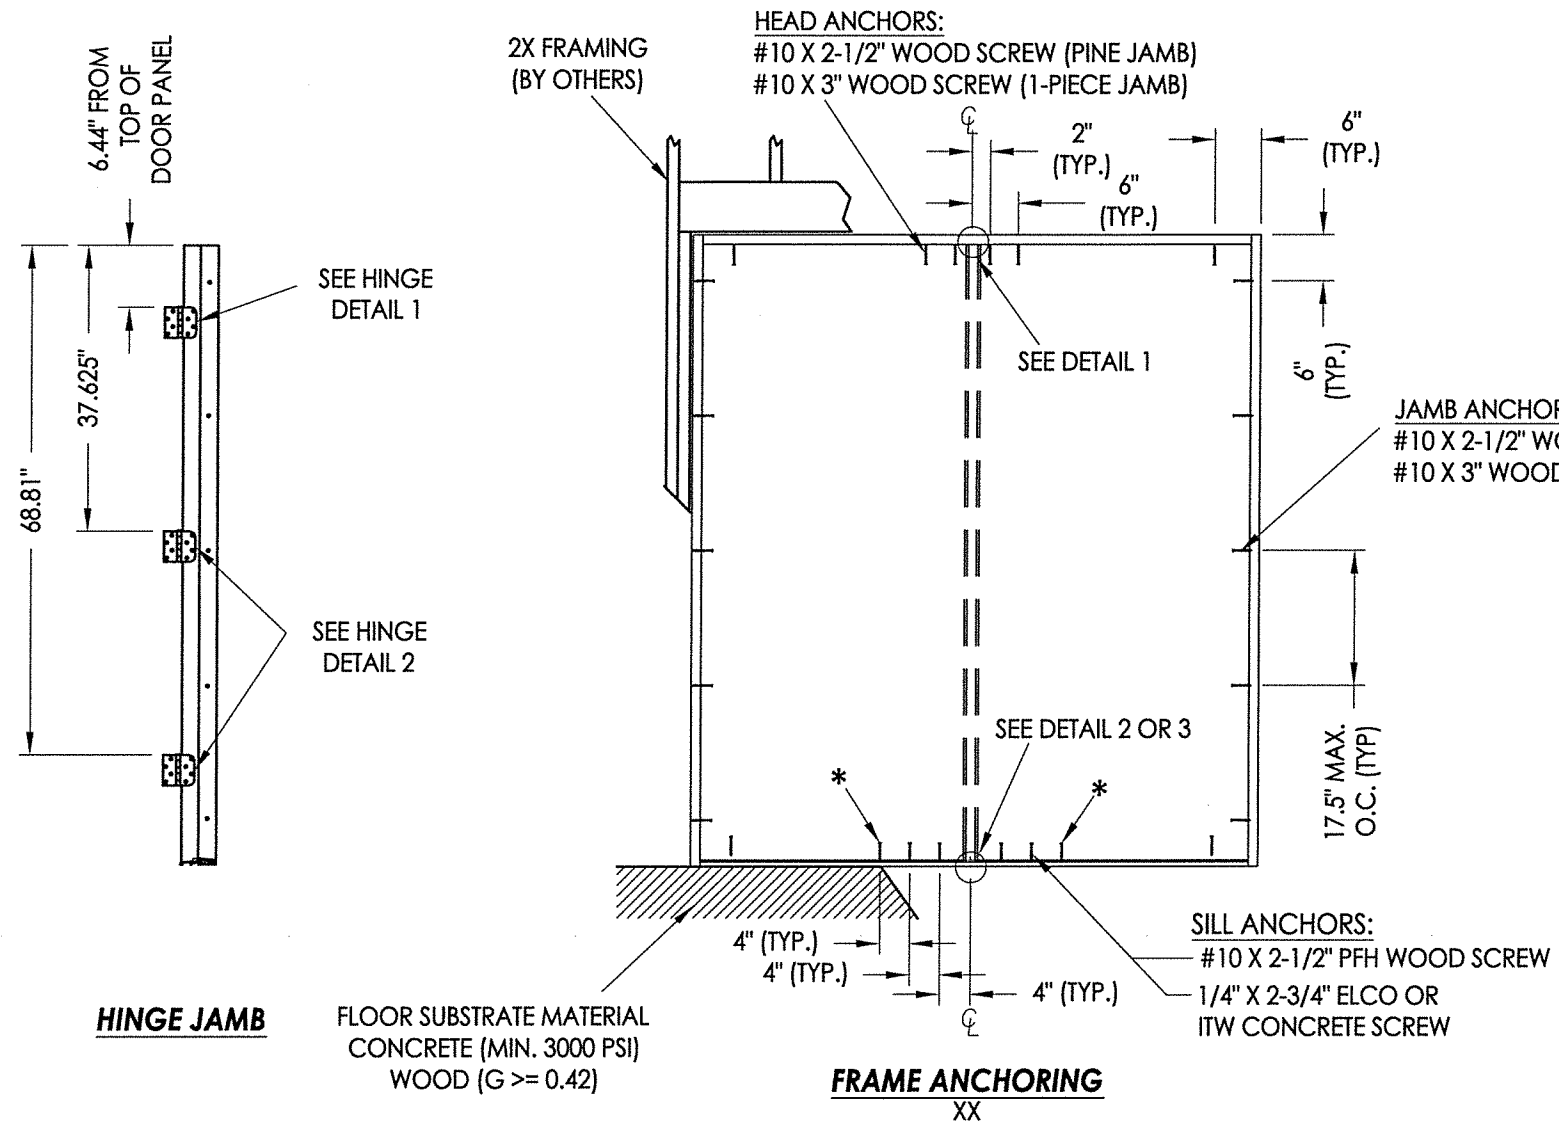

*NOTE: THESE ANCHORS REQUIRED FOR D.P. > 40 PSF.



JAMB NOTES:
 THE PINE OR "FusionFrame" 1-PIECE JAMB MAY BE INSTALLED @ THE HEAD OR SIDE JAMB.
 THE FusionFrame" 2-PIECE JAMB MAY BE INSTALLED @ THE SIDE JAMBS ONLY.

- CONCRETE ANCHOR NOTES:**
- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
 - Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
 - Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-3/4"	3"	1-1/2"
ITW TAPCON®	1/4"	1-3/4"	1-1/2"	4"
ELCO ULTRACON®	1/4"	1-3/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

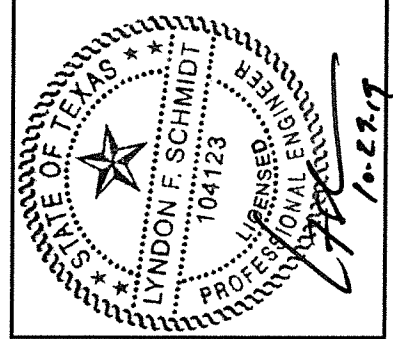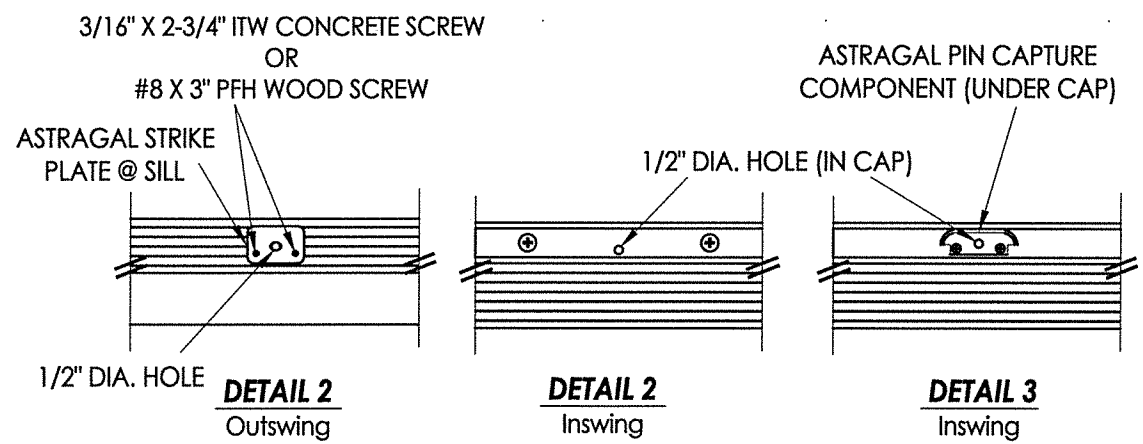

Documents Prepared By: Lyndon F. Schmidt, P.E.
 TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
 CERTIFICATE OF REGISTRATION # F-11852

PRODUCT:	ENDURA
PART OR ASSEMBLY:	FRAME ANCHORING
DATE:	11/08/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	TX-4653
SHEET	7 OF 7