
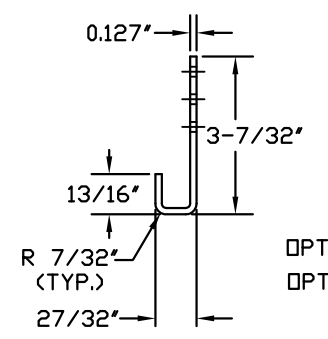
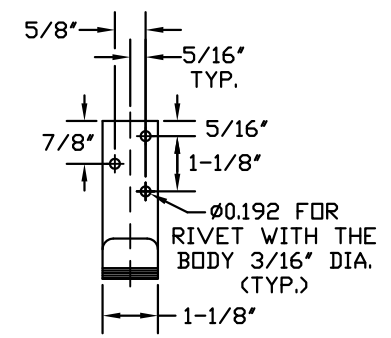
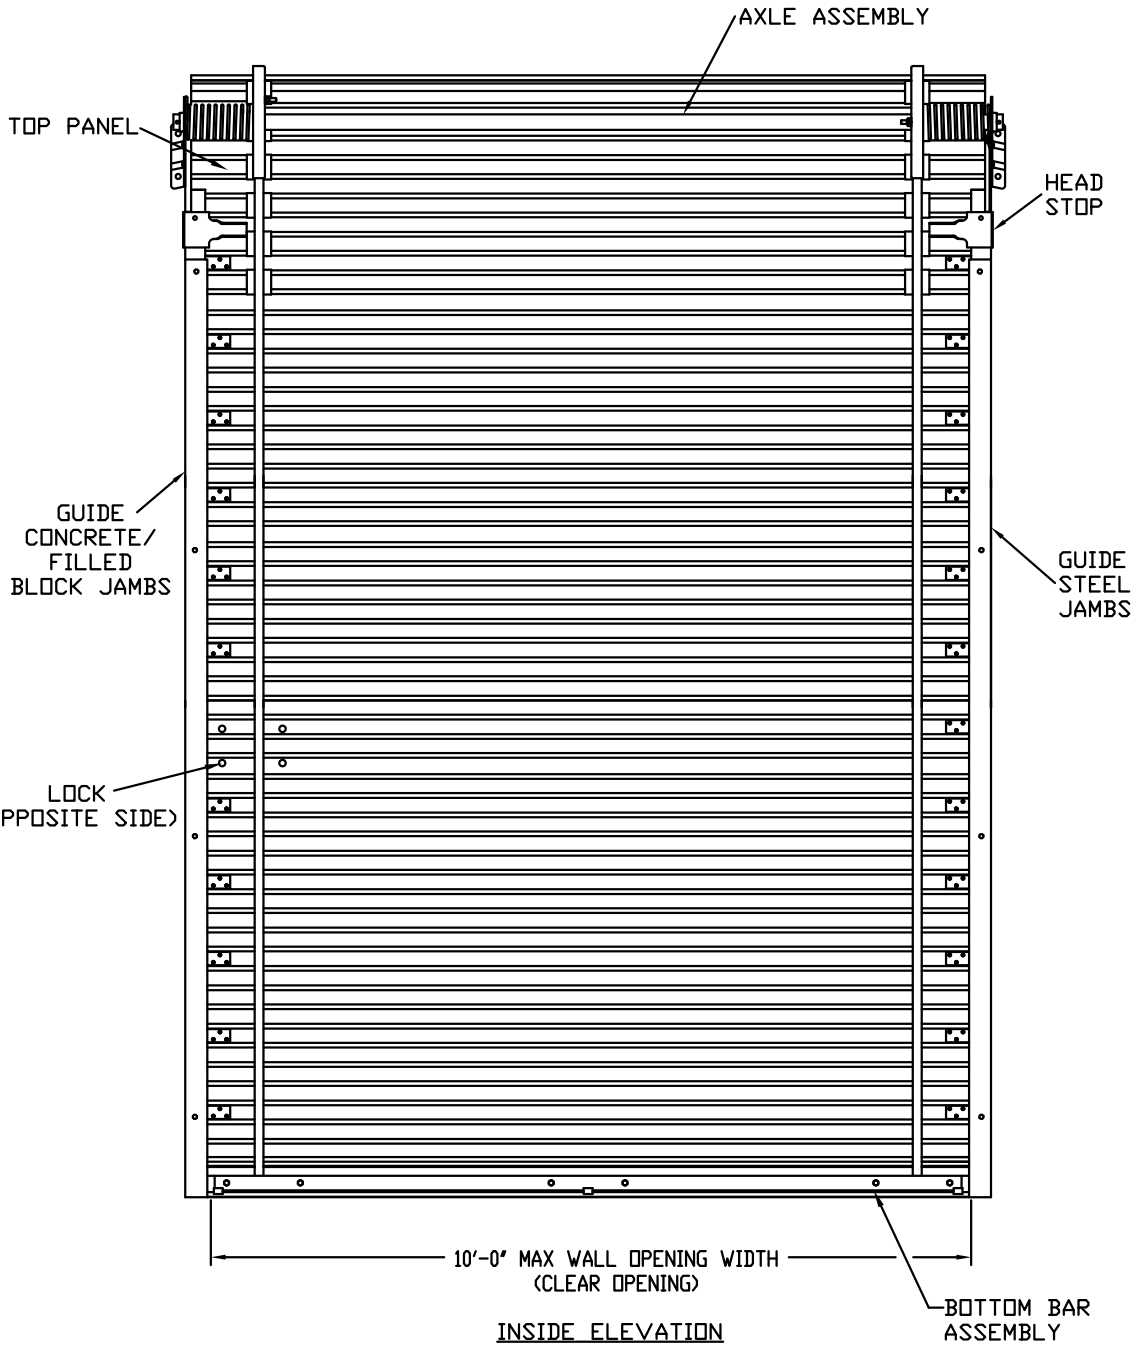


REVISIONS			
NO.	RELEASE PER DRN	DATE	APPROVAL

MINIMUM HEADROOM DIMENSIONS


OPENING HEIGHT	THRU 7'-4"	OVER 7'-4" THRU 8'-8"	OVER 8'-8" THRU 10'-0"	OVER 10'-0" THRU 12'-0"
VERTICAL HEADROOM	15-1/2"	16"	18"	20"
HORIZONTAL HEADROOM	17-1/2"	18"	19"	21"

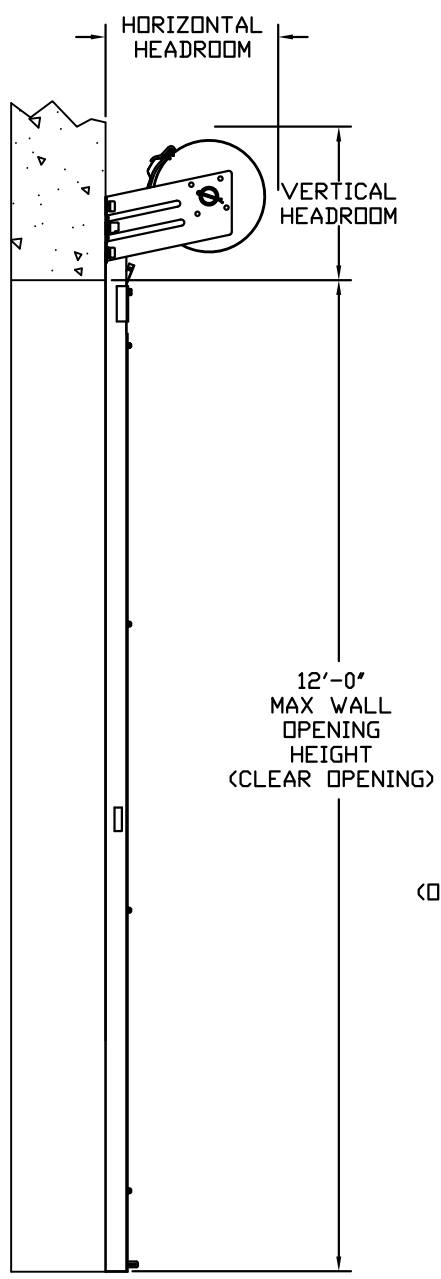


ASTM A653 G40 GALVANIZED CS TYPE B  
WINDLOCK DETAIL

EACH WINDLOCK IS ATTACHED TO CURTAIN WITH THREE STEEL RIVETS WITH THE BODY 3/16" DIA.


OPTION 1: THE WINDLOCK SHOWN WAS TESTED.  
OPTION 2: THE SAME WINDLOCK WITH A GUSSET MAY ALSO BE USED.

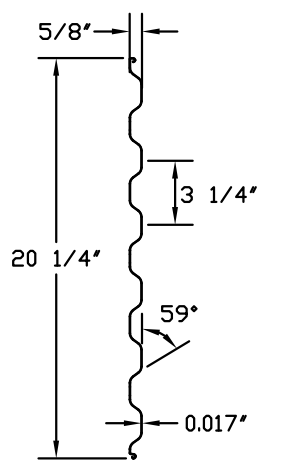


ASTM A653 SS GRADE 80 WITH FULL COAT OF PRIMER AND BAKED POLYESTER FINISH COAT  
TYPICAL PANEL (26 GA.) DETAIL

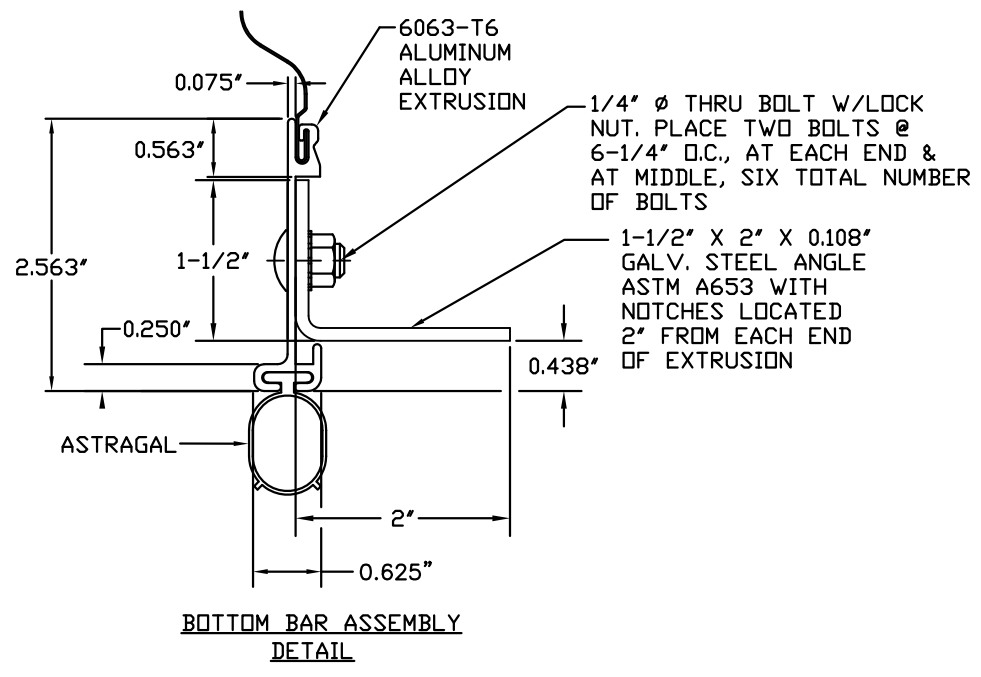


BOTTOM BAR ASSEMBLY DETAIL

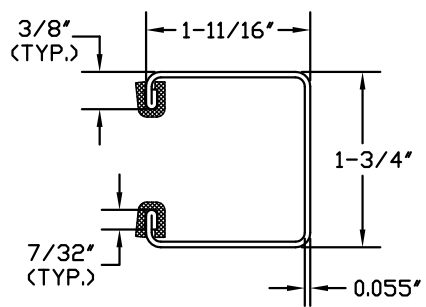

ASTM A653 G40 GALVANIZED CS TYPE B  
GUIDE DETAIL

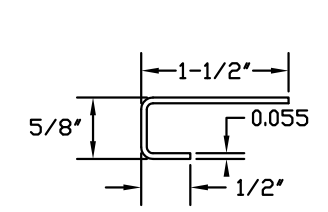

ASTM A653 G40 GALVANIZED CS TYPE B  
WINDBAR DETAIL

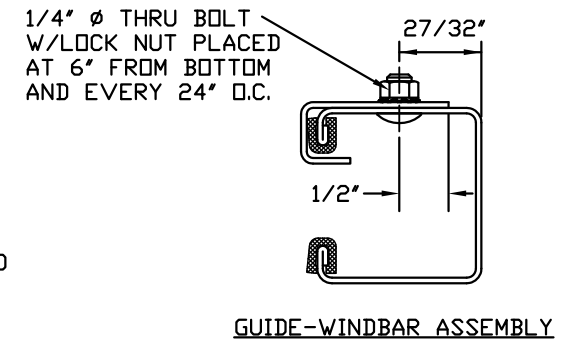

GUIDE-WINDBAR ASSEMBLY

JOHN E. SCATES PE  
3121 FAIRGATE  
CARROLTON, TX 75007  
  
FL PE 51737  
TX PE 56308/F-2203

THESE CONFIDENTIAL DOCUMENTS SUBMITTED BY DBCI CONTAIN INFORMATION OF A PROPRIETARY NATURE AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING IN PART OR IN WHOLE FOR ANY PURPOSE OTHER THAN THAT WHICH IS NECESSARY FOR PREPARATION OF BIDS OR ENGINEERING WITHOUT THE EXPRESS PERMISSION OF DBCI WHICH MAY RECALL DOCUMENTS AT ANY TIME.


PART NUMBER: N/A	
MATERIAL: N/A	
APPLIED FINISH: N/A	
UNIT OF MEASURE: N/A	
APPROVALS	DATE:
DRAWN BRAY ALLEN	8/6/14
CHECKED BRAY ALLEN	8/6/14
APPROVED	

**DBCI** DOORS & BUILDING COMPONENTS  
DOUGLASVILLE, GA CHANDLER, AZ HOUSTON, TX  
© 2000 DBCI ALL RIGHTS RESERVED


26 GA. WIND LOAD MAX. SIZE 10'-0" x 12'-0"  
CURL-LOK K690 SERIES

SIZE <b>B</b>	DRAWING NUMBER -K690-14-0001	REV.
SCALE: NONE	SHEET 1	OF 2


REVISIONS			
REV	DESCRIPTION	DATE	APPROVAL
1	CERTIFICATION UPDATE	6/06/06	H.B.
2	CERTIFICATION UPDATE	8/19/08	B.A.
3	REMOVED CODE REFERENCE IN NOTE	2/21/12	B.A.
4	MODIFIED FOR TDI	12/19/13	B.A.

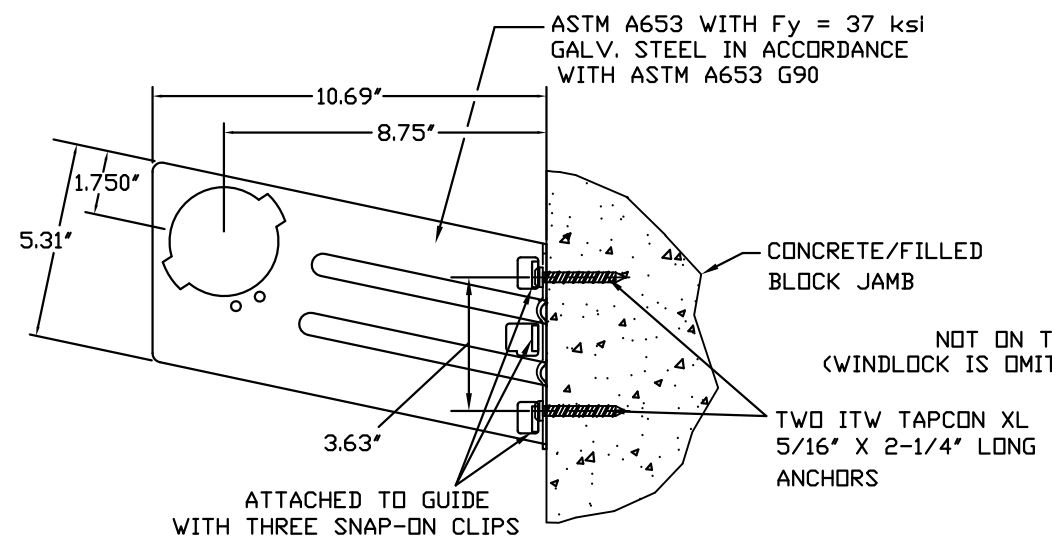


DOOR MOUNTING BRACKET TO MASONRY DETAIL

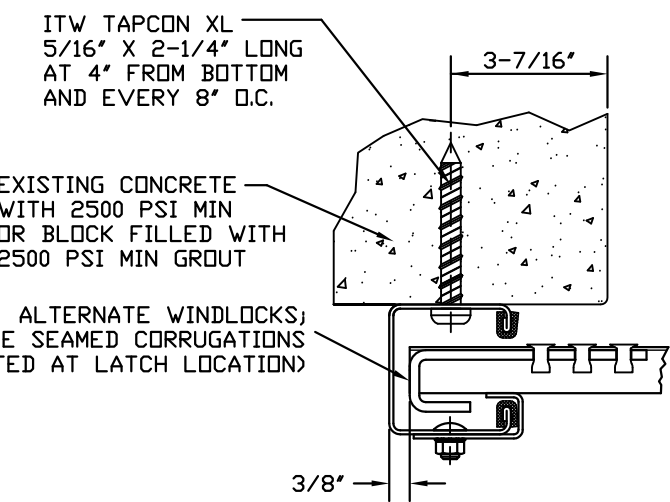


FOR MASONRY JAMBS:  
CURTAIN WIDTH=OPENING WIDTH+7 3/4"  
CONCRETE/FILLED BLOCK JAMBS  
LH GUIDE MOUNT SHOWN

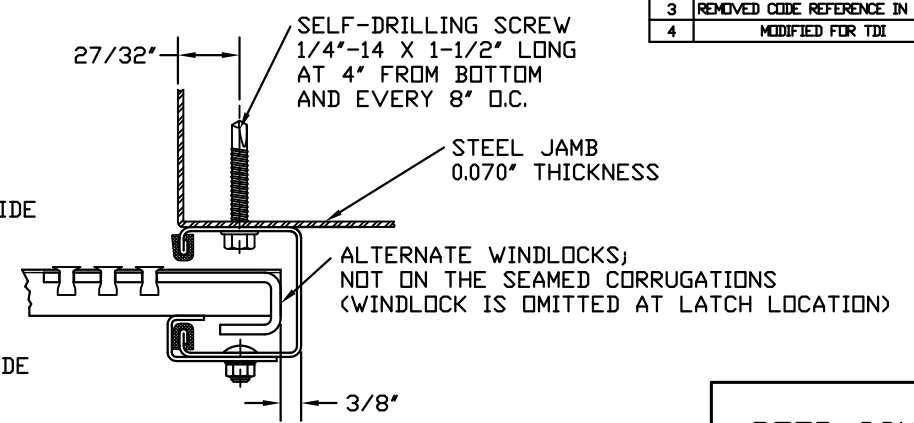


FOR STEEL JAMBS:  
CURTAIN WIDTH=OPENING WIDTH+3"  
STEEL JAMBS  
RH GUIDE MOUNT SHOWN

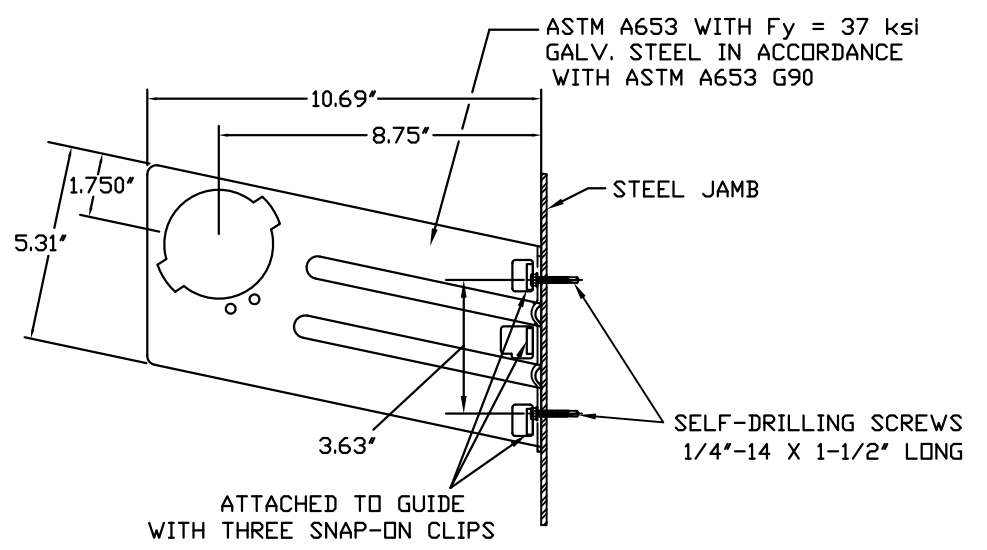

DOOR MOUNTING BRACKET TO STEEL DETAIL

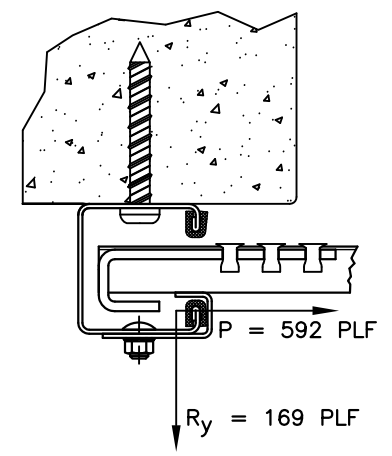

CONCRETE/FILLED BLOCK JAMBS  
LH GUIDE MOUNT SHOWN

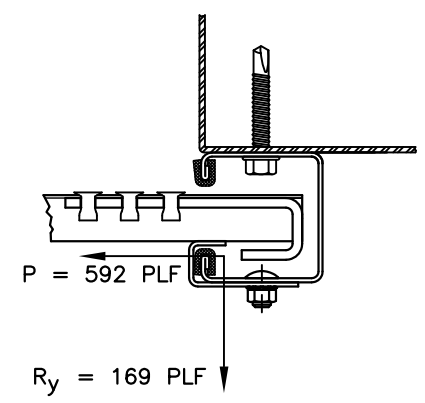


STEEL JAMBS  
RH GUIDE MOUNT SHOWN

SUPERIMPOSED LOAD DIAGRAM

DOOR SCHEDULE	
DOOR WIDTH	DESIGN PRESSURE (PSF)
≤ 4'-0"	+ 64.2
	- 75.0
5'-0"	+ 55.0
	- 64.2
6'-0"	+ 46.2
	- 53.9
7'-0"	+ 39.8
	- 46.5
8'-0"	+ 34.9
	- 40.8
9'-0"	+ 31.2
	- 36.4
10'-0"	+ 28.2
	- 32.9

GENERAL NOTES:

1. THIS DOOR EVALUATED IN ACCORDANCE WITH TEST METHODS ASTM E330-02 AND ANSI/DASMA 108-05.
2. THIS PRODUCT EVALUATION IS GENERIC. IT DOES NOT INCLUDE INFORMATION PREPARED FOR A SPECIFIC SITE.
3. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE STRUCTURAL CAPACITY OF THE SUBSTRATE (JAMB) TO RESIST THE LOADS IMPOSED BY THE ROLL-UP DOOR.
4. ALL DOOR JAMBS (MASONRY OR STEEL) MUST BE DESIGNED TO RESIST THE FORCES SHOWN IN SUPERIMPOSED LOAD DIAGRAM.
5. THE DOOR ASSEMBLY SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

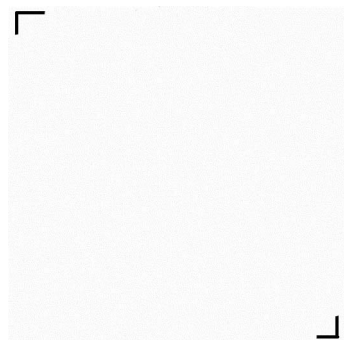

JOHN E. SCATES PE  
3121 FAIRGATE  
CARROLLTON, TX 75007  
  
FL PE 51737  
TX PE 56308/F-2203

THESE CONFIDENTIAL DOCUMENTS SUBMITTED BY DBCI CONTAIN INFORMATION OF A PROPRIETARY NATURE AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING IN PART OR IN WHOLE FOR ANY PURPOSE OTHER THAN THAT WHICH IS NECESSARY FOR PREPARATION OF BIDS OR ENGINEERING WITHOUT THE EXPRESS PERMISSION OF DBCI WHICH MAY RECALL DOCUMENTS AT ANY TIME.

PART NUMBER: N/A	
MATERIAL: N/A	
APPLIED FINISH: N/A	
UNIT OF MEASURE: N/A	
APPROVALS	DATE
DRAWN BRAY ALLEN	8/6/14
CHECKED BRAY ALLEN	8/6/14
APPROVED	



26 GA. WIND LOAD MAX. SIZE 10'-0" x 12'-0"  
**CURL-LOK K690 SERIES**

SIZE <b>B</b>	DRAWING NUMBER -K690-14-0001	REV.
SCALE: NONE	SHEET 2	OF 2