NOTES: 1. IMPACT RESISTANT GLAZING OPTION - IMPACT RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS). GLAZING SHALL BE 1/4" POLYCARBONATE. MAXIMUM GLAZING DIMENSIONS SHALL BE 14" x 46" CUTOUT, FASTENED WITH A MINIMUM #8 X 1" SMS: 3X ALONG THE HORIZONTAL AND 3X ALONG THE VERTICAL. SEE DETAIL E ON SHEET 2 FOR ASSEMBLY DETAILS.

2. NON-IMPACT RESISTANT GLAZING OPTION - .090" MINIMUM SSB GLAZING IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS (3X ALONG THE HORIZONTAL AND 2X ALONG THE VERTICAL) INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS) MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. MAXIMUM GLAZING DIMENSIONS SHALL BE 15" x 46" CUTOUT. GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

3. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE

4. KEY LOCK, SLIDE LOCK, OR OPERATOR REQUIRED.

5. FACER STEEL TO HAVE A MINIMUM 29 GA THICKNESS AND BACKER STEEL TO HAVE A MINIMUM 29 GA THICKNESS.

5. EACH SECTION HAS AN INTERNAL 1"WIDE X 20 GA CONTINUOUS STEEL STRIP AT THE TOP AND BOTTOM OF THE SECTION.


. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS


8. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

9. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A 13 GA LHR 7/4 TOP BRACKET WITH A MINIMUM OF (3) 1/4-20x3/4" SELF DRILLING CRIMPTITE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. U-BAR ON TOP SECTION SHALL BE INSTALLED ON TOP OF LHR TOP BRACKETS.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

1	LONDO ON		SOLI OKTING STROOTORE		
		DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)		
I	10'-2"	ALL	+152.5/-170.3		
ı	10'-0"	ALL	±182 5 /= 203 8		



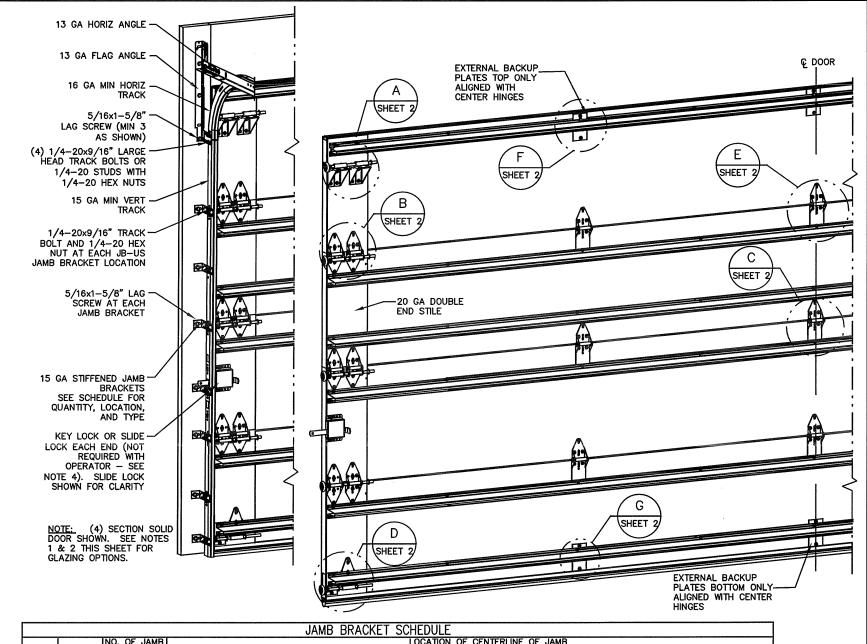

DOOR NO. OF JAMB BRACKETS SECTIONS (FACE INC.) LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2") 2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/4" (JB-US)

2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 42" (JB-US), 52-1/2" (JB-US), 63-1/4" (JB-US)

2" (JB-US), 10" (JB-US), 18-3/4" (JB-US), 26-3/4" (JB-US), 36" (JB-US), 45" (JB-US), 54-1/4" (JB-US), 74-1/2" (JB-US)

2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 75-1/2" (JB-US) 7'-0" 4 7'-6" 4 OR 5 8'-0" 4 OR 5 SEE NOTE BELOW

(JB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT AS SHOWN ABOVE.

ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

COMPLIES WITH THE REQUIREMENTS OF IBC/IRC 2018.

REVISIONS

SW 9/14/2020

TLC 4/1/21

PCR 32769

SW 2/16/22

REV A - UPDATED DRAWING TO SHOW

WL008

P1 REVISED MODELS PER

GLAZING CROSS-SECTION

REV B - UPDATED PER

NAME

SW


TLC

REV.


В


3

411714





DIVISION OF OVERHEAD DOOR COR 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890

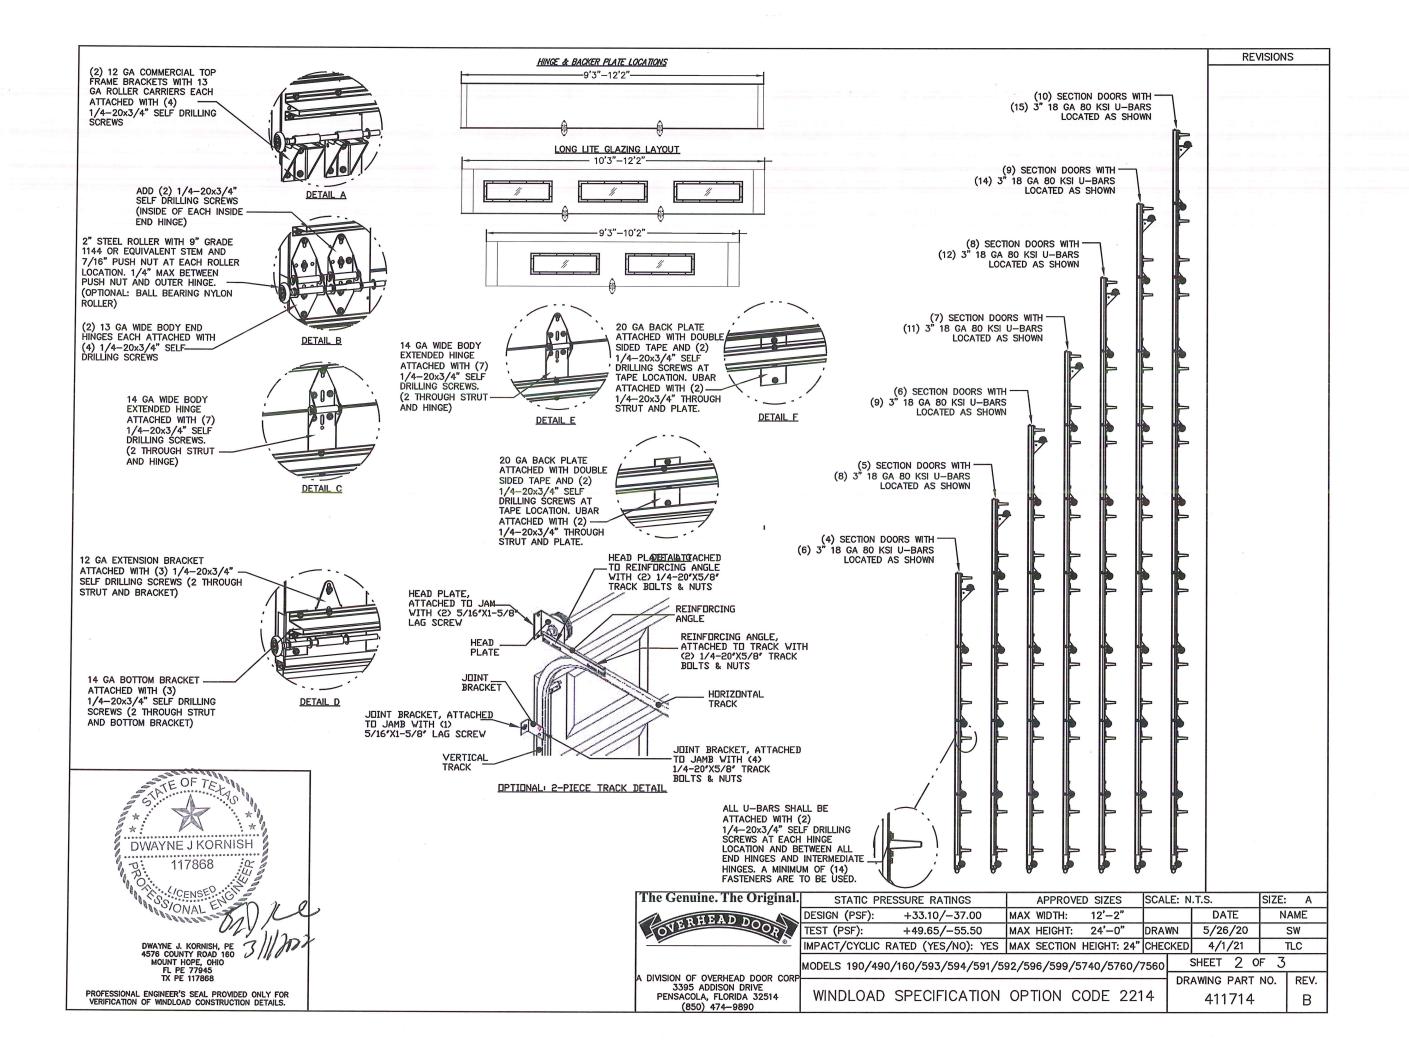

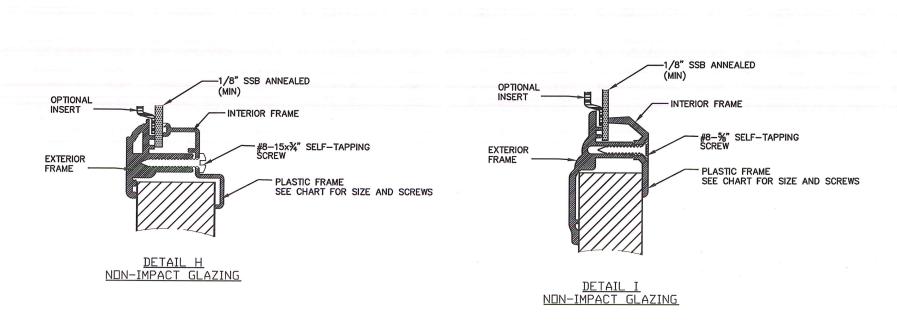

	OUTSIDE FRAME SIZE	DAYLIGHT OPENING (DLO)	SCREW QTY EA HORIZ LEG	QTY EA	SCREW QTY TOTAL	DETAIL
	17"X51"	14X48	5	3	16	Н
	15.1X44"	11.5"X40.5"	8	3	22	1
	14.9X20.8"	11"X17"	3	3	12	- 1
L	7"X40.8	4"X37.8"	5	2	14	1
	15.3"X44.1"	11.3"X40.1"	6	3	18	J
	14.6"X20.8"	10.6"X16.8"	3	2	10	J
	13"X38"	9"X34"	5	2	14	J

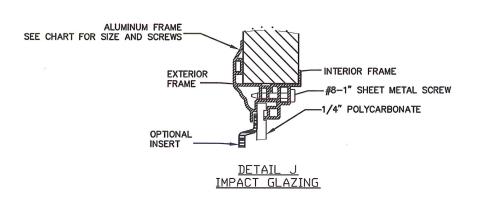



The Genuine. The Original. STATIC PRESSURE RATINGS APPROVED SIZES SCALE: N.T.S. SIZE: A DESIGN (PSF): +33.10/-37.00 12'-2" DATE NAME MAX WIDTH: +49.65/-55.50 MAX HEIGHT: 24'-0" 5/26/20 SW IMPACT/CYCLIC RATED (YES/NO): YES MAX SECTION HEIGHT: 24" CHECKED 4/1/21 TLC SHEET 3 OF MODELS 190/490/160/593/594/591/592/596/599/5740/5760/7560

A DIVISION OF OVERHEAD DOOR CORP 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474—9890

WINDLOAD SPECIFICATION OPTION CODE 2214

DRAWING PART NO. REV. 411714 B

REVISIONS