NOTES:

1. IMPACT RESISTANT GLAZING OPTION — IMPACT

OF THE MAY BE INSTALLED II RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS). GLAZING SHALL BE 1/4" POLYCARBONATE. MAXIMUM GLAZING DIMENSIONS SHALL BE 14" x 46" CUTOUT, FASTENED WITH A MINIMUM #8 X 1" SMS: 3X ALONG THE HORIZONTAL AND 3X ALONG THE VERTICAL. SEE DETAIL E ON SHEET 2 FOR ASSEMBLY DETAILS. IF GLAZING IS INSTALLED IN THIRD SECTION, AN ADDITIONAL U-BAR NEEDS TO BE INSTALLED ON THE TOP OF THE SECOND


- 2. NON-IMPACT RESISTANT GLAZING OPTION .090" MINIMUM SSB GLAZING IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS (3X ALONG THE HORIZONTAL AND 2X ALONG THE VERTICAL) INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS)
 MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. MAXIMUM GLAZING DIMENSIONS SHALL BE 15" x 46" CUTOUT, GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.
- 3. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE
- 4. KEY LOCK, SLIDE LOCK, OR OPERATOR REQUIRED.
- 5. FACER STEEL TO HAVE A MINIMUM 29 GA THICKNESS AND BACKER STEEL TO HAVE A MINIMUM
- 6. EACH SECTION HAS AN INTERNAL 1" WIDE X 20 GA CONTINUOUS STEEL STRIP AT THE TOP AND BOTTOM OF THE SECTION.
- 7. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS
- 8. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
- 9. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A 13 GA LHR 7/4 TOP BRACKET WITH A MINIMUM OF (3) 1/4-20x3/4" SELF DRILLING CRIMPTITE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. U-BAR ON TOP SECTION SHALL BE INSTALLED ON TOP OF LHR TOP BRACKETS.

SUPER	IMP	OSED	DESIGN	PRESSURE
LOADS	ON	SUPP	ORTING	STRUCTURE

TO THE OWNER OF THE OWNER OF THE OWNER OF THE OWNER OW								
DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)						
10'-2"	ALL	+152.5/-170.3						
12'-2"	ALL	+182.5/-203.8						
14'-2"	ALL	+212.5/-237.3						
15'-2"	ALL	+227.5/-254.0						
16'-2"	ALL	+242.5/-270.8						

OF TEXAS DWAYNE J KORNISH WAYNE ! KANTON DWAYNE J. KORNISH, PE 4576 COUNTY ROAD 160 MOUNT HOPE, OHIO FL PE 77945 TX PE 117868

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

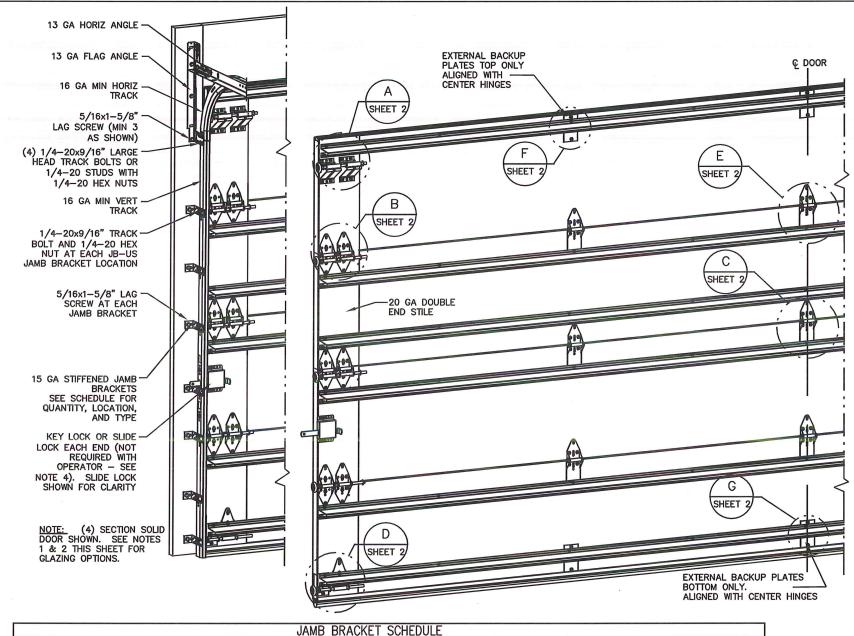

LOCATION OF CENTERLINE OF JAMB DOOR NO. OF BRACKETS BRACKETS MEASURED FROM BOTTOM HEIGHT SECTIONS (EACH JAMB) OF TRACK (ALL DIMENSIONS ± 2") 2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/4" (JB-US)

2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 42" (JB-US), 52-1/2" (JB-US), 63-1/4" (JB-US)

2" (JB-US), 10" (JB-US), 18-3/4" (JB-US), 26-3/4" (JB-US), 36" (JB-US), 45" (JB-US), 54-1/4" (JB-US), 74-1/2" (JB-US)

2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 75-1/2" (JB-US) 7'-0" 4 7'-6" | 4 OR 5 8'-0" | 4 OR 5 SEE NOTE BELOW

(JB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT AS SHOWN ABOVE.

ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

COMPLIES WITH THE REQUIREMENTS OF IBC/IRC 2018.



(850) 474-9890

l.	STATIC PRESSURE RATINGS			APPROVE	ED SIZES	SCALE: N	SIZE: A		
	DESIGN (PSF):	+30.00/-33.50	MAX	WIDTH:	16'-2"		DATE	NAME	
7	TEST (PSF):	+45.00/-50.25	MAX	HEIGHT:	24'-0"	DRAWN	5/20/20	SW	
	IMPACT/CYCLIC	RATED (YES/NO): YES	MAX	SECTION	HEIGHT: 24"	CHECKED	4/1/21	TLC	
	MODELS 190 /490 /160 /593 /594 /591 /592 /596 /599 /5740 /5760 /7560 SHEET 1 OF 3								

MODELS 190/490/160/593/594/591/592/596/599/5740/5760/7560 DIVISION OF OVERHEAD DOOR CORE 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514

WINDLOAD SPECIFICATION OPTION CODE 2242

DRAWING PART NO. REV. 411717 В

REVISIONS

P1 REVISED MODELS PER

GLAZING CROSS-SECTION

REV B - UPDATED PER

SW 9/14/2020

TLC 4/1/21


PCR 32769


SW 2/16/22

REV A - UPDATED


DRAWING TO SHOW


WL008

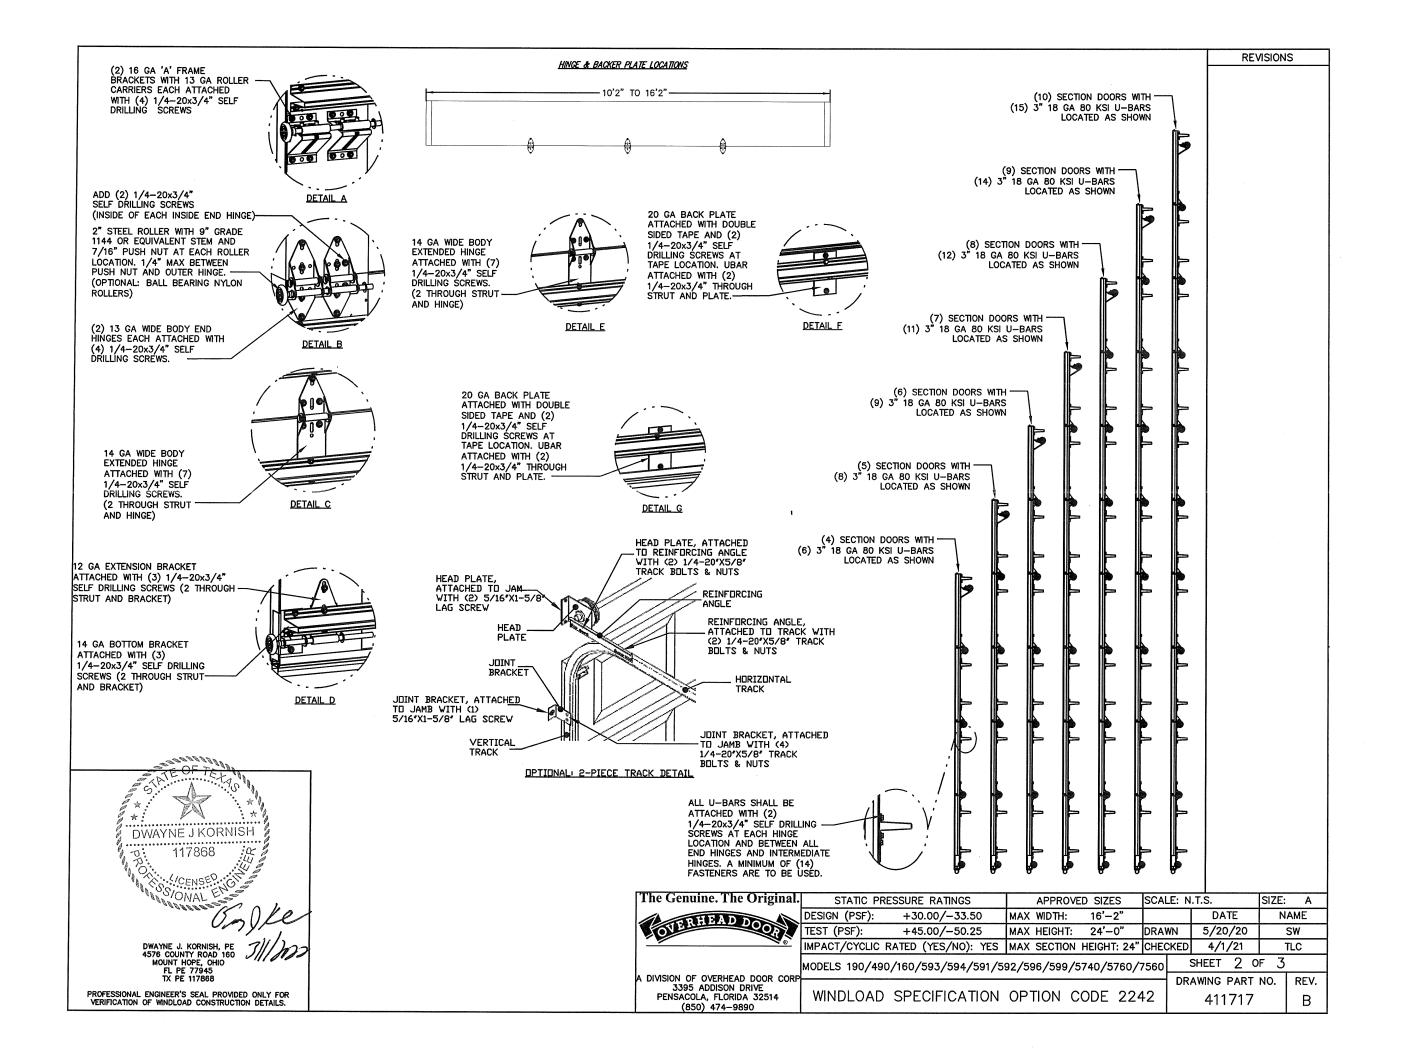

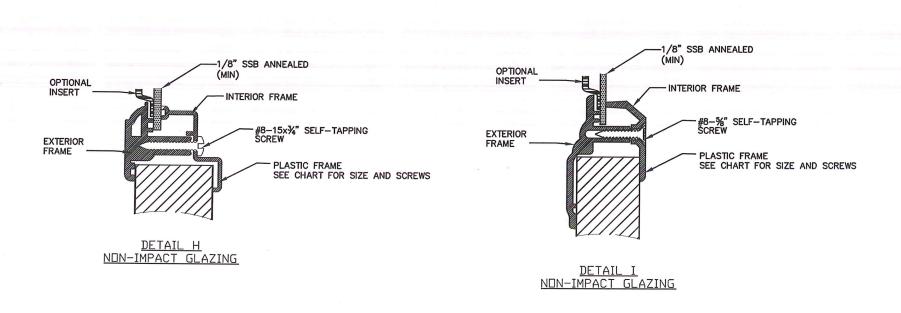

OUTSIDE FRAME SIZE	DAYLIGHT OPENING (DLO)	SCREW QTY EA HORIZ LEG	SCREW QTY EA VERT LEGS	SCREW QTY TOTAL	DETAIL
17"X51"	14X48	5	3	16	Н
15.1X44"	11.5"X40.5"	8	3	22	
14.9X20.8"	11"X17"	3	3	12	
7"X40.8	4"X37.8"	5	2	14	- 1
15.3"X44.1"	11.3"X40.1"	6	3	18	J
14.6"X20.8"	10.6"X16.8"	3	2	10	J
13"X38"	9"X34"	5	2	14	J

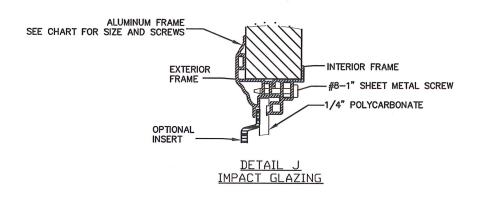



The Genuine. The Original.	STATIC PRESSURE RATINGS		APPROVED SIZES			SCALE: N.T.S.		SIZE:
TRHEAD DO	DESIGN (PSF):	+30.00/-33.50	MAX	WIDTH:	16'-2"		DATE	NAI
	TEST (PSF):		2. 2	HEIGHT:		DRAWN	5/20/20	SI
	IMPACT/CYCLIC	RATED (YES/NO): YES	MAX	SECTION	HEIGHT: 24"	CHECKED	4/1/21	TL
	MODELS 190/490/160/593/594/591/592/596/599/5740/5760/7560					7560	SHEET 3 C)F 3

A DIVISION OF OVERHEAD DOOR CORP 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474–9890

WINDLOAD SPECIFICATION OPTION CODE 2242

DRAWING PART NO. REV. 411717 В

SIZE: A NAME

SW

TLC

REVISIONS