

NOTES:

1. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.

2. SLIDE LOCK OR OPERATOR REQUIRED. LOW HEADROOM REQUIRES A LOCK ON THE LEFT AND RIGHT SIDE OF THE DOOR.

3. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

4. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:
EXTERIOR - 27 GA
INTERIOR - 30 GA

5. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE SOUTHERN PINE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

6. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A DOUBLE LHR TOP BRACKET IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. SEE LHR, DETAIL A, SHEET 2.

7. FOR LOW HEAD ROOM APPLICATIONS, THE UPPERMOST JAMB BRACKET IS OMITTED.

8. GLAZING OPTIONS - .125" MINIMUM GLAZING (ANNEALED) INSTALLED IN TOP SECTION (WITH OR WITHOUT DECORATIVE LITE FRAME DIVIDERS) MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS. MAX CLEAR OPENING 43-1/4" X 19-1/4". SEE DETAIL E, SHEET 3.

9. 11 GA ROLLER SLIDES WITH WELDED ENDS AND 11 GA REINFORCING BRACKETS REQUIRED FOR DOORS >8' TALL.

13 GA HORIZ ANGLE

13 GA FLAG ANGLE

5/16x1-5/8" LAG SCREW EACH HOLE

(4) 1/4-20x9/16" TRACK BOLTS & NUTS

15 GA MIN VERT TRACK

5/16x1-5/8" LAG SCREW AT EACH JAMB BRACKET

1/4-20x9/16" TRACK BOLT AND NUT AT EACH JAMB BRACKET


SECURE LOCK STRIKER PLATE (ONLY REQUIRED WITH SLIDE LOCK) ATTACHED TO TRACK WITH (2) 1/4-20x9/16" TRACK BOLTS AND NUTS WITH ONE BOLT GOING THROUGH BOTH THE STRIKER PLATE AND JAMB BRACKET

SLIDE LOCK EACH END (NOT REQUIRED WITH OPERATOR - SEE NOTE 2)

15 GA JB-1 JAMB BRACKETS. SEE SCHEDULE FOR QUANTITY AND LOCATION.

NOTE: (3) SECTION DOOR SHOWN. SEE PAGE 2 FOR U-BAR LOCATIONS FOR DIFFERENT SECTIONED DOORS.

FASTENERS AT AND MIDWAY BETWEEN ALL INTERMEDIATE HINGE LOCATIONS AND MIDWAY BETWEEN THOSE LOCATIONS. SEE NOTE SHEET 2

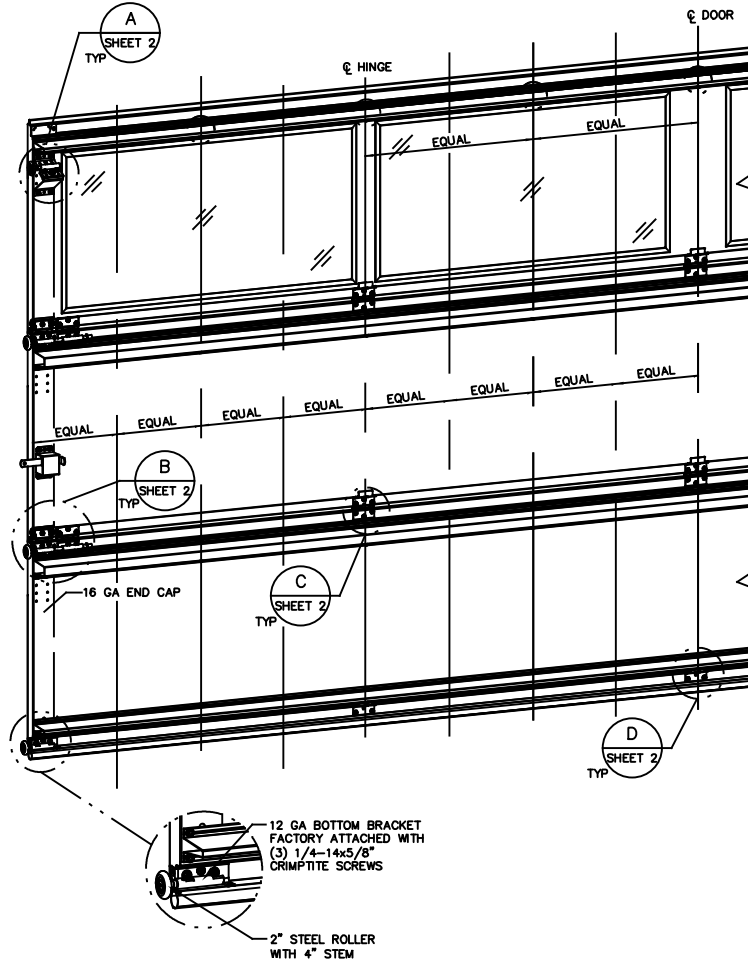

REVISIONS

P01 CREATED NEW DRAWING FOR 4" STRUT WINDLOAD 8-22-16 GAC

P02 ER 31281 REVISED NOMENCLATURE FOR ROLLERS TO 1144 GRADE STEEL 2-3-17 GAC

C UPDATED PER PCR32744. UPDATED REV LEVELS TO ALPHABETICAL 12/8/21 SW

JAMB BRACKET SCHEDULE			
DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
7'-0"	3	6	2", 10", 26", 42", 53", 63"
8'-0"	4	8	2", 10", 26", 39", 48", 57", 66", 75"
> 8'-0"			SEE NOTE BELOW

NOTE: ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE		
DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
18'-0"	7'-0"	+236.7/-263.7
	8'-0"	+236.7/-263.7


Wayne Dalton
A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

This door has been tested per ANSI/DASMA 108

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+26.30/-29.30	MAX WIDTH:	18'-0"	DATE	1-19-16	NAME	GAC
		MAX HEIGHT:	14'-0"	DRAWN		CHECKED	
IMPACT/CYCLIC RATED (YES/NO): NO		MAX SECTION HEIGHT:	28"				
MODELS 9700/9510				SHEET 1 OF 3			
WINDLOAD SPECIFICATION OPTION CODE 0538				DRAWING PART NO.		REV.	
				359175		C	

STANDARD LIFT TRACK


2" STEEL ROLLER WITH 4" STEM WITH PUSHNUT 1/2" FROM SLIDE
 13 GA COMMERCIAL 'A' FRAME TOP BRACKET ATTACHED WITH (4) 1/4-20x7/8" SELF DRILLING SCREWS



13 GA ROLLER SLIDE ATTACHED TO BRACKET WITH 5/16-18 BOLT & NUT IN CENTER SLOT AND 1/4-20x9/16" TRACK BOLT & NUT THROUGH ANY TWO ALIGNING HOLES

2" GRADE 1144 STEEL ROLLER WITH 9" STEM WITH PUSHNUT 1/2" FROM SLIDE
 14GA LHR TOP BRACKET ATTACHED TO DOOR WITH (3) 1/4-20 x 11/16" SELF DRILLING AND (2) #12 X 1/2" PHILLIPS SCREWS

LOW HEADROOM TRACK




13 GA ROLLER SLIDE ATTACHED TO BRACKET WITH (2) 1/4-20 CARRIAGE BOLTS

(7) SECTION DOORS WITH (6) 4" 16 GA & (2) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(2) 15 GA HINGE LEAFS ATTACHED WITH (3) 1/4-14x5/8" CRIMPTITE SCREWS EACH


14 GA HINGE BASE FACTORY ATTACHED TO DOOR WITH (5) 1/4-14x5/8" CRIMPTITE SCREWS
 2" 1144 GRADE OR EQUIVALENT STEEL ROLLER WITH 9" STEM WITH PUSHNUT 1/2" FROM SLIDE



BEFORE U-BAR INSTALLATION

13 GA ROLLER CARRIERS FACTORY ATTACHED TO HINGE BASE AND REINFORCING BRACKET. (EXCEPTION: NOTE #9)

13 GA REINFORCING BRACKET ATTACHED BENEATH HINGE BASE. (EXCEPTION: NOTE #9)




AFTER U-BAR INSTALLATION


POSITION U-BAR OVER REINFORCING BRACKET AND ATTACH WITH (4) 1/4-20x7/8" SELF DRILLING SCREWS PLUS (2) SCREWS BENEATH STRUT

DETAIL B

15 GA HINGE ATTACHED WITH (6) 1/4-14x5/8" CRIMPTITE SCREWS



BEFORE U-BAR INSTALLATION




AFTER U-BAR INSTALLATION

POSITION U-BAR OVER HINGE LEAF AND ATTACH WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS AS SHOWN


DETAIL C

15 GA HINGE BRACKET ATTACHED WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS



BEFORE U-BAR INSTALLATION

POSITION U-BAR OVER HINGE BRACKET AND ATTACH WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS AS SHOWN



AFTER U-BAR INSTALLATION

DETAIL D

UNLESS NOTED OTHERWISE, ALL U-BARS SHALL BE ATTACHED WITH A MINIMUM OF (4) FASTENERS AT EACH END, (2) FASTENERS AT ALL INTERMEDIATE HINGE LOCATIONS, MIDWAY BETWEEN INTERMEDIATE HINGE LOCATIONS, AND MIDWAY BETWEEN THOSE MIDWAY LOCATIONS. (SEE DIAGRAM SHEET 1). ALL FASTENERS USED TO ATTACH U-BARS SHALL BE 1/4-20x7/8" SELF DRILLING.




(4) SECTION DOORS WITH (3) 4" 16 GA & (2) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(3) SECTION DOORS WITH (2) 4" 16 GA & (2) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)


(6) SECTION DOORS WITH (5) 4" 16 GA & (2) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(5) SECTION DOORS WITH (4) 4" 16 GA & (2) 3" 18 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

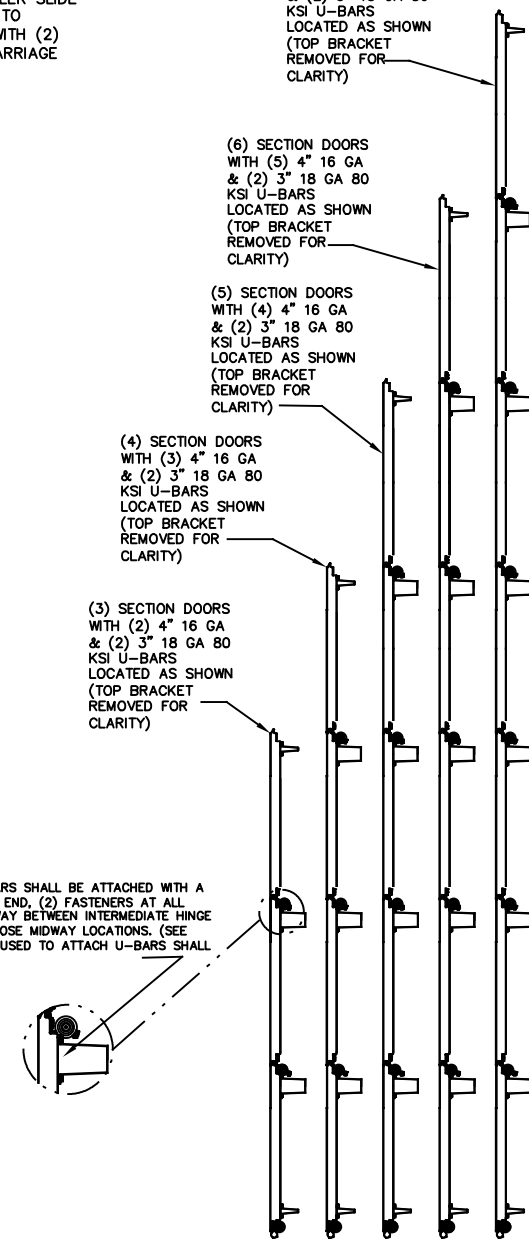

Wayne® Dalton
 A DIVISION OF OVERHEAD DOOR CORP
 3395 ADDISON DRIVE
 PENSACOLA, FLORIDA 32514
 (850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+26.30/-29.30	MAX WIDTH:	18'-0"	DATE	1-19-16	NAME	GAC
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX HEIGHT:	14'-0"	DRAWN		CHECKED	
MODELS 9700/9510				SHEET 2 OF 3			
WINDLOAD SPECIFICATION OPTION CODE 0538				DRAWING PART NO.		REV.	
				359175		C	

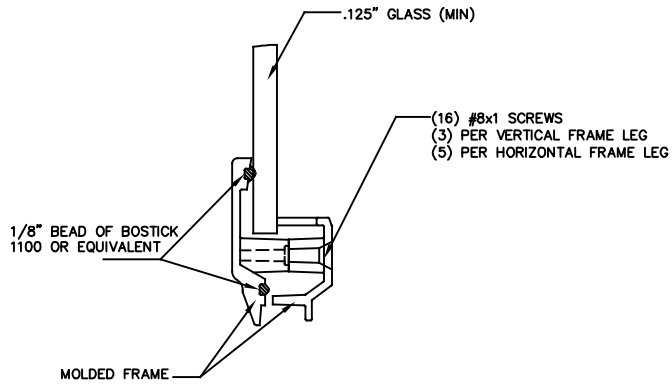

NON-IMPACT PLASTIC FRAME
(STATIC RATED)

DETAIL E

JOHN E. SCATES, PE
2560 KING ARTHUR #124-54
LEWISVILLE, TX 75056
FL PE 51737 TX PE 56308/F-2203

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.



A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+26.30/-29.30	MAX WIDTH:	18'-0"	DATE	NAME		
		MAX HEIGHT:	14'-0"	DRAWN	1-19-16 GAC		
IMPACT/CYCLIC RATED (YES/NO): NO		MAX SECTION HEIGHT: 28"	CHECKED				
MODELS 9700/9510				SHEET 3 OF 3			
WINDLOAD SPECIFICATION OPTION CODE 0538				DRAWING PART NO.	REV.		
				359175	C		