## NOTES:


- 1. NON IMPACT GLAZING OPTIONS: A. 16 X 9.75 CLEAR OPENING INSTALLED TOP OR INTERMEDIATE SECTION.
- B. 36.75 X 9.75 CLEAR OPENING INSTALLED TOP OR INTERMEDIATE SECTION.

GLAZING SSB (0.090") MINIMUM.
MAY INCLUDE DECORATIVE INSERTS NOT AVAILABLE IN MORE THAN ONE SECTION. DOES NOT SATISFY WINDBORNE-DEBRIS.

- 2. IMPACT GLAZING OPTION: 16.75 X 9.75 CLEAR OPENING GLAZING 1/4" GROOVED POLYCARBONATE ALUMINUM FRAMES WITH 10 SCREWS MAY INCLUDE DECORATIVE INSERTS INSTALLED IN TOP OR INTERMEDIATE SECTION. NOT AVAILABLE IN MORE THAN ONE SECTION. SEE ASSEMBLY DETAIL ON SHEET 2.
- 3. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.
- 4. KEY LOCK, SLIDE LOCKS, OR OPERATOR REQUIRED.
- 5. LOUVER OPTION .032" MINIMUM LOUVERS IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS INSTALLED IN THE BOTTOM SECTION. LOUVERS ARE NOT IMPACT RESISTANT AND DO NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS
- 6. SECTION STEEL TO HAVE A MINIMUM 25 GA THICKNESS.
- 7. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
- 8. DOOR JAMB TO BE MINIMUM 2" X 6", GRADE 2 SOUTHERN PINE. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
- 9. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A 13 GA LHR 7/4 TOP BRACKET WITH A MINIMUM OF (3) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. U-BAR ON TOP SECTION SHALL BE INSTALLED ON TOP OF LHR TOP BRACKETS.

## SUPERIMPOSED DESIGN PRESSURE

LOAD	S ON	SUPPORTING STRUCTURE					
DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)					
10'-0"	ALL	+130.0/-145.0					
12'-0"	ALL	+156.0/-174.0					
14'-0"	ALL	+182.0/-203.0					
15'-0"	ALL	+195.0/-217.5					
16'-0"	ALL	+208.0/-232.0					

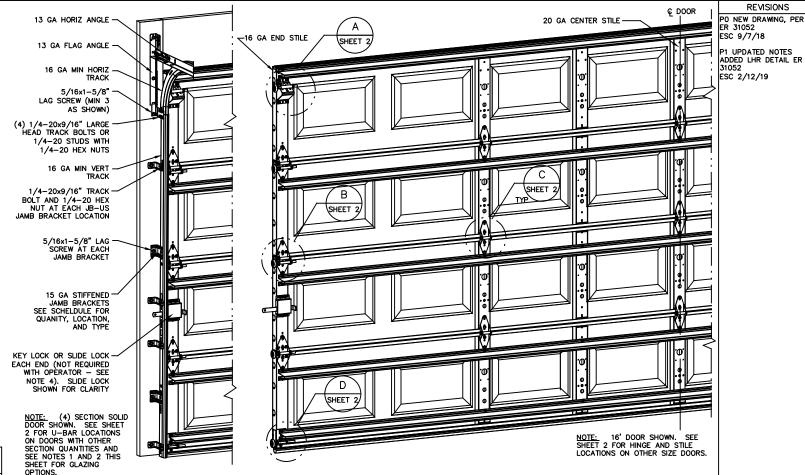

JAMB BRACKET SCHEDULE												
DOOR HEIGHT	INO OF	NO. OF JAMB BRACKETS (EACH JAMB)	I TRACK	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")								
6'-6"	4	6	QI	2" (JB-US), 14" (QI), 23-1/2" (JB-US), 34" (JB-US), 44" (QI), 56" (JB-US)								
6'-6"	4	6	FAT	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/4" (JB-US)								
7'-0"	4	6	QI	2" (JB-US), 14" (QI), 25-1/2" (JB-US), 34" (JB-US), 44" (QI), 63-1/4" (JB-US)								
7'-0"	4	6	FAT	2" (JB-US), 10" (JB-US), 25-3/4" (JB-US), 36" (JB-US), 52-1/2" (JB-US), 63-1/4" (JB-US)								
7'-6"	5	8	QI	2" (JB-US), 14" (QI), 24-1/2" (JB-US), 32-1/2" (JB-US), 43" (QI), 49" (JB-US), 62-1/2" (QI), 72" (JB-US)								
7'-6"	5	8	FAT	2" (JB-US), 10" (JB-US), 22-3/4" (JB-US), 36" (JB-US), 45" (JB-US), 54-1/4" (JB-US), 63" (JB-US), 74-1/2" (JB-US)								
8'-0"	5	8	QI	2" (JB-US), 14" (QI), 23" (JB-US), 34" (JB-US), 46" (QI), 58" (JB-US), 66-1/2" (QI), 75-1/2" (JB-US)								
8'-0"	5	8	FAT	2" (JB-US), 10" (JB-US), 25-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 66" (JB-US), 75-1/2" (JB-US)								
> 8'-0"				SEE NOTE BELOW								

3395 ADDISON DRIVE

(850) 474-9890

NOTE:

FL PE 51737

TX PE 56308/F2203

(JB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT. (QI) FOLLOWING DIMENSION DENOTES QUICK INSTALL JAMB BRACKET INSTALLED IN BUTTERFLY SLOT. NO ADDITIONAL HARDWARE NEEDED TO ATTACH TO TRACK.

ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

GARAGE DOORS JOHN E. SCATES, PE 2560 KING ARTHUR BLVD #124-54 LEWISVILLE, TX 75056 DIVISION OF OVERHEAD DOOR CORE

	STATIC PRESSURE RATINGS			APPROVED SIZES			SCALE: N.T.S.			Α
	DESIGN (PSF):	PESIGN (PSF): +26.00/-29.00		WIDTH:	16'-0"	-0"		DATE	NAME	
	TEST (PSF):	+39.00/-43.50	MAX	HEIGHT:	14'-0"	DRA	٧N	9/17/18	ES	C
м	IMPACT/CYCLIC	RATED (YES/NO): YES	MAX	SECTION	HEIGHT: 21"	CHE	KED		DJ	K

MODELS 8000/8100/8200 WINDLOAD SPECIFICATION OPTION CODE 1126

SHEET 1 OF 2 DRAWING PART NO. REV.

P1

364264

REVISIONS

PO NEW DRAWING, PER

P1 UPDATED NOTES

ER 31052

ESC 9/7/18

ESC 2/12/19

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

PENSACOLA, FLORIDA 32514

