


- 2. IMPACT RESISTANT GLAZING OPTION- IMPACT RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS). GLAZING SHALL BE 1/4" POLYCARBONATE. MAXIMUM GLAZING DIMENSIONS SHALL BE 11" X 17" CUTOUT, FASTENED WITH #8 X 1" SMS: 3X ALONG THE HORIZONTAL AND 2X ALONG THE VERTICAL. SEE DETAIL E ON SHEET 2 FOR ASSEMBLY DETAILS.
- 3. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSIBES
- 4. KEY LOCK, SLIDE LOCKS, OR OPERATOR REQUIRED.
- 5. LOUVER OPTION .032" MINIMUM LOUVERS IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS INSTALLED IN THE BOTTOM SECTION. LOUVERS ARE NOT IMPACT RESISTANT AND DO NOT MEET THE REQUIREMENTS FOR WIND—BORNE DEBRIS REGIONS.
- 6. SECTION STEEL TO HAVE A MINIMUM 25 GA THICKNESS.
- 7. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWNIG.
- 8. DOOR JAMB TO BE MINIMUM 2x6, STRUCTURAL GRADE SOUTHERN PINE. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
- 9. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE (2) 13 GA LHR 7/4 TOP BRACKET WITH A MINIMUM OF (3) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. U-BAR ON TOP SECTION SHALL BE INSTALLED ON TOP OF LHR TOP BRACKETS.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
17'-0"	ALL	+223.6/-250.0
18'-0"	ALL	+236.7/-263.7

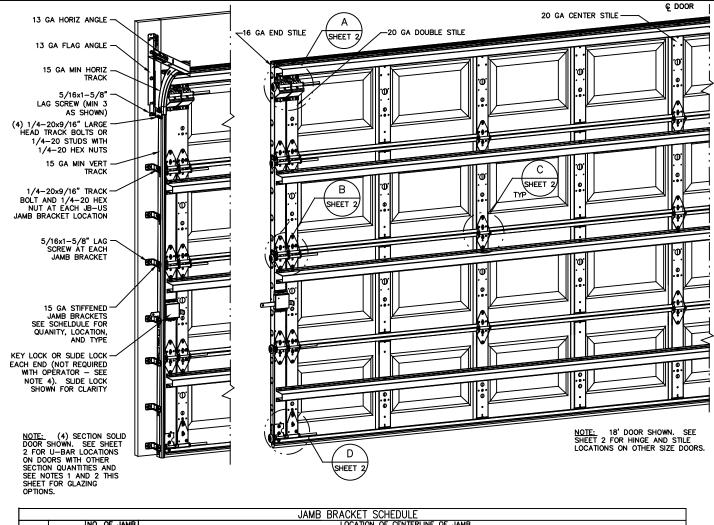

JAMB BRACKET SCHEDULE											
	DOOR	INO OF	NO. OF JAMB BRACKETS	DELOVETO LIELGUIDED COOL DOTTOLL							
	HEIGHT	SECTIONS	(EACH JAMB)								
	6'-6"	4	7	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 30-1/2" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/4" (JB-US)							
	7'-0"	4	7	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 30-1/2" (JB-US), 42" (JB-US), 52-1/2" (JB-US), 63-1/4" (JB-US)							
	7'-6"	5	9	2" (JB-US), 10" (JB-US), 18-3/4" (JB-US), 30-1/2" (JB-US), 36" (JB-US), 45" (JB-US), 54-1/4" (JB-US), 63" (JB-US), 74-1/2" (JB-US)							
	8'-0"	5	9	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 30-1/2" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 66" (JB-US), 75-1/2" (JB-US)							
	> 8'−0*	*		SEE NOTE BELOW							

<u>NOTE:</u> (UB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT AS SHOWN ABOVE.

ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

COMPLIES WITH THE REQUIREMENTS OF IBC/IRC 2018.

Wayne Dalton

DIVISION OF OVERHEAD DOOR CORP 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890

STATIC PRESSURE RATINGS			APPROVED SIZES			SCALE: N.T.S.			Α
DESIGN (PSF):	+26.30/-29.30	MAX	WIDTH:	18'-0"			DATE	NAN	ΜE
TEST (PSF):	+39.45/-43.95	мах	HEIGHT:	14'-0"	DRAWN		10/16/18	ES	С
IMPACT/CYCLIC	RATED (YES/NO): YES	мах	SECTION	HEIGHT: 21"	CHECK	ED	4/12/21	TL	С
	SHEET 1 OF 2								

MODELS 8000/8100/8200
WINDLOAD SPECIFICATION OPTION CODE 1145

DRAWING PART NO. REV.

REVISIONS

PO NEW DRAWING, PER

P1 ADDED 4" STRUTS INSTEAD OF 3" U-BARS

P2 ADDED 80KSI CALL

REV C ADDED IRC/IBC

OUTS TO 4" STRUTS

ER 31052

ESC 10/16/18

ESC 11/12/18

5-2-19 GAC

TLC 4/12/21

NOTE

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

JOHN E. SCATES, PE 2560 KING ARTHUR BLVD #124-54 LEWSVILLE, TX 75056 FL PE 51737 TX PE 56308/F2203

364240

