1. STANDARD GLAZING OPTION - .125" MINIMUM DSB GLAZING MEETS UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. GLAZING SHALL HAVE A MAXIMUM HEIGHT OF 6.70" AND A MAXIMUM LENGTH OF 24.00". GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

2. ALUMINUM FULL VIEW OPTION — ALUMINUM FULL VIEW SECTION MAY REPLACE ANY SECTION EXCEPT TOP AND BOTTOM PANELS. ALUMINUM FULL VIEW SECTION SHALL HAVE RAILS AND STILES OF EXTRUDED ALUMINUM ALLOY 6063-T6 WITH A 2-1/4" INTEGRAL FIN AND .125" MINIMUM DSB GLAZING INSTALLED WITH ALUMINUM RETAINERS IN ORDER TO MEET UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. AFV PANEL SIZE IS 45.5"x21.9" (MAX). GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

3. MINIMUM OF 1" OVERLAP ON BOTH JAMBS REQUIRED TO MEET NEGATIVE DESIGN PRESSURES.

4. SLIDE LOCK OR OPERATOR REQUIRED.

C2400 - 25 GA

- 5. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS: C20 - 20 GA C24 - 24 GA
- 6. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
- 7. TRACK CLIPS SHALL BE LOCATED WITH CENTERLINE OF BOTTOM CLIP SPACED 10" MAX FROM BOTTOM OF TRACK AND REMAINING TRACK CLIPS SPACED AT 24" O.C. MAX. SPACING BETWEEN TOP TRACK CLIP AND SPLICE PLATE SHALL BE 30" O.C. MAX.
- 8. WHEN MOUNTING TO WOOD, DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

SECTION QUANTITIES AND SEE NOTES & 2 THIS SHEET FOR GLAZING

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

MAX DOOR WIDTH	DOOR HEIGHT	MAX UNIFORM LOAD EACH JAMB (PLF)
14'-2"	ALL	+80.8/-90.0

J. C. VOELKEL

13 GA HORIZ ANGLE -15 GA MIN HORIZ TRACK 13 GA CONTINUOUS WALL ANGLE 15 GA MIN VERT TRACK 5/16"x1-5/8" LAG SCREW AT EACH HOLE LOCATION FOR WOOD SUBSTRATE. SEE SHEET 3 FOR MOUNTING TO OTHER SUBSTRATES. 1/4-20x9/16" TRACK BOLT AND 1/4-20 HEX NUT AT EACH TRACK CLIP LOCATION (SEE DETAIL A SHEET 3) 11 GA TRACK CLIPS (WELDED, BOLTED, OR RIVETED TO WALL ANGLE) SEE NOTE 7 AND DETAIL F SHEET 3 SLIDE LOCK ONE END (NOT REQUIRED WITH OPERATOR - SEE NOTE 4)

NOTE: (4) SECTION SOLID DOOR SHOWN. SEE SHEET 2 FOR U-BAR LOCATIONS ON DOORS WITH OTHER


THE DOORS ARE DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2018 IRC AND THE 2018 IBC. STATIC PRESSURE RATINGS APPROVED SIZES SCALE: N.T.S. SIZE: A DESIGN (PSF): +15.90/-18.20 MAX WIDTH: 14'-2" DATE NAME 24'-1" 11/12/20 TEST (PSF): +23.85/-27.30 MAX HEIGHT: TLC IMPACT/CYCLIC RATED (YES/NO): NO MAX SECTION HEIGHT: 24" CHECKED 4/28/21 TLC SHEET 1 OF MODELS C20/C24/C2400 DRAWING PART NO. REV. WINDLOAD SPECIFICATION OPTION CODE 2032 365576

REVISIONS

REV - INITIAL DRAWING

REV A — ADDED SIZE OF AFV PANEL


TLC 11/12/20

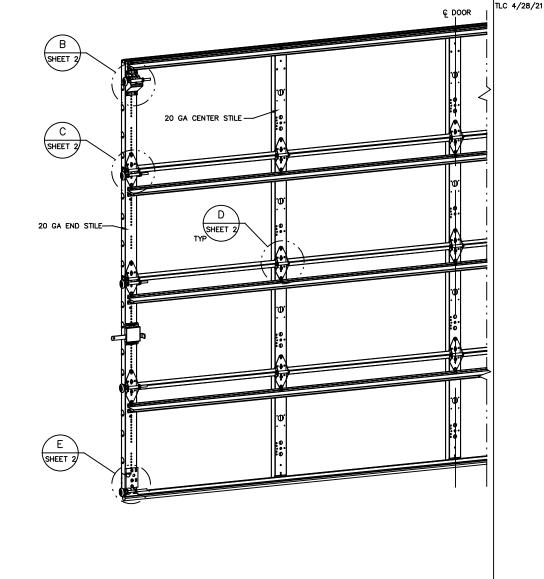



Wayne


DIVISION OF OVERHEAD DOOR CORE 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890

J. CHRISTIAN VOELKEL, PE 312 N. NEW WARRINGTON ROAD, UNIT 1A FI PF 82229 PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

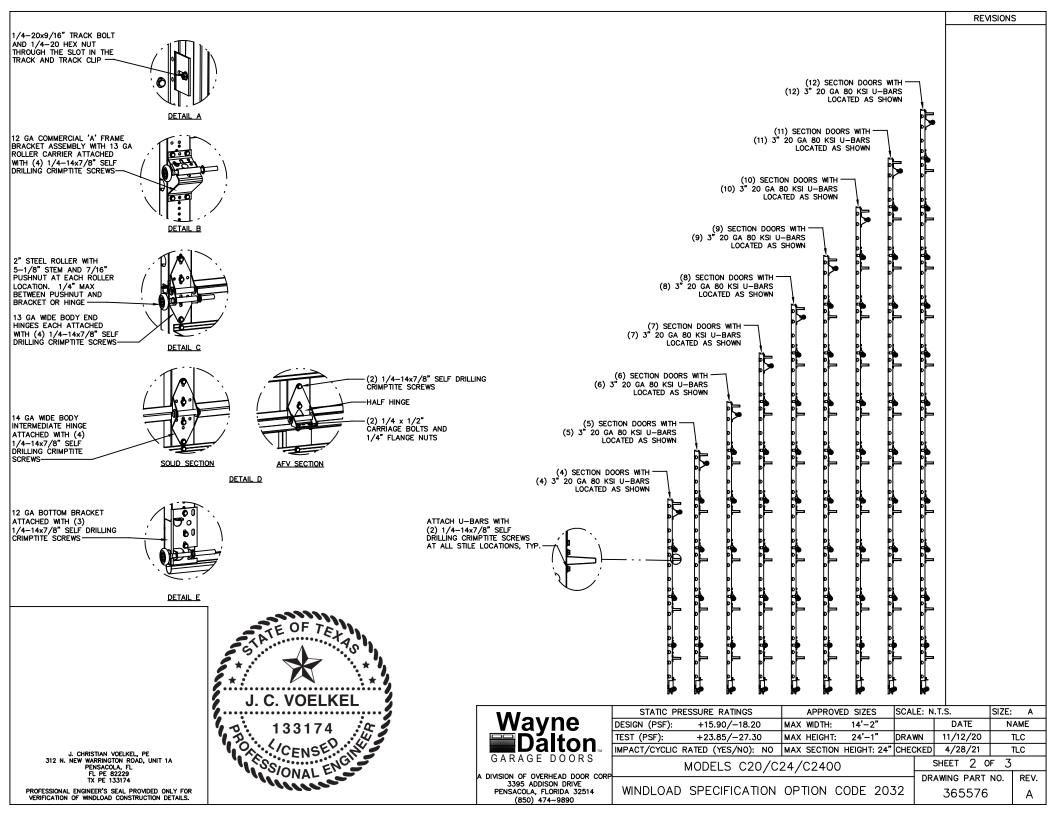

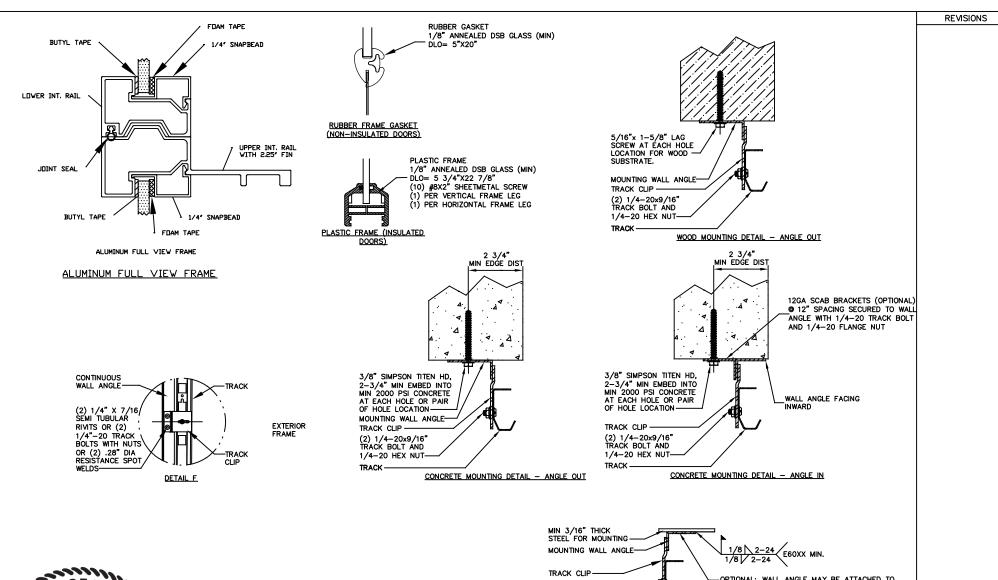







DIVISION OF OVERHEAD DOOR COR 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890

	STATIC PRESSURE RATINGS			APPROVED SIZES SCAI				LE: N.T.S.		Α		
	DESIGN (PSF): +15.90/-18.20		MAX	WIDTH:	14'-2"			DATE		NAME		
	TEST (PSF):	+23.85/-27.30	MAX	X HEIGHT:	24'-1"	DRAW	v 1	1/12/20	TLC			
	IMPACT/CYCLIC	RATED (YES/NO): NO	мах	SECTION	HEIGHT: 24"	CHECK	ŒD	4/28/21	1	ΓLC		
	MODELS C20/C24/C2400							SHEET 3 OF 3				
₹P							DRAWING PART		NO.	REV.		
	WINDLOAD	SPECIFICATION	OP.	TION C	ODE 203	32	,	365576		Α		