1. NON-IMPACT RESISTANT OPTION - .125" MINIMUM DSB GLAZING MEETS UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. 13 GA HORIZ ANGLE -GLAZING SHALL HAVE A MAXIMUM HEIGHT OF 6.70" AND A MAXIMUM LENGTH OF 24.00". GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR

2. IMPACT RESISTANT GLAZING OPTION -IMPACT RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN INTERMEDIATE SECTIONS (WITH OR WITHOUT DECORATIVE INSERTS). GLAZING SHALL BE 1/4" POLYCARBONATE. MAXIMUM GLAZING DIMENSIONS SHALL BE 11" x 17", FASTENED WITH A MINIMUM #8 X 1" SMS: 3X ALONG THE HORIZONTAL AND 2X ALONG THE

WIND-BORNE DEBRIS REGIONS.

3. ALUMINUM FULL VIEW OPTION - ALUMINUM FULL VIEW SECTION MAY REPLACE ANY SECTION EXCEPT TOP AND BOTTOM PANELS. ALUMINUM FULL VIEW SECTION SHALL HAVE RAILS AND STILES OF EXTRUDED ALUMINUM ALLOY 6063-T6 AND .125" MINIMUM DSB GLAZING INSTALLED WITH ALUMINUM RETAINERS IN ORDER TO MEET UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. AFV PANEL SIZE IS 45.5"x21.9" (MAX). GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

4. MINIMUM OF 1" OVERLAP ON BOTH JAMBS REQUIRED TO MEET NEGATIVE DESIGN PRESSURES.

5. SLIDE LOCK OR OPERATOR REQUIRED.

6. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS: C20 - 20 GA C24 - 24 GA C2400 - 25 GA


7. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

8. TRACK CLIPS SHALL BE LOCATED WITH CENTERLINE OF BOTTOM CLIP SPACED 10" MAX FROM BOTTOM OF TRACK AND REMAINING TRACK CLIPS SPACED AT 24" O.C. MAX. SPACING BETWEEN TOP TRACK CLIP AND

SPLICE PLATE SHALL BE 30" O.C. MAX. 9. WHEN MOUNTING TO WOOD, DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE. J. C. VOELKEL

> J. CHRISTIAN VOELKEL, PE 312 N. NEW WARRINGTON ROAD, UNIT 1A PENSACOLA, FL TX PF 133174

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

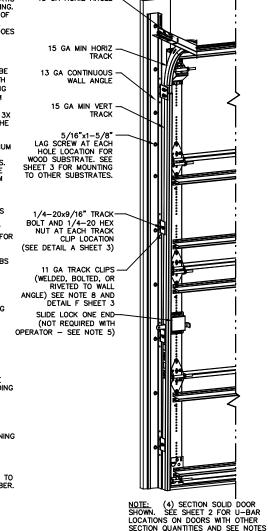

				PRESSURE
LOAD	S ON	SUPF	ORTING	STRUCTURE
MAX DOOR	DOOR HEIGHT	мах	UNIFORM LO	DAD EACH JAMB

10'-4" ALL

1, 2, & 3 OF THIS SHEET FOR GLAZING OPTIONS.

+193.1/-218.9

SHEET 2 20 GA CENTER STILE SHEET 2 20 GA WOOD FILLED SHEET END STILE SHEET

THE DOORS ARE DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2018 IRC AND THE 2018 IBC.

GARAGE DOORS

A DIVISION OF OVERHEAD DOOR C
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

	STATIC PRESSURE RATINGS			APPROVED SIZES SCA			ALE: N.T.S.		SIZE:	Α
	DESIGN (PSF): +37.50/-42.50 TEST (PSF): +56.25/-63.75		MAX	WIDTH:	10'-4"			DATE	NAME	
			MAX HEIGHT: 24'-1"		24'-1"	DRAWN		2/28/20	TLC	
	IMPACT/CYCLIC	RATED (YES/NO): YES	мах	SECTION	HEIGHT: 24"	CHEC	KED	4/28/21	1	ΓLC
	MODELS C20/C24/C2400							EET 1 0	F 3	
RP	, ,						DRAW	ING PART	NO.	REV.
	WINDLOAD	SPECIFICATION SPECIFICATION	Ob.	TION C	ODE 207	74		365601		Α

REVISIONS

REV - INITIAL DRAWING

REV A — ADDED SIZE OF AFV PANEL

TLC 12/28/20

TLC 4/28/21

€ DOOR

