

ANDERSEN CORPORATION

A-SERIES PICTURE & FIXED TRANSOM WINDOWS (IMPACT)



100 FOURTH AVE. NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **INSTALLATION CLIP:** FOR INSTALLATION INTO WOOD FRAMING USE TWO (2) #10 WOOD SCREWS PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. **INSTALLATION CLIP:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE TWO (2) #10-16 GR. 5 SELF-TAPPING SCREW PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
7. **INSTALLATION CLIP:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE TWO (2) 3/16 INCH DIAMETER ITW TAPCONS OR ONE (1) 1/4 INCH DIAMETER ITW TAPCON PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1-1/4 INCH MINIMUM EMBEDMENT. ANCHORS SHALL BE INSTALLED THROUGH CLIP SUCH THAT A MINIMUM 1-3/4" O.C. SPACING IS MAINTAINED.
8. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
9. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
10. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
11. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
12. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.42.
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - C. GROUT-FILLED CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
 - D. HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - E. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 35.9 MIL (0.0359" or 20 GAUGE). MIN. 1/2" EDGE DISTANCE.
 - F. ALUMINUM - MINIMUM ALLOY 6063-T5. MINIMUM WALL THICKNESS OF 0.078". MIN. 1/2" EDGE DISTANCE.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2006 INTERNATIONAL BUILDING CODE (IBC) AND INTERNATIONAL RESIDENTIAL CODE (IRC) WITH 2006 TEXAS REVISIONS, EFFECTIVE JANUARY 1, 2008 AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-05/08
 - ASTM E1886-02/05
 - ASTM E1996-02/05
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: PINE
7. CLADDING MATERIAL: FIBERGLASS
8. WOOD COMPONENTS SHALL HAVE BEEN PRESERVATIVE TREATED OR SHALL BE OF A DURABLE SPECIES.
9. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 4 FOR GLAZING DETAILS.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION & GENERAL NOTES
2	-	ELEVATION, ANCHOR LAYOUTS, & ASSEMBLY NOTES
3	-	VERTICAL SECTIONS
4	-	HORIZONTAL SECTIONS & GLAZING OPTIONS
5	-	BILL OF MATERIALS & COMPONENTS

OVERALL SIZE		DESIGN PRESSURE	MIN. GLAZING OPTION	MISSILE IMPACT RATING
WIDTH	HEIGHT			
55 1/4"	55 1/4"	+70/- 70 PSF	OPTION 1 OR 2	LARGE & SMALL MISSILE IMPACT
71 1/4"	79 1/4"	+70/- 70 PSF	OPTION 3 OR 4	LARGE & SMALL MISSILE IMPACT
71 1/4"	95 1/4"	+65/- 65 PSF	OPTION 3	LARGE & SMALL MISSILE IMPACT

TITLE: A-SERIES PICTURE & FIXED TRANSOM WINDOWS INSTALLATION & GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS	DESCRIPTION	NO.	BY	DATE




DATE: 08.06.12
DWN BY: MSS
CHK BY: HFN
SCALE: NTS

DWG #: **AWD067**

SHEET: **1 OF 5**

I:\bdlf-csv\common\projects\andersen\windows\12-0631 (rd) submit\12-0631 - windows and doors\awd067 a series pw (in) drops.awd067.dwg




100 FOURTH AVE. NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: A-SERIES PICTURE &
FIXED TRANSOM WINDOWS
ELEVATIONS, ANCHOR LAYOUTS,
& ASSEMBLY NOTES

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-9478 FX: (954) 744-4738

ANCHOR LEGEND	
—	INSTALLATION CLIP LOCATION.

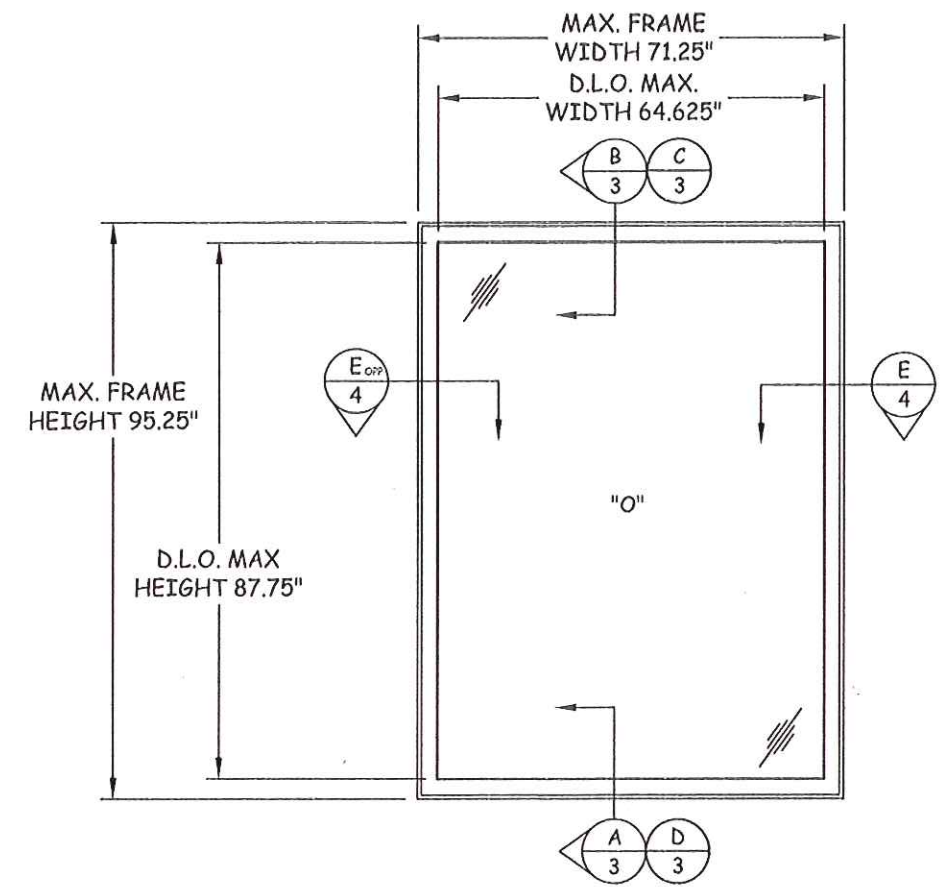

ELEVATION

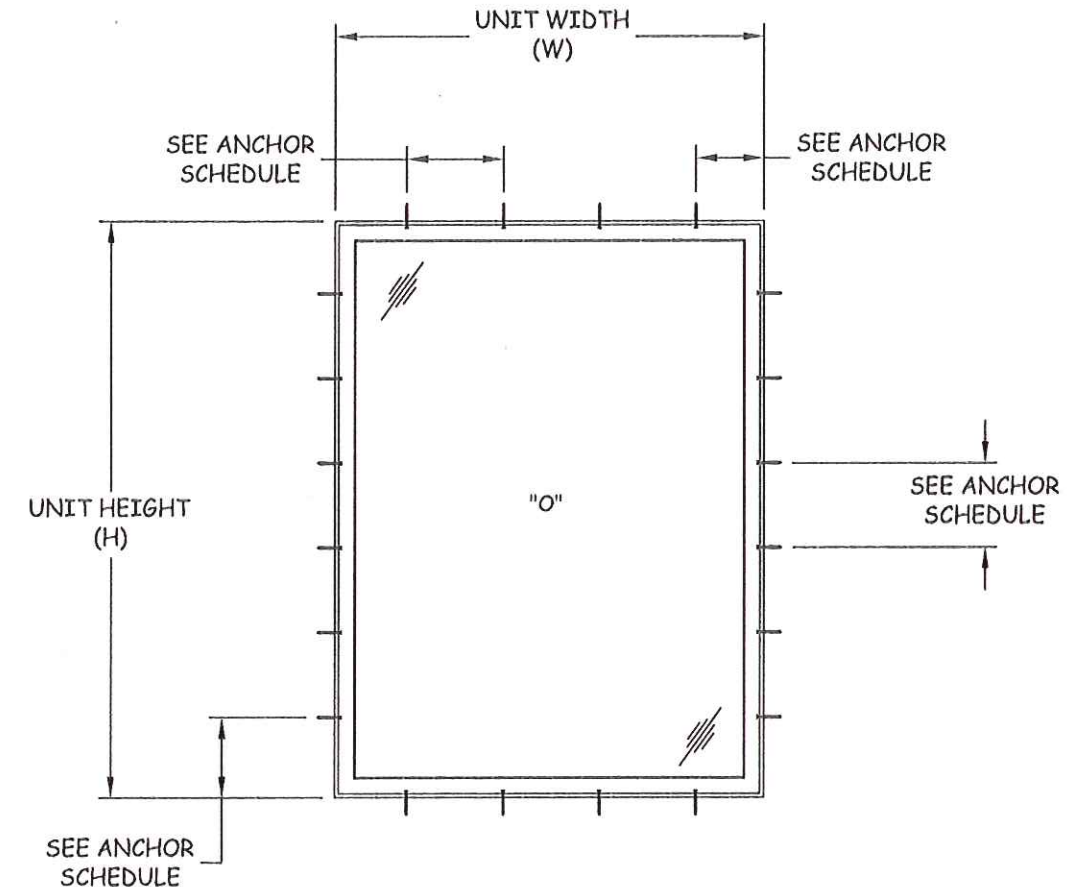


TYPICAL ANCHOR LAYOUT

INSTALLATION CLIP

ASSEMBLY NOTES:

- 1) INSIDE TRIM STOPS SHALL BE SECURED WITH 7/16" X 1-1/2" STAPLES 3" FROM CORNERS AND 10" O.C. THEREAFTER.
- 2) FRAME MEMBERS SNAP-FITS INTO FRAME CLADDING AND IS FASTENED WITH 7/16" X 1" STAPLES 3" FROM CORNERS AND 10" O.C. THEREAFTER.
- 3) TRIM STOPS SHALL BE SECURED WITH VINYL SPLINE.

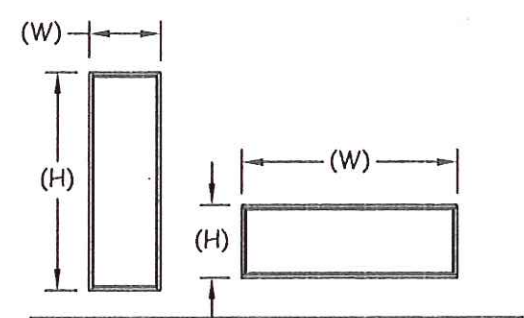

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA. ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT.

ANCHOR SCHEDULE - HEAD/SILL		ANCHOR SCHEDULE - JAMBS	
WIDTH (W)	QUANTITY OF CLIPS	HEIGHT (H)	QUANTITY OF CLIPS
$W > 63.25"$	4	$H > 79.25"$	6
$51.25" < W \leq 63.25"$	3	$71.25" < H \leq 79.25"$	5
$35.25" < W \leq 51.25"$	2	$63.25" < H \leq 71.25"$	4
$W \leq 35.25"$	1	$51.25" < H \leq 63.25"$	3
		$35.25" < H \leq 51.25"$	2
		$H \leq 35.25"$	1

ANCHOR SCHEDULE NOTES:

- 1) INSTALLATION CLIPS SHALL BE LOCATED 12" FROM CORNERS AND EQUALLY SPACED THEREAFTER.
- 2) IF ONE INSTALLATION CLIP IS SPECIFIED, THE CLIP SHALL BE LOCATED AT MIDSPAN OF JAMB.

NO.	DESCRIPTION	BY	DATE




DATE: 08.06.12
DWN BY: MSS
CHK BY: HFN
SCALE: NTS
DWG #: **AWD067**
SHEET: **2 OF 5**




100 FOURTH AVE. NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES PICTURE &
FIXED TRANSOM WINDOWS
VERTICAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

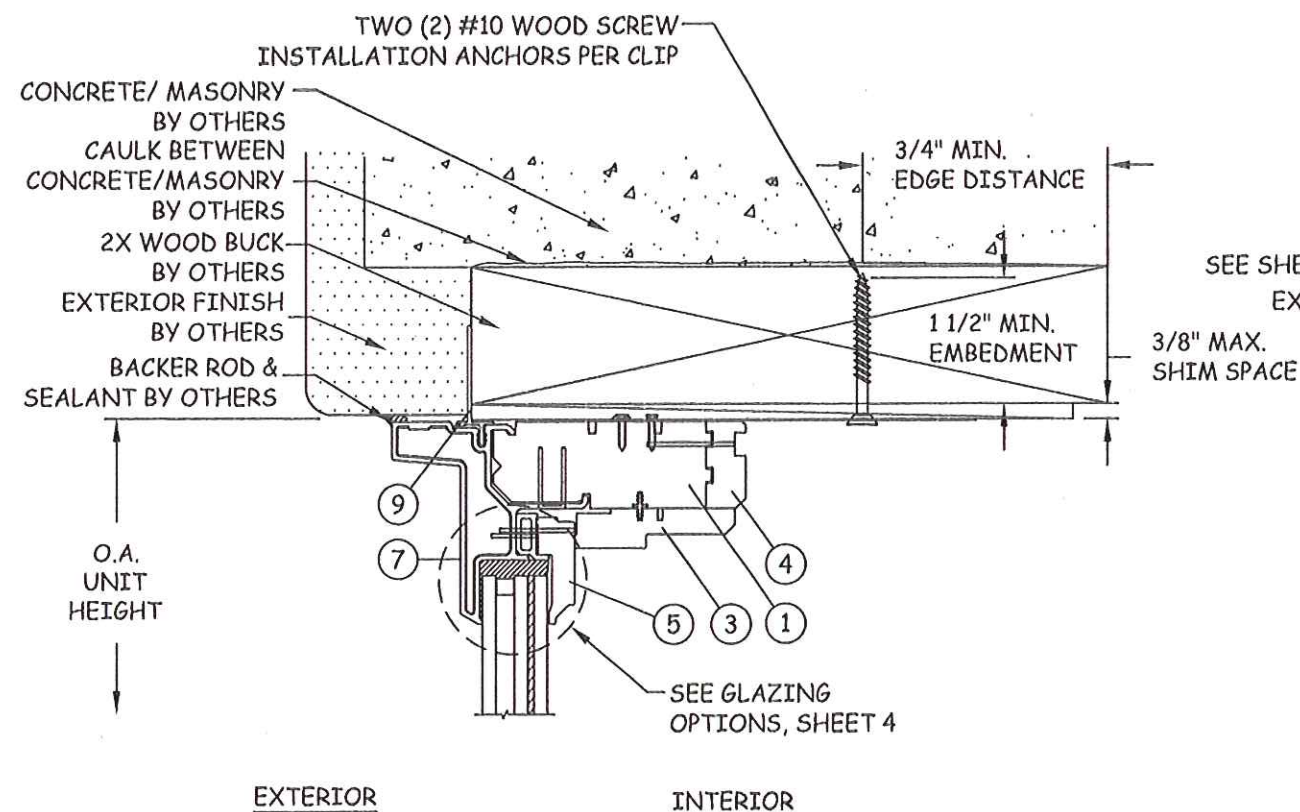


B
3 VERTICAL SECTION
HEAD - 2X WOOD BUCK
APW

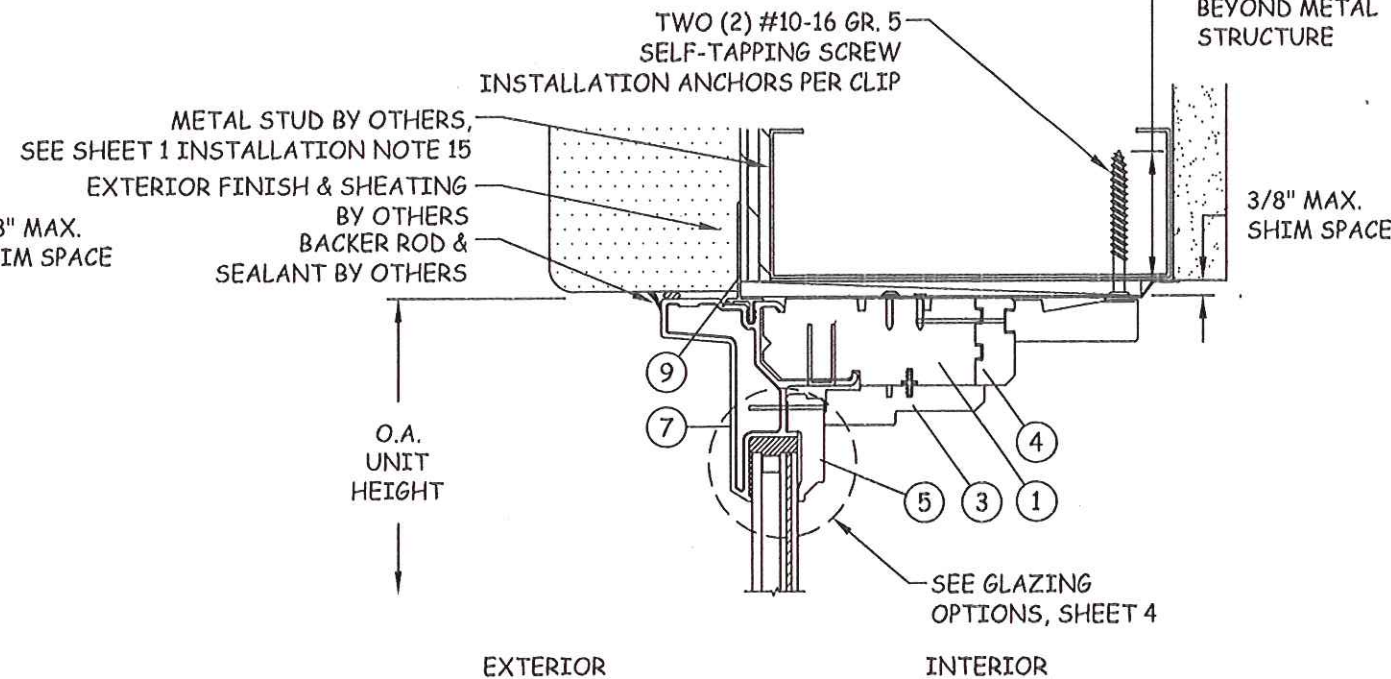

C
3 VERTICAL SECTION
HEAD - METAL STUD
ATF

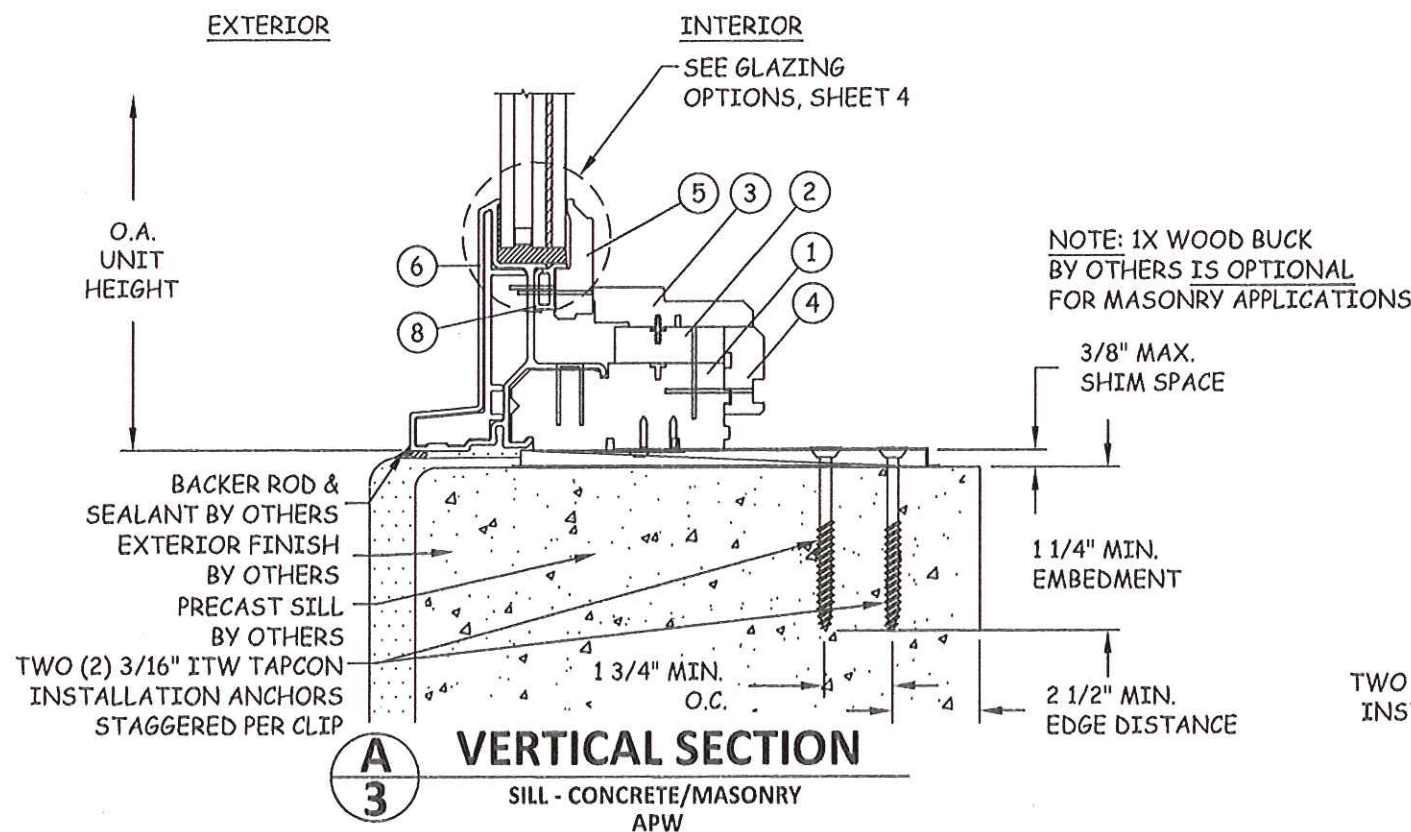


A
3 VERTICAL SECTION
SILL - CONCRETE/MASONRY
APW

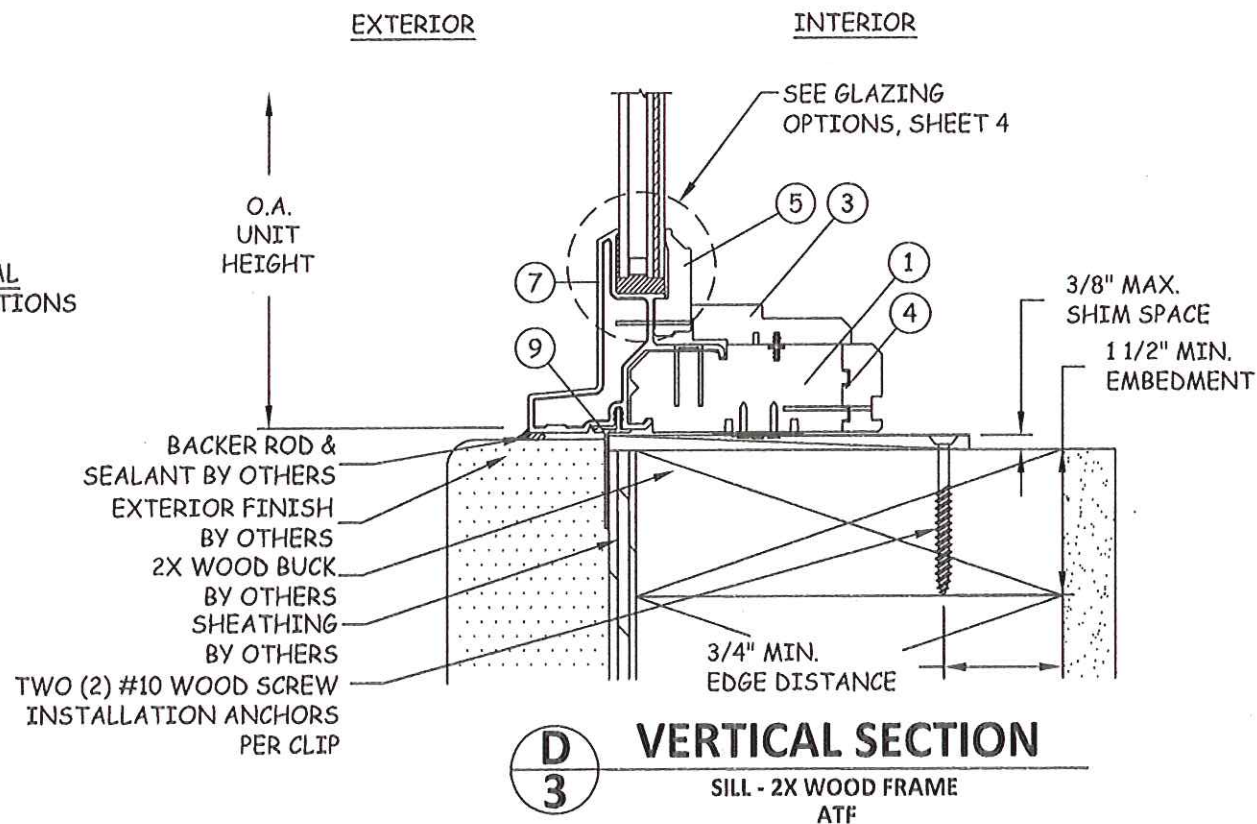

D
3 VERTICAL SECTION
SILL - 2X WOOD FRAME
ATF

REVISIONS

NO.	DESCRIPTION	BY	DATE

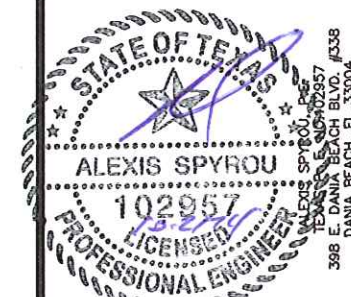


DATE: 08.06.12
DWN BY: MSS
CHK BY: HFN
SCALE: NTS
DWG #: AWD067
SHEET: 3 OF 5




100 FOURTH AVE. NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: A-SERIES PICTURE & FIXED TRANSOM WINDOWS HORIZONTAL SECTIONS & GLAZING OPTIONS
PREPARED BY: BUILDING DROPS, INC. 398 E. DANIA BEACH BLVD. #338 DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

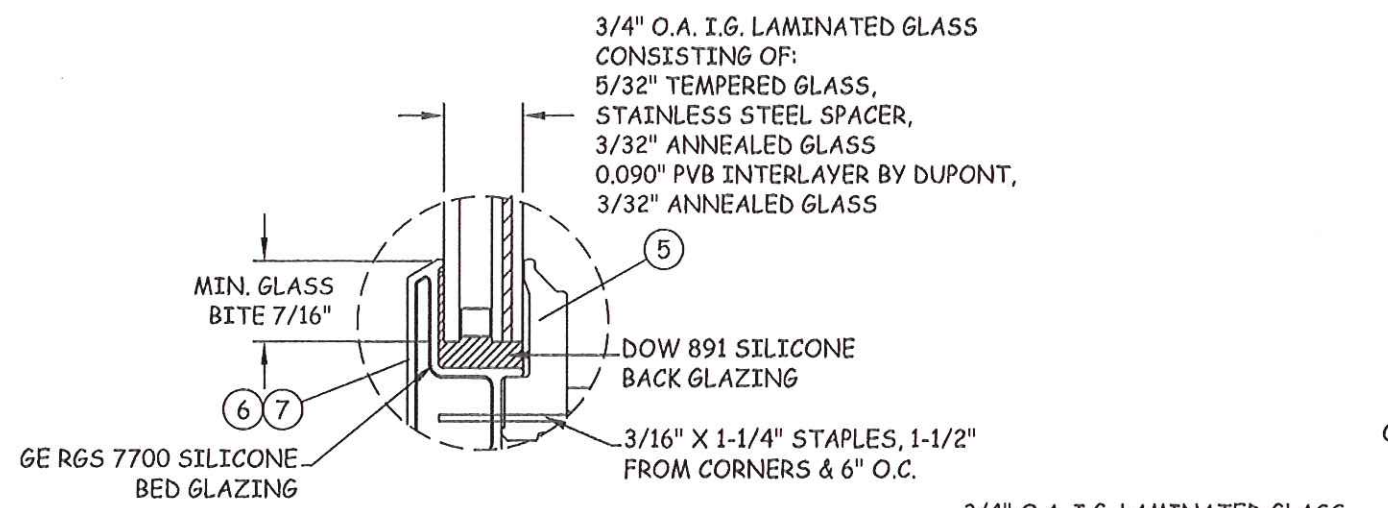


GLAZING OPTION 1
FOR USE IN UNITS UP TO 21.2 SQ. FT.

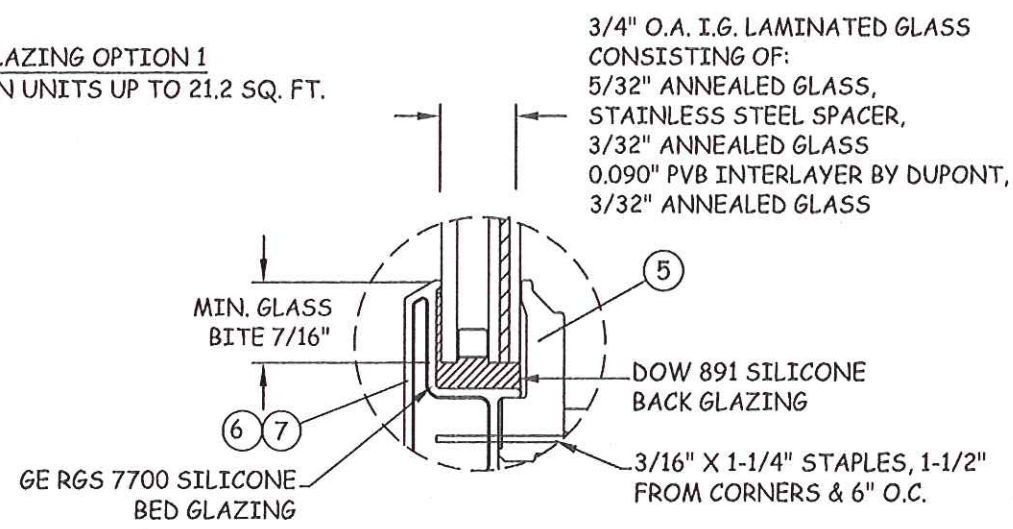


GLAZING OPTION 2
FOR USE IN UNITS UP TO 21.2 SQ. FT.

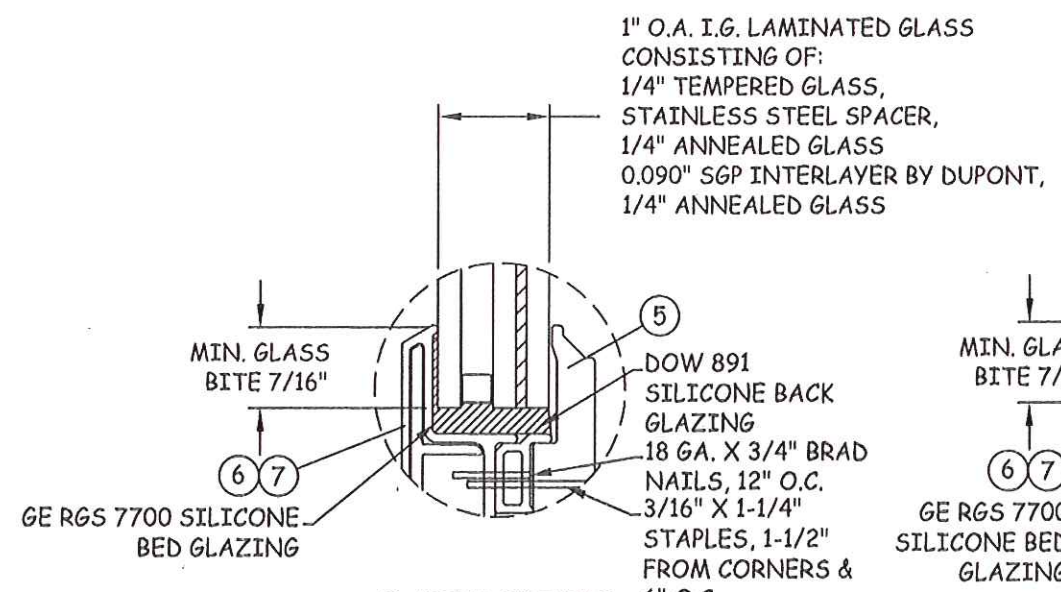

GLAZING OPTION 3
FOR USE IN UNITS UP TO 47.1 SQ. FT.

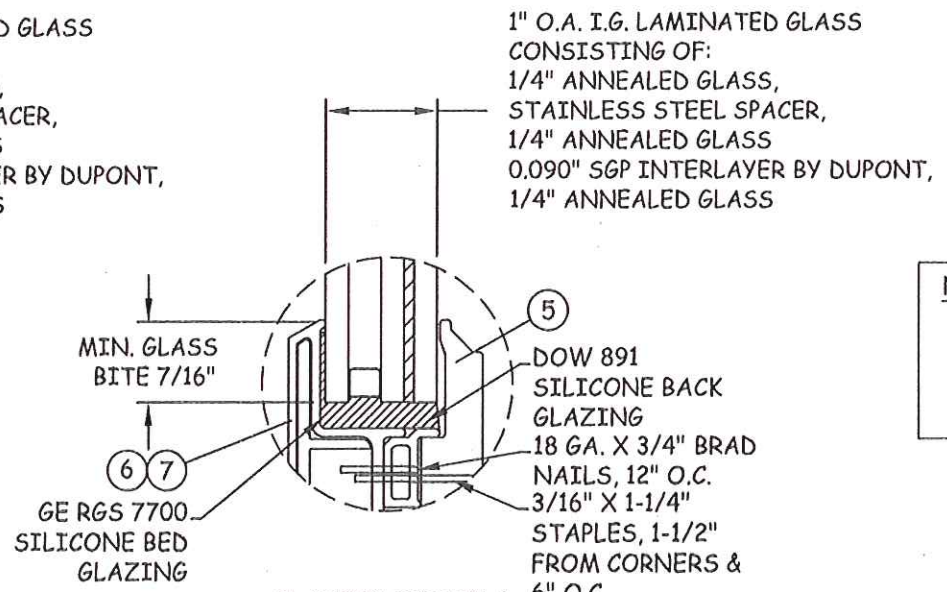


GLAZING OPTION 4
FOR USE IN UNITS UP TO 39.2 SQ. FT.

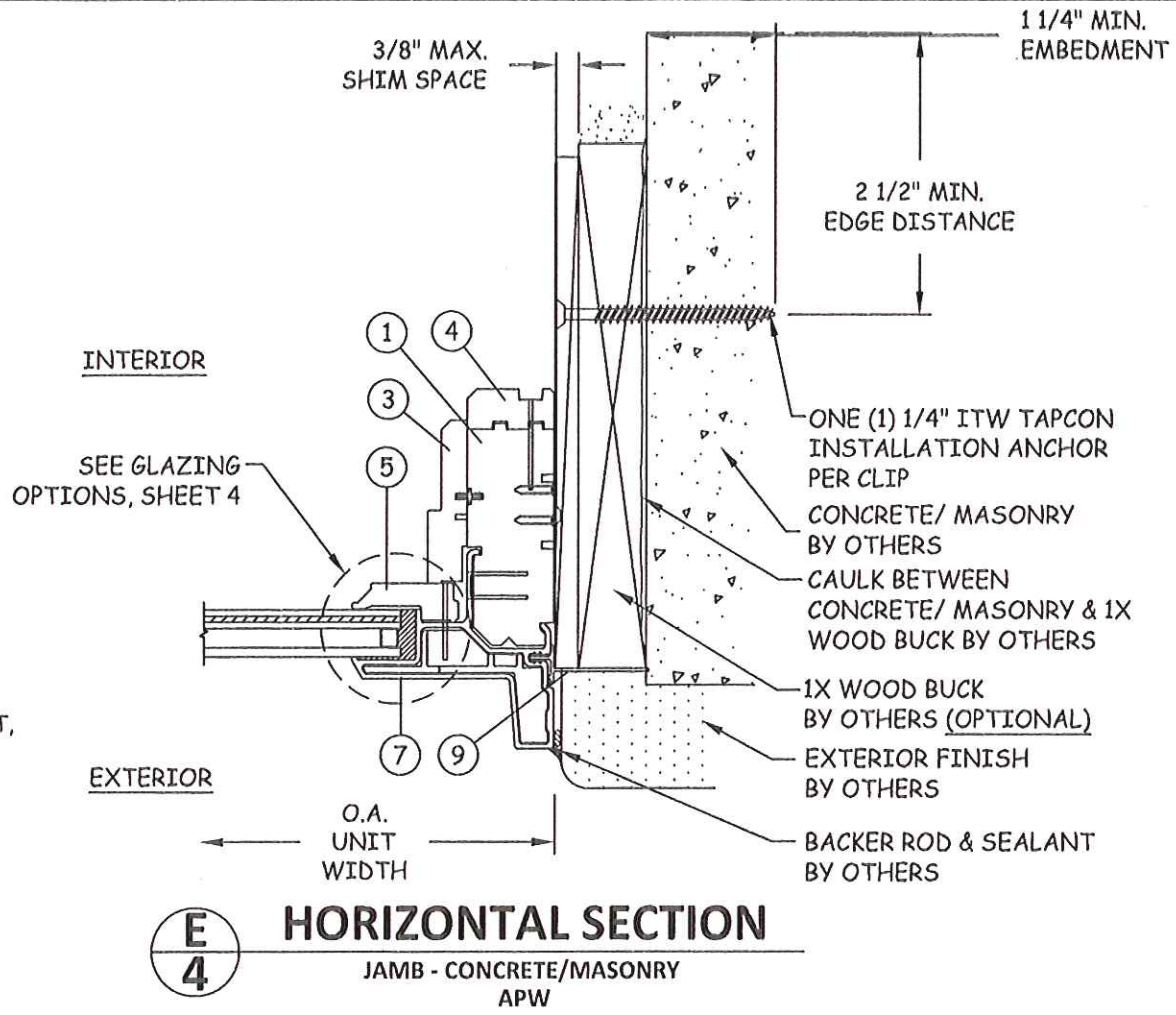

NOTE:
1) FOR INSTALLATION ABOVE 30 FT. ABOVE GRADE IN AREAS REQUIRING IMPACT RESISTANCE, ALL UNITS MUST BE SAFETY GLAZED OR COVERED BY AN IMPACT PROTECTIVE SYSTEM PER IBC SECTION 2406.

NO.	DESCRIPTION	BY	DATE

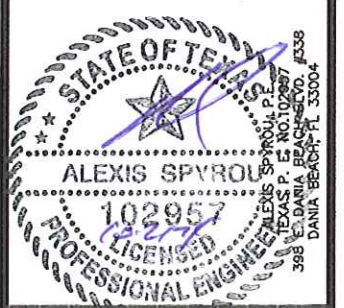


DATE: 08.06.12
DWN BY: MSS
CHK BY: HFN
SCALE: NTS
DWG #: AWD067
SHEET: 4 OF 5


BILL OF MATERIALS			
ITEM #	DESCRIPTION	MATERIAL	MANUFACTURER
1	FRAME	WOOD	ANDERSEN
2	SILL FILLER BLOCK - APW	WOOD	ANDERSEN
3	TRIM STOP	WOOD	ANDERSEN
4	INSIDE TRIM STOP	WOOD	ANDERSEN
5	GLAZING STOP	WOOD	ANDERSEN
6	FRAME CLADDING - APW SILL	FIBERGLASS	ANDERSEN
7	FRAME CLADDING - APW/ATF	FIBERGLASS	ANDERSEN
8	GLASS SPACER - 1" GLAZING	RIGID PVC	ANDERSEN
9	NAILING FLANGE	RIGID PVC	ANDERSEN
10	INSTALLATION CLIP	304 SS	ANDERSEN

NOTE: ALL WOOD COMPONENTS ARE PINE


3 TRIM STOP WOOD

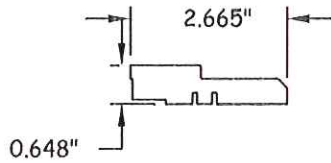


4 INSIDE TRIM STOP WOOD

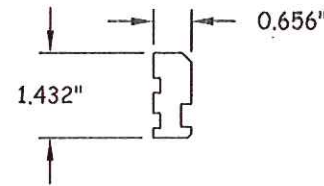


5 GLAZING STOP WOOD




6 FRAME CLADDING - APW SILL FIBERGLASS

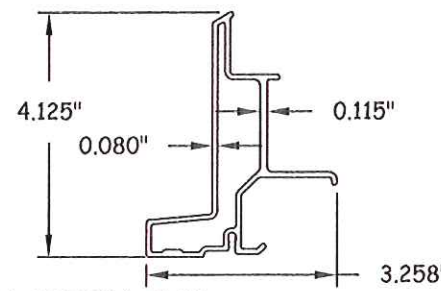


7 FRAME CLADDING - APW/ATF FIBERGLASS

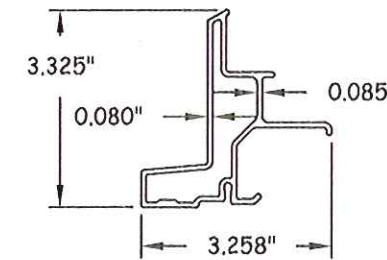


8 GLASS SPACER - 1" GLAZING RIGID PVC

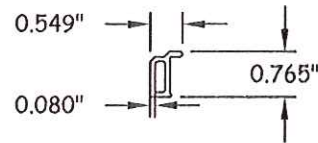

9 NAILING FLANGE RIGID PVC




10 INSTALLATION CLIP 304 SS

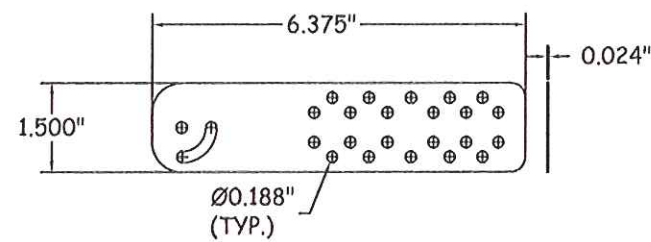


NOTE: INSTALLATION CLIPS SHALL BE ATTACHED TO WINDOW FRAME WITH TWO (2) #8 X 5/8" SCREWS

1 FRAME WOOD

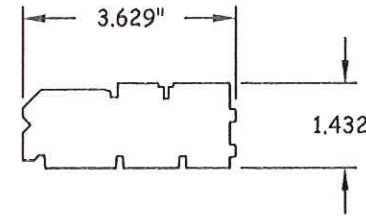

2 SILL FILLER BLOCK - APW WOOD

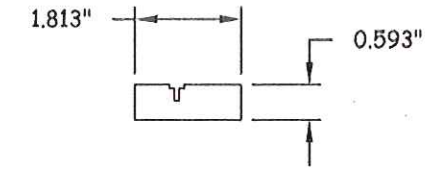


100 FOURTH AVE. NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES PICTURE &
FIXED TRANSOM WINDOWS
BILL OF MATERIALS &
COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS

NO.	DESCRIPTION	BY	DATE

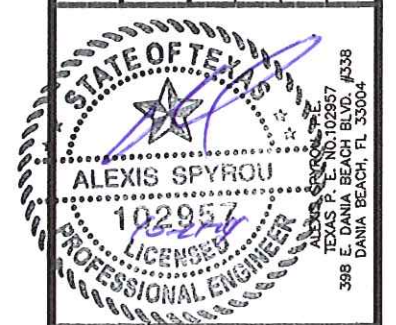

DATE: 08.06.12
DWN BY: MSS
CHK BY: HFN
SCALE: NTS

DWG #: AWD067
SHEET: 5 OF 5