



SPECIFICATIONS AND NOTES

1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +204.8 LBS/FT & -232.8 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. (.0216) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.

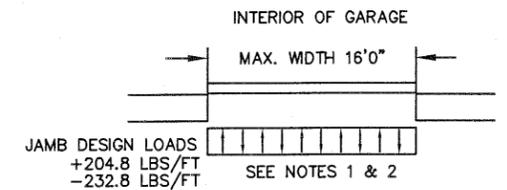

REV	DESCRIPTION OF REVISIONS	DATE	BY
	MAX SIZE 16' WIDTH 14' HEIGHT (DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)		
	DESIGN LOADS +25.6 PSF -29.1 PSF		
	TEST LOADS (1.5 x DESIGN LOADS) +38.4 PSF -43.6 PSF		
	Thomas L. Shelmerdine, PE (TX PE #85829) Structural Solutions, PA (TX Firm #F-004063)		

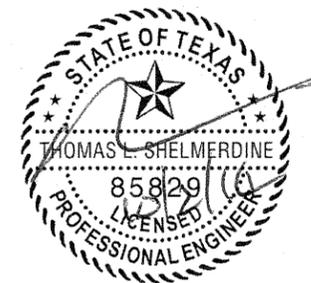

TX

Amarr

ENTRE/MATIC
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105



MODEL #1200 HERITAGE 3000
MODEL #1200 OAK SUMMIT 3000
SHORT, LONG, FLUSH & OAK SUMMIT PANELS

SIZE	DRAWN BY	RLR	DATE	07/22/14	DRAWING NUMBER
B	CHECKED BY	DATE			IRC-1216-130-15
					SHEET 1 OF 4




THE METHOD OF TESTING WAS IN SUBSTANTIAL CONFORMANCE WITH THE PROCEDURE DESCRIBED IN DASMA 108. THE PRESSURES SHOWN ON THE DRAWINGS WERE CALCULATED USING ASCE 7-98/02/05 WITH THE FOLLOWING PARAMETERS (5 FEET OF DOOR WIDTH IN THE END ZONE, ROOF AT ANY SLOPE, AND I=1.0):

WIND SPEED (MPH)	130	118	112	107	103
EXPOSURE LEVEL	B	C	C	D	D
MEAN ROOF HEIGHT	30'	15'	25'	15'	25'

OPTIONAL SHORT AND LONG PANEL GLAZING LAYOUTS
GLAZING MEETS ASTM E1300-04

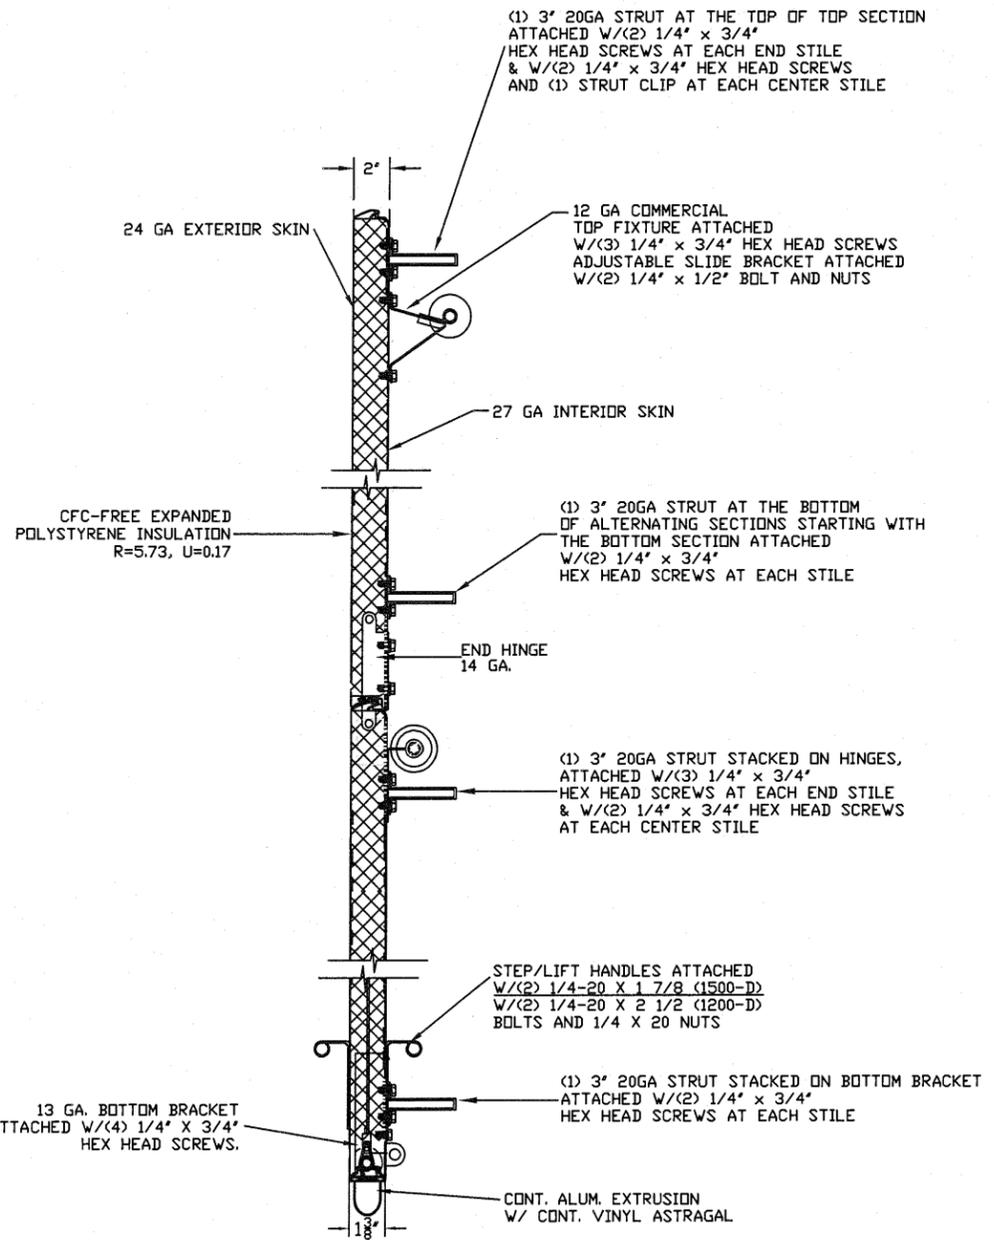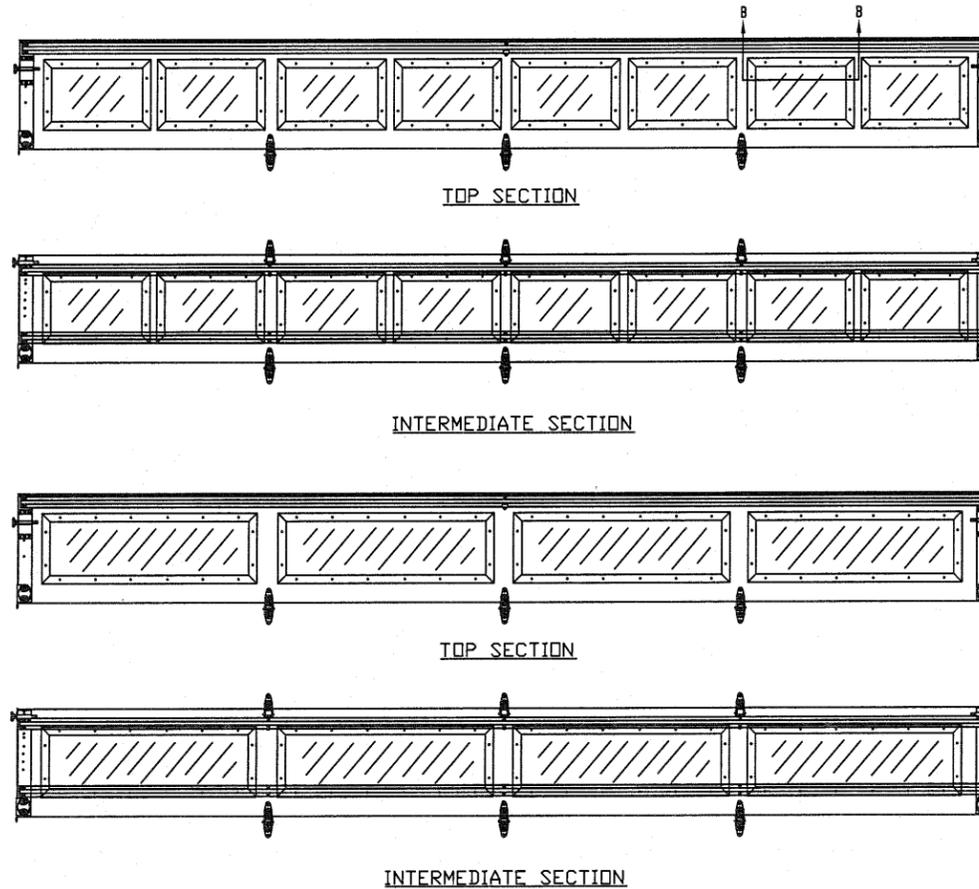


GLAZING OPTION CROSS SECTION
GLAZING NOT AVAILABLE IN WIND-BORNE DEBRIS REGION

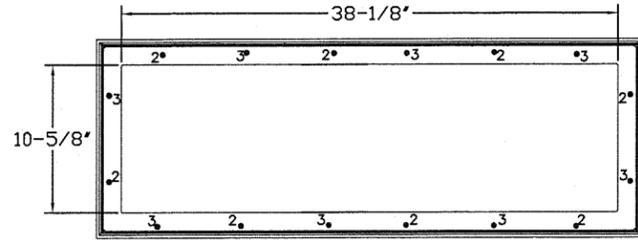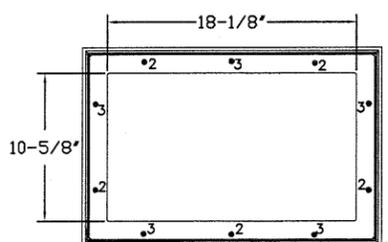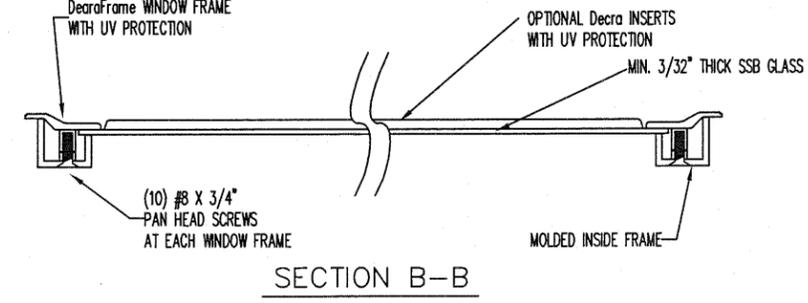

REV	DESCRIPTION OF REVISIONS	DATE	BY
<p>MAX SIZE 16' WIDTH 14' HEIGHT (DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)</p> <p>DESIGN LOADS +25.6 PSF -29.1 PSF</p> <p>TEST LOADS (1.5 x DESIGN LOADS) +38.4 PSF -43.6 PSF</p>		<p>Thomas L. Shelmerdine, PE (TX PE #85829) Structural Solutions, PA (TX Firm #F-004063)</p> <p>STATE OF TEXAS THOMAS L. SHELMERDINE 85829 LICENSED PROFESSIONAL ENGINEER TX</p>	
<p>Amarr ENTRE/MATIC 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105</p>			
<p>MODEL #1200 HERITAGE 3000 MODEL #1200 OAK SUMMIT 3000 SHORT, LONG, FLUSH & OAK SUMMIT PANELS</p>			
SIZE	DRAWN BY RLR	DATE 07/22/14	DRAWING NUMBER
B	CHECKED BY	DATE	IRC-1216-130-15
			SHEET 2 OF 4

5921-G.W. Friendly Ave., Greensboro, NC 27410

WOOD JAMB ATTACHMENT TO STRUCTURE

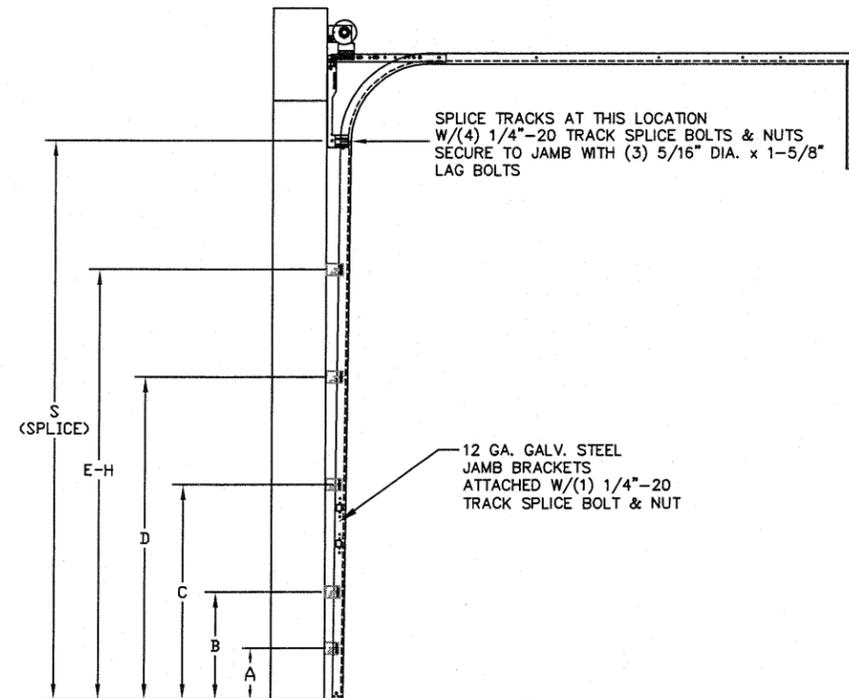

TRACK CONFIGURATION FOR 6'6" UP TO 14' TALL DOORS (SEE TABLE 1)
N.T.S.

TABLE 1

DOOR HEIGHT	TRACK ATTACHMENT								SPLICE S
	A	B	C	D	E	F	G	H	
6' 6"	3.5"	21"	42"	63"					70"
7'	3.5"	21"	42"	63"					76"
7' 6"	3.5"	21"	42"	63"					82"
8'	3.5"	21"	42"	63"					88"
8' 6"	3.5"	21"	42"	63"	84"				94"
9'	3.5"	21"	42"	63"	84"				100"
9' 6"	3.5"	21"	42"	63"	84"				106"
10'	3.5"	21"	42"	63"	84"	105"			112"
10' 6"	3.5"	21"	42"	63"	84"	105"			118"
11'	3.5"	21"	42"	63"	84"	105"			124"
11' 6"	3.5"	21"	42"	63"	84"	105"			130"
12'	3.5"	21"	42"	63"	84"	105"	126"		136"
12' 6"	3.5"	21"	42"	63"	84"	105"	126"		142"
13'	3.5"	21"	42"	63"	84"	105"	126"		148"
13' 6"	3.5"	21"	42"	63"	84"	105"	126"	147"	154"
14'	3.5"	21"	42"	63"	84"	105"	126"	147"	160"

ALL TRACK ATTACHMENT SPACING +/- 1.5' ALLOWED
WITH SYP OR SPF NO. 2 OR BETTER ONLY



2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE
5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS THEN 24" O.C. (1 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE
HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 20" O.C. (1 1/4" EMBEDMENT)
ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK
SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3' APART) AT 16" O.C. (1 1/2" EMBEDMENT)
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3' APART) AT 16" O.C. (1 1/4" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 24" O.C. (1 1/4" EMBEDMENT) (OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)

*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
*PREPARATION OF WOOD JAMBS BY OTHERS

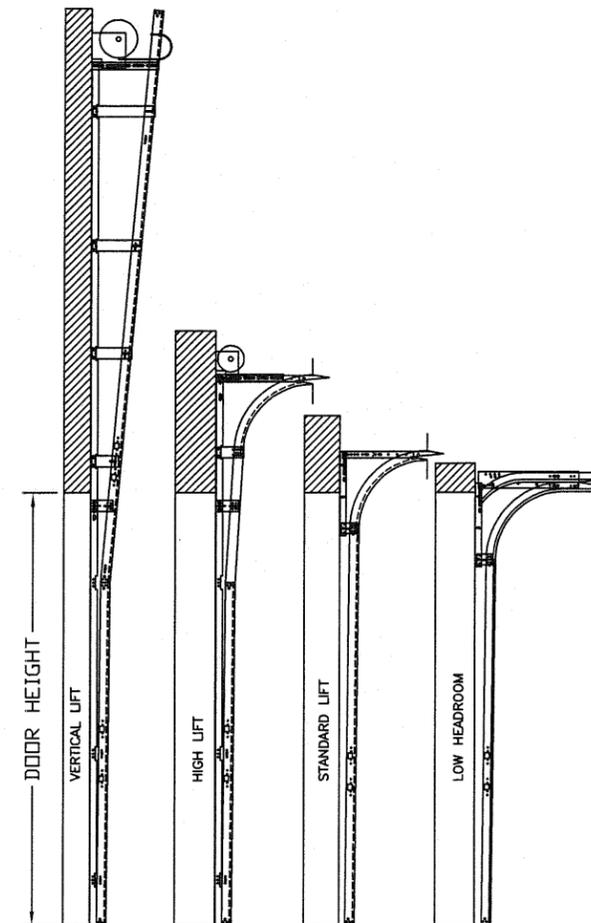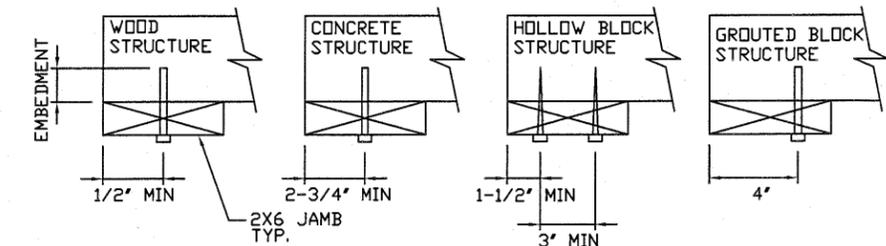

AVAILABLE TRACK CONFIGURATIONS
N.T.S.

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE
16' WIDTH
14' HEIGHT
(DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)

DESIGN LOADS
+25.6 PSF
-29.1 PSF

TEST LOADS
(1.5 x DESIGN LOADS)
+38.4 PSF
-43.6 PSF

Thomas L. Shelmerdine, PE (TX PE #85829)
Structural Solutions, PA (TX Firm #004063)

STATE OF TEXAS
THOMAS L. SHELMERDINE
85829
LICENSED PROFESSIONAL ENGINEER
TX

5921-G W. Friendly Ave., Greensboro, NC 27410

Amarr
ENTREMATIC
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

MODEL #1200 HERITAGE 3000
MODEL #1200 OAK SUMMIT 3000
SHORT, LONG, FLUSH & OAK SUMMIT PANELS

SIZE	DRAWN BY	RLR	DATE	07/22/14	DRAWING NUMBER
B	CHECKED BY		DATE		IRC-1216-130-15

SHEET 3 OF 4

TABLE 2

Section	Panel Type	Center Stile Locations (Measured from Left Edge)				Max Design Loads Allowed	
		1st (in)	2st (in)	3rd (in)	4th (in)	Positive (PSF)	Negative (PSF)
10' 0	Short	48.41	71.59			34.2	38.8
10' 0	Long	30.00	60.00	90.00		40.8	46.3
10' 0	Oak Summit	30.63	60.00	89.38		40.8	46.3
12' 0	Short	48.81	72.00	95.19		34.0	38.6
12' 0	Long	49.63	72.00	94.38		34.0	38.6
12' 0	Oak Summit	48.31	72.00	95.69		34.0	38.6
12' 2	Short	49.64	73.00	96.36		33.5	38.1
12' 2	Long	50.08	73.00	95.92		33.5	38.1
12' 2	Oak Summit	49.06	73.00	96.94		33.5	38.1
12' 4	Short	50.64	74.00	97.36		33.0	37.6
12' 4	Long	51.08	74.00	96.92		33.0	37.6
12' 4	Oak Summit	49.81	74.00	98.19		33.0	37.6
12' 6	Short	50.67	75.00	99.33		32.6	37.1
12' 6	Long	51.17	75.00	98.83		32.6	37.1
12' 6	Oak Summit	50.56	75.00	99.44		32.6	37.1
12' 8	Short	51.67	76.00	100.33		32.2	36.6
12' 8	Long	52.10	76.00	99.90		32.2	36.6
12' 8	Oak Summit	51.31	76.00	100.69		32.2	36.6
12' 10	Short	52.25	77.00	101.75		31.8	36.1
12' 10	Long	53.10	77.00	100.90		31.8	36.1
12' 10	Oak Summit	52.06	77.00	101.94		31.8	36.1
13' 0	Short	53.00	78.00	103.00		31.4	35.6
13' 0	Long	54.10	78.00	101.90		31.4	35.6
13' 0	Oak Summit	52.81	78.00	103.19		31.4	35.6
13' 2	Short	54.00	79.00	104.00		31.0	35.2
13' 2	Long	55.10	79.00	102.90		31.0	35.2
13' 2	Oak Summit	53.56	79.00	104.44		31.0	35.2
13' 4	Short	54.40	80.00	105.60		30.6	34.7
13' 4	Long	54.90	80.00	105.10		30.6	34.7
13' 4	Oak Summit	54.31	80.00	105.69		30.6	34.7
13' 6	Short	55.40	81.00	106.60		30.2	34.3
13' 6	Long	55.90	81.00	106.10		30.2	34.3
13' 6	Oak Summit	55.06	81.00	106.94		30.2	34.3
13' 8	Short	56.40	82.00	107.60		29.8	33.9
13' 8	Long	56.63	82.00	107.38		29.8	33.9
13' 8	Oak Summit	55.81	82.00	108.19		29.8	33.9
13' 10	Short	57.16	83.00	108.71		29.5	33.5
13' 10	Long	57.17	83.00	108.83		29.5	33.5
13' 10	Oak Summit	56.56	83.00	109.44		29.5	33.5

Section	Panel Type	Center Stile Locations (Measured from Left Edge)				Max Design Loads Allowed	
		1st (in)	2st (in)	3rd (in)	4th (in)	Positive (PSF)	Negative (PSF)
14' 0	Short	57.76	84.00	110.11		29.1	33.1
14' 0	Long	58.63	84.00	109.38		29.1	33.1
14' 0	Oak Summit	57.31	84.00	110.69		29.1	33.1
14' 2	Short	58.85	85.00	111.41		28.8	32.7
14' 2	Long	59.17	85.00	110.83		28.8	32.7
14' 2	Oak Summit	58.06	85.00	111.94		28.8	32.7
14' 4	Short	59.16	86.00	112.71		28.4	32.3
14' 4	Long	60.17	86.00	111.83		28.4	32.3
14' 4	Oak Summit	58.81	86.00	113.19		28.4	32.3
14' 6	Short	59.86	87.00	114.01		28.1	31.9
14' 6	Long	61.17	87.00	112.83		28.1	31.9
14' 6	Oak Summit	59.56	87.00	114.44		28.1	31.9
14' 8	Short	60.56	88.00	115.31		27.8	31.6
14' 8	Long	64.81	88.00	131.19		27.8	31.6
14' 8	Oak Summit	60.31	88.00	115.69		27.8	31.6
14' 10	Short	61.26	89.00	116.61		27.5	31.2
14' 10	Long	65.60	89.00	132.40		27.5	31.2
14' 10	Oak Summit	61.06	89.00	116.94		27.5	31.2
15' 0	Short	61.94	90.00	117.94		27.2	30.9
15' 0	Long	66.60	90.00	133.40		27.2	30.9
15' 0	Oak Summit	63.63	90.00	146.38		21.7	24.7
15' 2	Short	62.66	91.00	119.21		26.9	30.5
15' 2	Long	67.60	91.00	134.40		26.9	30.5
15' 2	Oak Summit	64.13	91.00	147.88		21.5	24.4
15' 4	Short	63.60	79.20	104.80	130.40	26.6	30.2
15' 4	Long	67.25	92.00	136.75		26.6	30.2
15' 4	Oak Summit	64.63	92.00	149.38		21.3	24.2
15' 6	Short	66.62	93.00	139.38		26.3	29.9
15' 6	Long	67.60	93.00	138.40		26.3	29.9
15' 6	Oak Summit	67.42	93.00	138.58		26.3	29.9
15' 8	Short	67.62	94.00	140.38		26.0	29.6
15' 8	Long	68.60	94.00	139.40		26.0	29.6
15' 8	Oak Summit	68.02	94.00	139.98		26.0	29.6
15' 10	Short	68.62	95.00	141.38		25.7	29.3
15' 10	Long	69.17	95.00	140.83		25.7	29.3
15' 10	Oak Summit	68.62	95.00	141.38		25.7	29.3
16' 0	Short	69.62	96.00	142.38		25.6	29.1
16' 0	Long	70.60	96.00	141.40		25.6	29.1
16' 0	Oak Summit	69.42	96.00	143.58		25.6	29.1

TABLE 3

DOOR HEIGHT	SECTION HEIGHTS							
	Btm	#2	#3	#4	#5	#6	#7	#8
14' 0"	21"	21"	21"	21"	21"	21"	21"	21"
13' 6"	21"	21"	21"	21"	21"	18"	18"	21"
13' 0"	21"	21"	21"	18"	18"	18"	18"	21"
12' 6"	21"	18"	18"	18"	18"	18"	18"	21"
12' 0"	21"	21"	21"	21"	21"	18"	21"	
11' 6"	21"	21"	21"	18"	18"	18"	21"	
11' 0"	21"	18"	18"	18"	18"	18"	21"	
10' 6"	21"	21"	21"	21"	21"	21"		
10' 0"	21"	21"	21"	18"	18"	21"		
9' 6"	21"	18"	18"	18"	18"	21"		
9' 0"	18"	18"	18"	18"	18"	18"		
8' 6"	21"	21"	21"	18"	21"			
8' 0"	21"	18"	18"	18"	21"			
7' 6"	18"	18"	18"	18"	18"			
7' 0"	21"	21"	21"	21"				
6' 6"	21"	18"	18"	21"				

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE
16' WIDTH
14' HEIGHT
(DOOR HEIGHT SUBJECT TO WEIGHT LIMITATIONS)

DESIGN LOADS
+25.6 PSF
-29.1 PSF

TEST LOADS
(1.5 x DESIGN LOADS)
+38.4 PSF
-43.6 PSF



TX

Amarr

ENTRE/MATIC
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

MODEL #1200 HERITAGE 3000
MODEL #1200 OAK SUMMIT 3000
SHORT, LONG, FLUSH & OAK SUMMIT PANELS

Thomas L. Shelmerdine, PE (TX PE #85829)
Structural Solutions, PA (TX Firm #F-004063)

5921-G W. Friendly Ave., Greensboro, NC 27410

SIZE	DRAWN BY	RLR	DATE	07/22/14	DRAWING NUMBER
B	CHECKED BY		DATE		IRC-1216-130-15
					SHEET 4 OF 4