
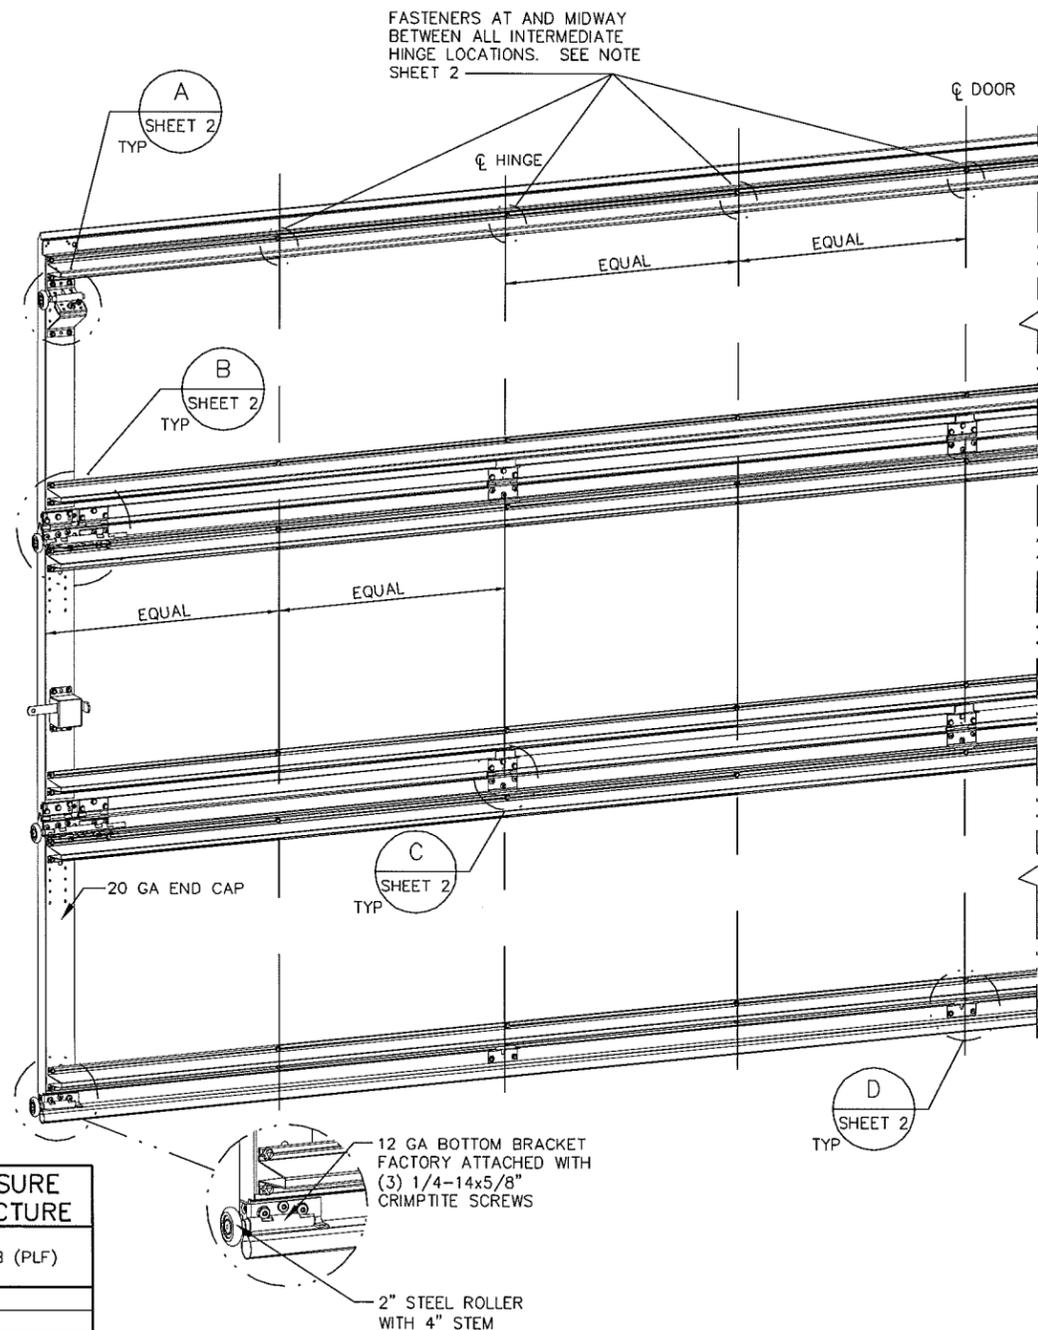


NOTES:

- VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.
- SLIDE LOCK OR OPERATOR REQUIRED.
- THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
- SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:
EXTERIOR - 27 GA
INTERIOR - 30 GA
- DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
- END CAPS ON TOP AND BOTTOM SECTIONS SHALL BE FACTORY ADHERED TO SECTION WITH SILAPRENE 6324 OR SILAPRENE M6344 ADHESIVE OR EQUAL. ADHESIVE SHALL BE APPLIED WITH (3) EQUALLY SPACED 3/16" WIDE BEADS FOR FULL HEIGHT OF END CAP.
- FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A LHR TOP BRACKET IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. SEE LHR DETAIL SHEET 2.
- SECTIONS SHALL HAVE A 20 GA BACKUP PLATE ACROSS THE TOP OF EACH SECTION.

NOTE: (3) SECTION DOOR SHOWN. SEE PAGE 2 FOR U-BAR LOCATIONS FOR (4) SECTION DOORS.

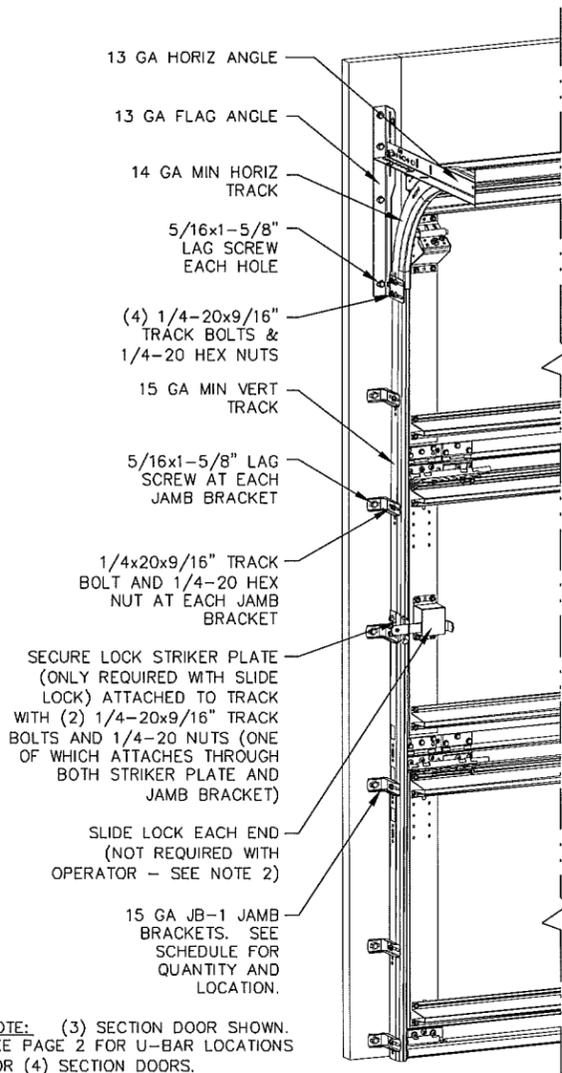

REVISIONS

P3 CHANGES MADE PER ETC LABORATORIES TESTING AND CHANGES TO GENERAL FORMAT 1/17/06 GRT
P4 UPDATED TITLE BLOCK 4/15/13 GRT

JAMB BRACKET SCHEDULE			
DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
7'-0"	3	6	2", 10", 26", 42", 53", 63"
8'-0"	4	8	2", 10", 26", 39", 48", 57", 66", 75"

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE		
DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
18'-0"	7'-0"	+166.5/-186.3
	8'-0"	+166.5/-186.3





John E. Scates
6/28/13

JOHN E. SCATES, PE
3121 FAIRGATE DR.
CARROLLTON, TX 75007
FL PE 51737 TX PE 56308/F2203

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

Wayne Dalton
A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890


STATIC PRESSURE RATINGS	APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF): +18.50/-20.70	MAX WIDTH: 18'-0"	DATE	NAME
TEST (PSF): +27.75/-31.05	MAX HEIGHT: 8'-0"	DRAWN	1/17/06 GRT
IMPACT/CYCLIC RATED (YES/NO): NO	MAX SECTION HEIGHT: 28"	CHECKED	2/10/06 MRB
MODELS 9550/9700		SHEET 1 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 0526		DRAWING PART NO.	REV.
		313641	P4

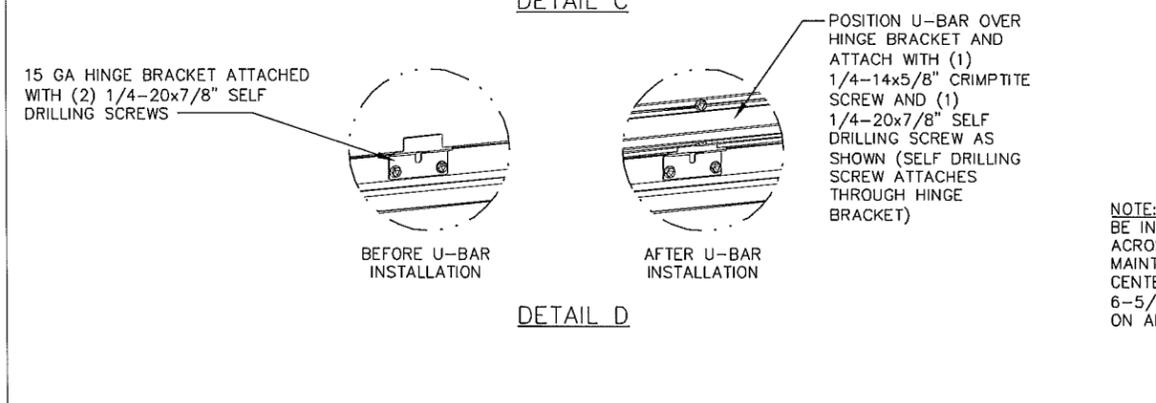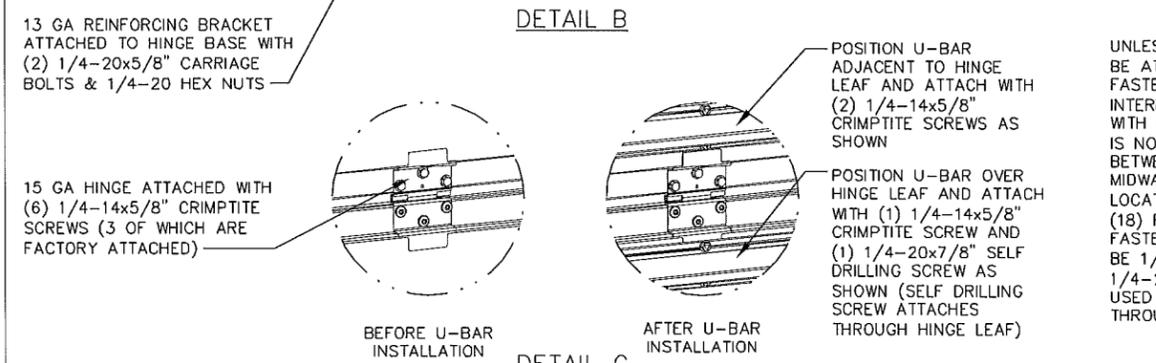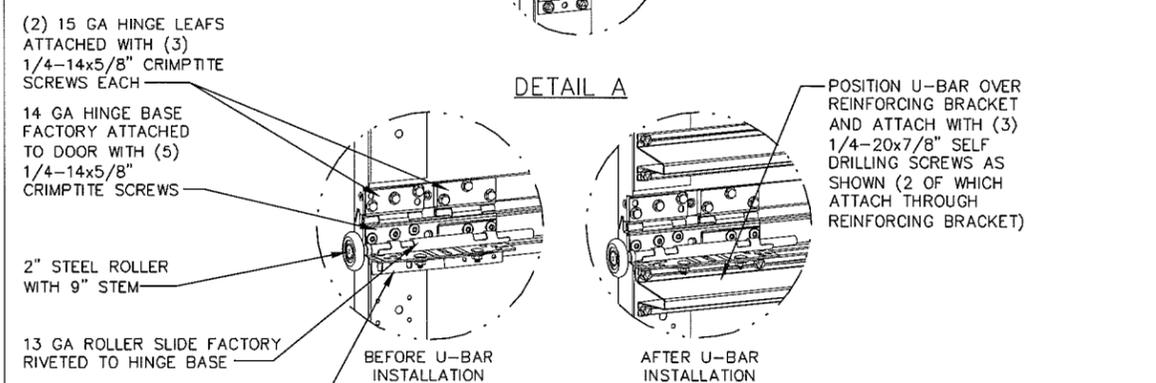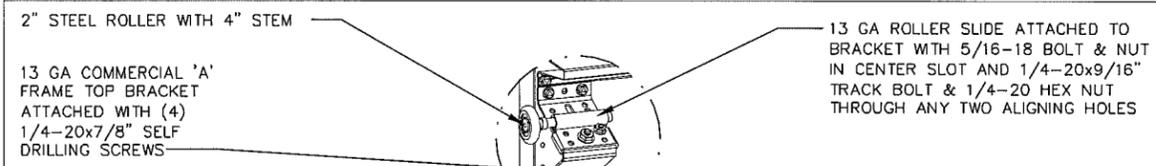


John E. Scates
6/28/13

JOHN E. SCATES, PE
3121 FAIRGATE DR.
CARROLLTON, TX 75007
FL PE 51737 TX PE 56308/F2203

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

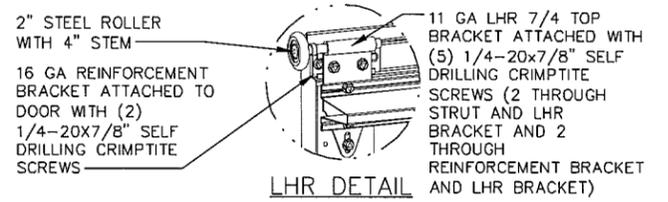

U-BAR LOCATIONS

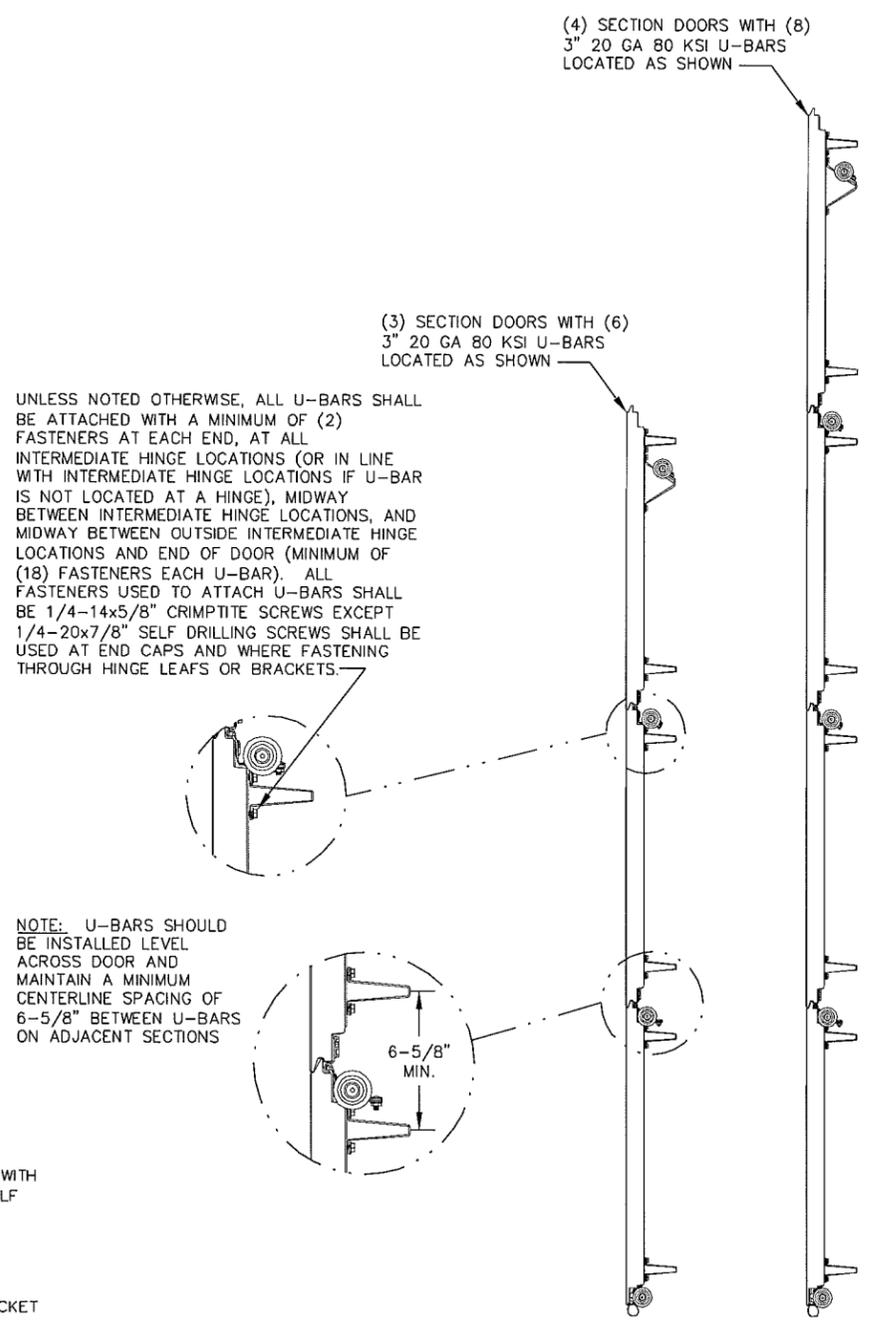

REVISIONS

P3 CHANGES MADE PER ETC LABORATORIES TESTING AND CHANGES TO GENERAL FORMAT 1/17/06 GRT
P4 UPDATED TITLE BLOCK 4/15/13 GRT

WAYNE DALTON®
A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS	APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF): +18.50/-20.70	MAX WIDTH: 18'-0"	DATE	NAME
TEST (PSF): +27.75/-31.05	MAX HEIGHT: 8'-0"	DRAWN 1/17/06	GRT
IMPACT/CYCLIC RATED (YES/NO): NO	MAX SECTION HEIGHT: 28"	CHECKED 2/10/06	MRB
MODELS 9550/9700		SHEET 2 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 0526		DRAWING PART NO. 313641	REV. P4