


MODELS	24 GA SHORT	27 GA SHORT	27 GA FLUSH	27 GA LONG
CLOPAY	4400, 4401	4300, HDG	4301, HDGF	4310, HDGL
HOLMES	--	66, 66G, 6200	68, 6201	67, 67G, 6203
IDEAL	--	SP200	SF200	SE200


DOOR HEIGHT	# OF SECTIONS	# OF STRUTS
UP TO 7'0"	4	3
7'3" TO 8'0"	5	3
8'3" TO 8'9"	5	4
9'0" TO 10'6"	6	4
10'9" TO 12'3"	7	5
12'6" TO 14'0"	8	6
14'3" TO 15'9"	9	7
16'0"	10	8
MAX SECTION HEIGHT: 21'		

**EQUIVALENT SECTION CONSTRUCTION:** FOR ANY OF THE MODELS LISTED ON THIS DRAWING, THE FOLLOWING W-LEVEL DOORS USE EQUIVALENT SECTIONS (UP TO THE MAXIMUM WIDTH ALLOWED ON THIS DRAWING). **W1, W4.** ANY OF THESE W-LEVELS MAY BE SHOWN ON THE OPTIONAL SHIPPING LABEL ON THE END STILE.

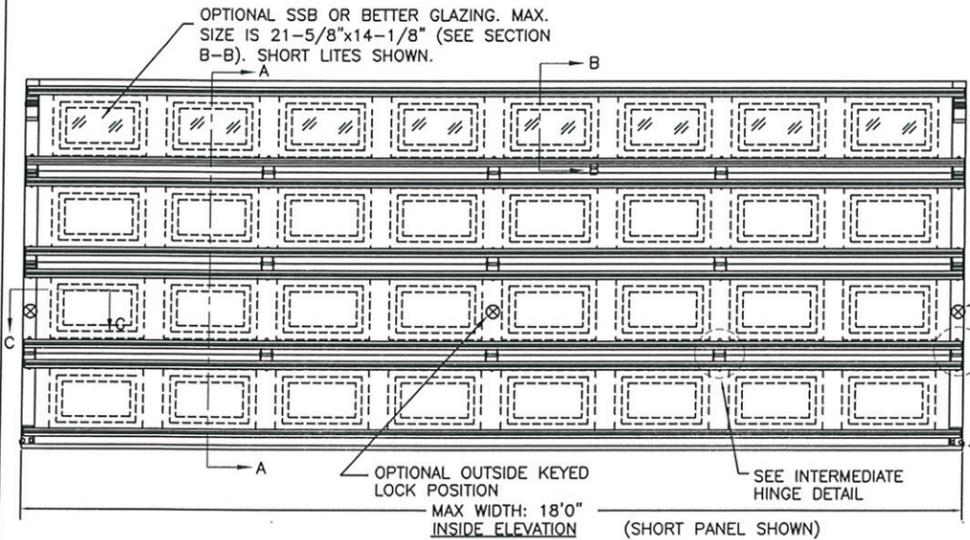

IN THE CASE OF GYPSUM WALLBOARD LOCATED AT OR NEAR THE DOOR OPENING LOCATION THERE ARE TWO ACCEPTABLE ALTERNATIVES:

- 1) THE WALLBOARD CAN BE CUT AWAY FROM THE DOOR OPENING AND 2X6 SOUTHERN YELLOW PINE WOOD JAMBS MOUNTED DIRECTLY TO THE SUPPORTING STRUCTURE TO CREATE THE MOUNTING SURFACE. ALTERNATIVELY, THE BRACKETS MAY BE ATTACHED DIRECTLY TO THE SUPPORTING STRUCTURE. SEE DETAIL BELOW. THE CENTER OF SCREW HOLE MUST BE AT LEAST 1/2" FROM BOTH EDGES FOR A 5/16" LAG SCREW.
- 2) IF THE WALLBOARD IS NOT CUT AWAY TO EXPOSE THE UNDERLYING STRUCTURE (WOOD FRAMING MEMBERS), A 2X6 SOUTHERN YELLOW PINE WOOD BUCK OVER SHALL BE INSTALLED THE WALLBOARD FRAMING THE OPENING USING THE JAMB ATTACHMENT FASTENERS LISTED BELOW. HOWEVER, THE JAMB ATTACHMENT FASTENERS MUST BE OF A SUFFICIENT INCREASED LENGTH TO ACCOUNT FOR THE THICKNESS OF THE WALLBOARD TO ENSURE PROPER FASTENER EMBEDMENT INTO THE STRUCTURAL FRAMING MEMBERS OF THE SUPPORTING STRUCTURE.

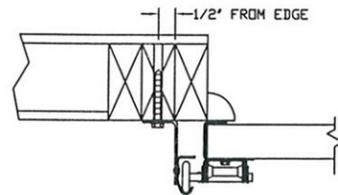

PREPARATION OF JAMBS BY OTHERS.


**VERTICAL JAMB ATTACHMENT (WOOD FRAME BUILDINGS):**

3/8"x3" LAG SCREWS ON 24" CENTERS. 1-1/8" O.D. WASHER REQUIRED. LAG SCREWS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.


**VERTICAL JAMB ATTACHMENT (C-90 BLOCK OR 2,000 PSI MIN. CONCRETE COLUMN):** 3/8"x3" SLEEVE ANCHOR BOLTS ON 18" CENTERS (2,000 PSI MIN. CONCRETE). WASHERS INCLUDED WITH SLEEVE ANCHORS.

OR 1/4"x3" TAPCON SCREWS ON 15" CENTERS (2,000 PSI MIN. CONCRETE) OR 8" CENTERS (C-90 BLOCK), 1" O.D. WASHERS REQUIRED WITH TAPCONS. ANCHORS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.




**OTHER JAMB CONFIGURATIONS:** REFER TO DASMA TDS-161. A LICENSED DESIGN PROFESSIONAL MAY ALSO BE EMPLOYED TO APPROVE ALTERNATE FASTENERS AND/OR JAMB CONFIGURATIONS.

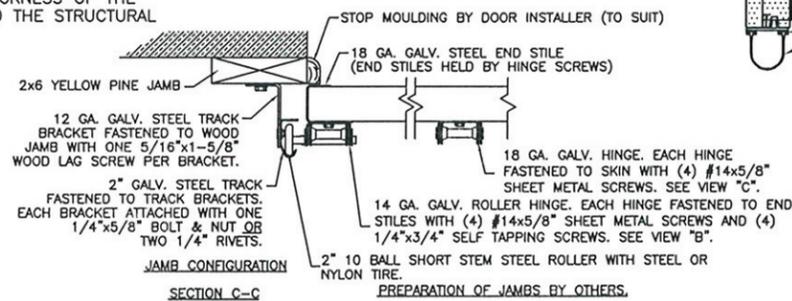

NOTE: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THE DRAWING.

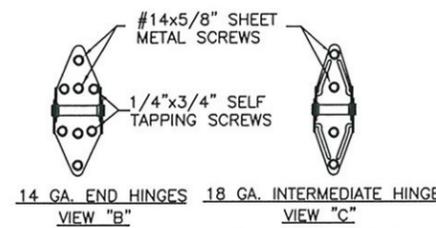

(NOTE: 14 GA. INTERMEDIATE HINGES ON 24 GA. EXTERIOR SKIN DOOR MODELS.)

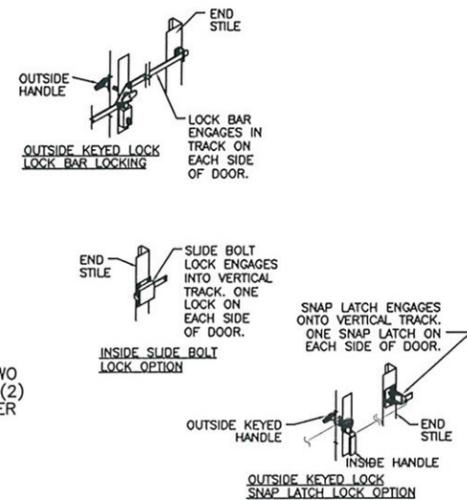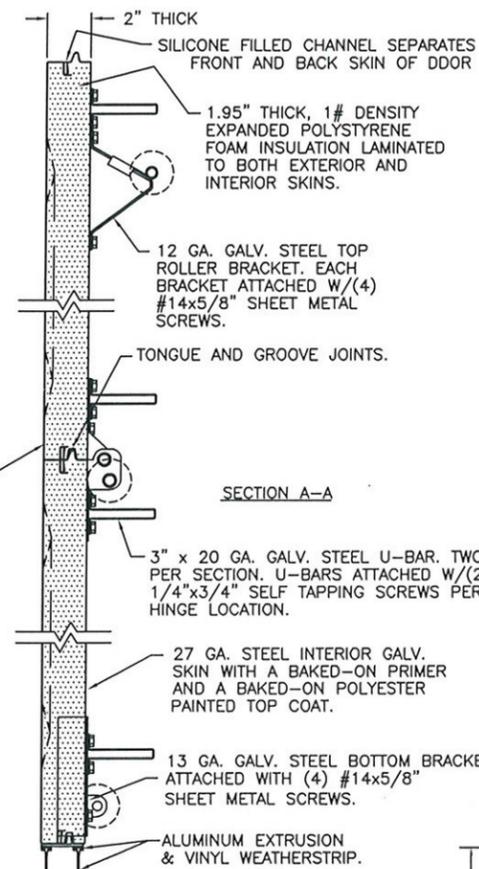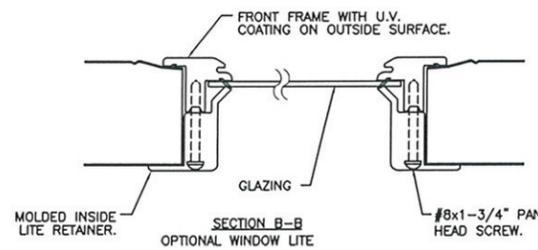

THE OPTIONAL GLAZING SHOWN ON THIS DRAWING MEETS THE WIND LOAD REQUIREMENTS OF THE FLORIDA BUILDING CODE OR INTERNATIONAL BUILDING CODE BUT DOES NOT MEET THE IMPACT RESISTANT REQUIREMENT FOR WINDBORNE DEBRIS REGIONS (REF. CHAPTER 16 FBC/IBC)


THIS DOOR MEETS OR EXCEEDS THE DESIGN LOADS FOR THE WIND SPEEDS LISTED BELOW ACCORDING TO THE FLORIDA BLDG. CODE OR IBC (ASCE7) FOR THE FOLLOWING CONDITIONS: 1) ENCLOSED BUILDING, 2) DOOR HAS 2' OF WIDTH IN BUILDING'S END ZONE, 3) IMPORTANCE FACTOR OF 1.0, 4) ANY ROOF SLOPE, AND 5) 50% SAFETY FACTOR.

WIND SPEED (MPH)	≤ 100	110	110	120
EXPOSURE LEVEL	B or C	B	C	B
MEAN ROOF HEIGHT	30'	30'	15'	30'

NOTE: TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING OF THIS DOOR.



HORIZONTAL TRACK SUPPORT BY DOOR INSTALLER (TO SUIT)

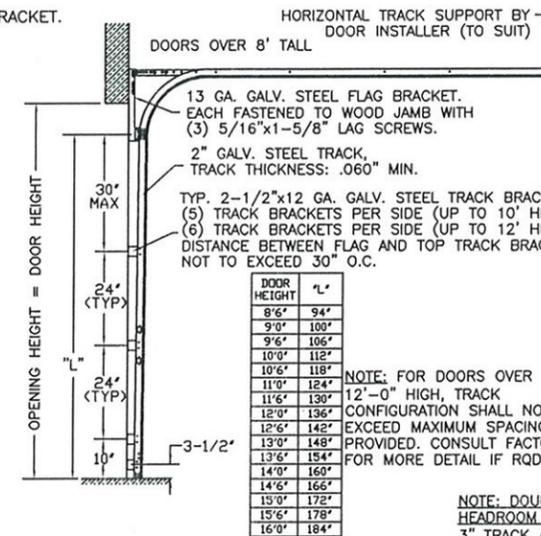

NOTE: FOR DOORS OVER 12'-0" HIGH, TRACK CONFIGURATION SHALL NOT EXCEED MAXIMUM SPACING PROVIDED. CONSULT FACTORY FOR MORE DETAIL IF RQD.

NOTE: DOUBLE TRACK LOW HEADROOM AVAILABLE. 3" TRACK AVAILABLE AS NEEDED.

DESIGN LOADS: +25.0, -25.0 PSF  
TEST LOADS: +37.5, -37.5 PSF

DOOR HEIGHT	"L"
6'-6"	70"
7'-0"	76"
7'-6"	82"
8'-0"	88"

ORIGINAL DRAWINGS ARE SIGNED IN BLUE INK WITH A RAISED SEAL (EMBOSSED)

DESIGN ENGINEER: MARK WESTWOOD, P.E.  
FLORIDA P.E. #48495  
NC P.E. #23832  
TEXAS P.E. #91513

**Clopay**  
Building Products  
Company  
Clopay Corporation All Rights Reserved.

8585 DUKE BLVD.  
MASON, OH 45040  
(513) 770-4800

REV	DATE	DESCRIPTION
12	8/2004	ADD M/N SP20, SE20, SF20
13	6/2005	UPDATED CODE REF.
14	9/2005	ADDED ROLLER OPTION
15	11/30/07	ADDED EXTENDED HEIGHTS & COMBINED W/ HOLMES M/N
16	08/12/08	ADDED MPC INFO AND HDGF, 66G, 67G, 68G
17	10/2009	REVISED FOR TDI.
18	06/2013	REVISED MAX GLAZING SIZE.

MANUFACTURING PRODUCT CODE MPC: DSIE-1F171	WINDLOAD RATING W4	MAX. SIZE: 18'0" x 16'0"
DATE: 7/29/94	DESCRIPTION: WINDLOAD MODELS 4400, 4401, 4310, HDG, HDGL, 4300, 4301	
DRAWN BY: MWW	DRAWING NUMBER: 101247	VER: TDI
CHECKED BY:	B	