

TEXAS DEPARTMENT OF INSURANCE

Engineering Services Program / MC 103-3A 333 Guadalupe Street P.O. Box 149104 Austin, Texas 78714-9104
Phone No. (512) 322-2212 Fax No. (512) 463-6693

PRODUCT EVALUATION RC-171

Effective October 1, 2012

*The following product has been evaluated for compliance with the wind loads specified in the **International Residential Code (IRC)** and the **International Building Code (IBC)**. This product shall be subject to reevaluation **September 2016**.*

This product evaluation is not an endorsement of this product or a recommendation that this product be used. The Texas Department of Insurance has not authorized the use of any information contained in the product evaluation for advertising, or other commercial or promotional purpose.

This product evaluation is intended for use by those individuals who are following the design wind load criteria in Chapter 3 of the IRC and Section 1609 of the IBC. The design loads determined for the building or structure shall not exceed the design load rating specified for the products shown in the limitations section of this product evaluation. This product evaluation does not relieve a Texas licensed engineer of his responsibilities as outlined in the Texas Insurance Code, the Texas Administrative Code, and the Texas Engineering Practice Act.

24 Gauge Tech Lock 2000 Metal Roofing Panel manufactured by

R.B. Hash & Associates, Inc.
8619 Derrington
Houston, Texas 77064
Telephone: (713) 463-9800
www.rbhash.com

will be accepted for use in areas along the Texas Gulf Coast when installed in accordance with the manufacturer's installation instructions and this product evaluation.

PRODUCT DESCRIPTION

The 24 gauge Tech Lock 2000 metal roofing panels have a 16" coverage. The metal roofing panels have a 2" high rib with a double lock mechanically seamed seam. The metal roofing panels are manufactured from 24 gauge Galvalume Plus coated steel conforming to ASTM A792, Grade 50, with a minimum yield strength of 50 ksi. The metal roofing panels can be painted with a Kynar 500 finish coating. Figure 1 illustrates a profile view of the metal roofing panel.

LIMITATIONS

Roof Decking: The metal roofing panels shall be installed over minimum $1\frac{5}{32}$ " plywood decking.

New Roof Deck Attachment: The roof decking shall meet or exceed the uplift requirements of the International Residential Code or International Building Code and shall be installed as required for resistance to lateral wind loads.

Design Wind Pressures: The design pressure uplift load resistance shall be as specified in Table 1.

Table 1

Attachment of minimum 24 gauge Tech Lock 2000 metal roofing panels to minimum $1\frac{5}{32}$ " plywood decking

Design Wind Pressure	Clip Fastener	Clip Spacing
-93.5 psf	Two (2) No. 10-13 x 1"	24"
-131.0 psf	Two (2) No. 10-13 x 1"	6"

Installation Over an Existing Roof Covering: Installation over an existing roof covering is limited to a maximum of one existing layer of composition shingles, wood shingles or shakes, built-up roofing, or roll roofing applied over an existing, solid roof deck of minimum $1\frac{5}{32}$ inch plywood. Note: Inspection of the existing roof deck must be made prior to the installation of the roof panels. The condition of the existing roof deck must be acceptable to receive the metal roofing panels before the metal roofing panel installation proceeds. NOTE: Underlayment is not required to be installed.

Roof Slope: The metal roofing panels may be installed on roofs with a roof slope as low as 3:12.

INSTALLATION INSTRUCTIONS

General: The metal roofing panels shall be installed in accordance with the manufacturer's recommended installation instructions and this product evaluation report.

Panels: The metal roofing panels shall be secured to the roof deck as specified in Table 1 and in accordance with this section.

Underlayment: A minimum of one layer of No. 15 (Type I) asphalt felt shall be used. The underlayment used shall comply with one or more of the following: ASTM D 226, ASTM D 4869, or ASTM D 1970. The underlayment shall be installed with 6-inch side laps and 3-inch end laps. The underlayment shall be applied with corrosion-resistant fasteners in accordance with the manufacturer's installation instructions. Fasteners shall be applied along the overlaps not farther apart than 36 inches on center.

Attachment of Metal Roofing Panels to Roof Deck: The metal roofing panels shall be secured to the roof deck as follows:


Roofing Panels: Minimum No. 10-13" x 1" GP Pancake screws, manufactured by Triangle Fastener with 3" long FG-218-22 galvanized steel panel installation clips by Logan Stamping, Inc. Figure 2 illustrates the panel installation clip. The fasteners shall be long enough to ensure a minimum penetration of $\frac{1}{4}$ " below the roof deck. (Note: If the metal roofing panels are installed over an existing roof covering, then the fastener length shall be increased so that the fasteners are long enough to ensure a minimum penetration of $\frac{1}{4}$ " below the existing plywood roof decking.) The required size and quantity of fasteners as well as the maximum allowable spacing of the clips is specified in Table 1.

Trims, Closures, and Accessories: Components, such as the eave trim, rake trim, ridge trim, and valley trim shall be installed as required by the manufacturer.

Alternative Fasteners: Substitution of equivalent fasteners shall meet the following requirements:


- No. 10-13 x 1" GP Pancake, manufactured by Triangle Fastener
- Ultimate withdrawal (pullout) \geq 350 lbs. in minimum $1\frac{5}{32}$ " plywood.

Note: The manufacturer's installation instructions shall be available on the job site during the installation. All fasteners shall be corrosion resistant as specified in the International Residential Code (IRC), the International Building Code (IBC), and the Texas Revisions.

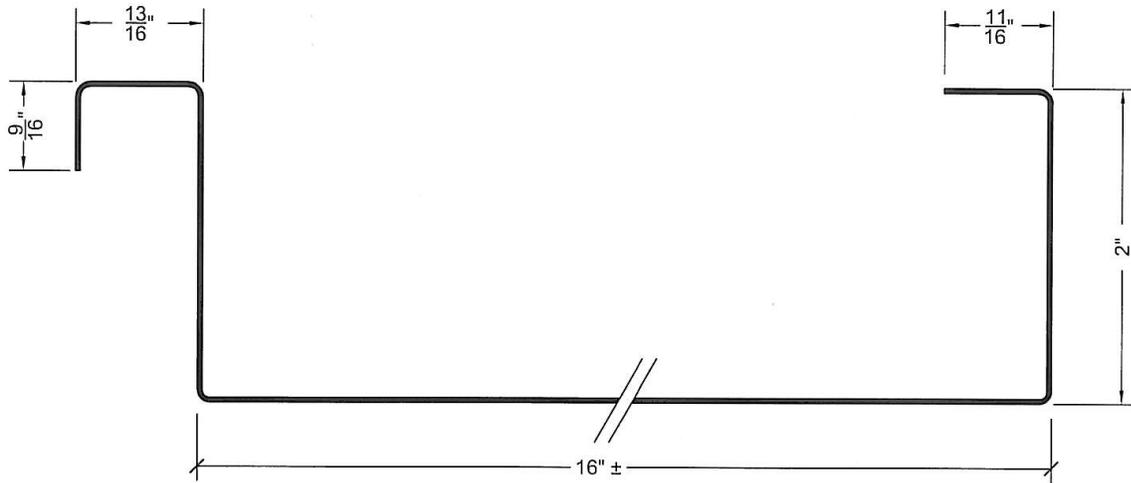

TECH-LOCK 2000 PANEL PROFILE N.T.S.

Figure 1. Tech Lock 2000 Panel – Profile

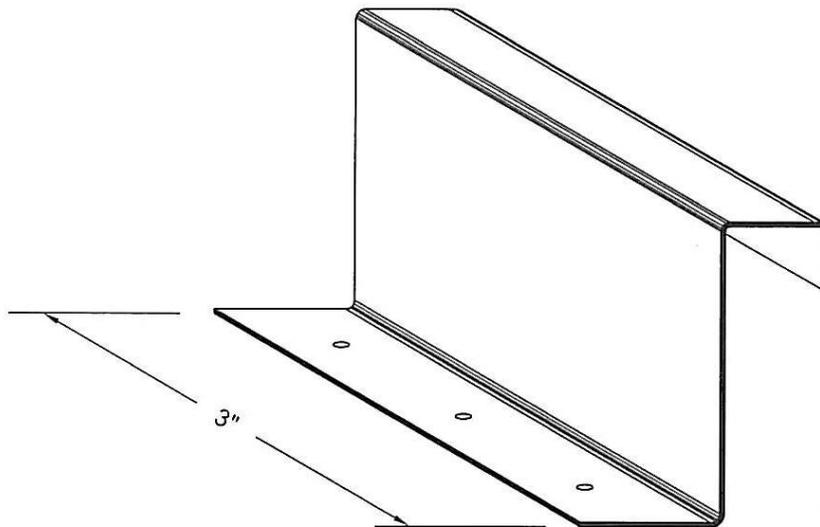

PANEL ATTACHMENT CLIP N.T.S.
LOGAN STAMPINGS INC.
FG-218-22

Figure 2. Tech Lock 2000 Panel Attachment Clip